

Bay Colony Group, Inc.

Professional Civil Engineers & Land Surveyors

4 School Street, PO Box 9136

Foxborough, Massachusetts 02035

Telephone (508) 543-3939 • Fax (508) 543-8866

E-mail: mailbox@baycolonygroup.com

**NOTICE OF INTENT
WETLANDS PROTECTION ACT
MASS G.L.C. 131, SECTION 40**

**7 Perry Drive
Foxborough, MA**

June, 2023

PREPARED FOR: Technimetals
7 Perry Drive
Foxborough, MA 02035

Bay Colony Group, Inc.

Professional Civil Engineers & Land Surveyors

4 School Street, PO Box 9136
Foxborough, Massachusetts 02035
Telephone (508) 543-3939 • Fax (508) 543-8866
E-mail: mailbox@baycolonygroup.com

June 15, 2023

Mr. Robert Boette, Chair
Foxborough Conservation Commission
40 South Street
Foxborough, MA 02035

**RE: 7 Perry Drive
FOXBOROUGH, MA**

Dear Mr. Boette,

On behalf of our client, Technimetals, we are submitting herewith a Notice of Intent pursuant to MGL Chapter 131, S.40, Wetlands Protection Act (WPA) and Article 267 of the General Bylaws of the Town of Foxborough for the construction of a 12,000-sf addition along with the associated parking, grading and utilities at 7 Perry Drive that lies partially within the buffer zone to a bordering vegetated wetland (BVW).

Enclosed please find 8 copies of the WPA Form 3 - Notice of Intent (NOI), which includes the site plan for 7 Perry Drive prepared by this office. All abutting owners within 100' of the property have been notified about the proposed work by certified mail. A check in the amount of \$537.50 based on the WPA fee of \$1,050.00 and a check in the amount of \$1,500.00 based on the local bylaw is enclosed.

The property consists of a parcel of land (Map 002, Parcel 010) located on the southern side of Perry Drive just to the east of the intersection with Phelps Road (**Appendix A**). The northern portion of the property is developed and contains an existing 23,900-sf commercial facility along with the associated parking and shipping area. The remainder of the site (Map 002, Parcel 006 portion) is currently undeveloped and consists of a wooded area. The property contains bordering vegetated wetland (BVW) located on the southeastern and southwestern portion of the property. The wetlands were originally flagged by the Pare Corporation on November 4, 2021 for a project on a neighboring parcel. Since then, the Pare Corporation has revisited the site in order to reflagged the wetlands on June 12, 2023 and the flags were located by this firm in an on the ground survey on June 13, 2023. A copy of the original Pare Corporation Wetland Field Report is enclosed in **Appendix B**.

The proposed work consists of the construction of a 12,000 square foot addition on the southern side of the existing building along with the associated parking and grading on the southern portion of the property. A portion of the building, parking area and grading will lie within the buffer zone to a BVW. The building will sit about 51' from the wetland at its closet

point, the parking area will sit about 37' from the wetlands at its closet point and the grading for the grading will take place about 30' from the wetlands at its closet point. About 1,876 square feet of buffer zone will be altered due to the building, about 12,091 square feet of buffer zone will be altered due to the parking area and about 3,090 square feet will be altered due to the grading. In all about 17,057 square feet of alterations will take place within the 100' buffer zone. No work is proposed within the 25' No-Disturbance Zone.

The addition will be serviced by municipal water and an existing conventional septic system located to the north of the existing building. The storm water system will include roof drains, deep sump catch basin and a subsurface infiltration basin. The stormwater runoff from the proposed parking area will be treated by the catch basin before being conveyed to the infiltration basin. The roof runoff from the proposed addition will be conveyed to the infiltration basin separately. The system has been designed to comply with the DEP Stormwater Standards and the stormwater standards outlined in the Town of Foxborough Stormwater Management Bylaws. A copy of the stormwater impact report is enclosed in **Appendix C**.

Access to the addition and proposed parking area will take place over the existing driveway to the east of the building off of Perry Drive, which will be extended in order to provide access to the back of the lot. Erosion control for this project will consist of silt socks and sacks that will be installed prior to the start of construction and will be maintained until the project has been completed and ground cover has been reestablished. A stabilized construction entrance will also be installed at the end of the existing driveway to prevent the tracking of sediment by construction vehicles that exit the site.

The sequence of construction for the project can be found on **Sheet 7** (SWPPP & Snow Storage Plan) of the site plan. Once a contractor is chosen the plan will be updated. This sequence is subject to change based on weather, availability of materials, and personnel.

Thank you for your consideration and please feel free to contact me should you have any questions or concerns that you would like us to address prior to the public hearing.

Very truly yours,

BAY COLONY GROUP, INC.



Cameron Gray
Project Engineer



William R. Buckley, Jr., P.E.
Project Manager

List of Documents

Previous Page – Letter to Conservation Commission

WPA Form 3 – Notice of Intent
Wetland Fee Transmittal Form
Copies of Checks
Town of Foxborough Checklist

Form of Notification to Abutters


List of Abutters

Appendix A
USGS Quadrangle Map Extract
FEMA Flood Insurance Rate Map
Extract from MassMapper

Appendix B
Pare Corporation Wetland Field Report dated November 9, 2021

Appendix C
Stormwater Management Report 7 Perry Drive Foxborough, MA date June, 2023
(Not included in all copies)

Attachments
Site Development Plan of Land 7 Perry Drive Foxborough, MA by Bay Colony Group, Inc
dated June 14, 2023



WPA Form 3 – Notice of Intent

Massachusetts Wetlands Protection Act M.G.L. c. 131, §40
Foxborough Wetlands Protection Bylaw, Ch. 267

MassDEP File Number

Foxborough
Town

Important: When filling out forms on the computer, use only the tab key to move your cursor - do not use the return key.



Note:
Before completing this form consult your local Conservation Commission regarding any municipal bylaw or ordinance.

A. General Information

1. Project Location:

7 Perry Drive	Foxborough	02035
a. Street Address	b. Town	c. Zip Code
Latitude and Longitude:	42° 06' 16.7"N	71° 14' 56.5"W
	d. Latitude	e. Longitude
002	010	
f. Assessors Map/Plat Number	g. Parcel /Lot Number	

2. Applicant:

Peter	Berube	
a. First Name	b. Last Name	
Technimetals		
c. Organization		
7 Perry Drive		
d. Street Address		
Foxborough	MA	02035
e. City/Town	f. State	g. Zip Code
508.698.2444	pberube@technimetals.com	
h. Phone Number	i. Fax Number	j. Email Address

3. Property owner (required if different from applicant): Check if more than one owner

Applicant is also Owner

a. First Name	b. Last Name	
BPAZ holdings 31 LLC		
c. Organization		
1 Samsone St. 15 th Flr		
d. Street Address		
San Francisco	CA	94104
e. City/Town	f. State	g. Zip Code
302.658.7581		
h. Phone Number	i. Fax Number	j. Email address

4. Representative (if any):

William	Buckley, Jr.	
a. First Name	b. Last Name	
Bay Colony Group, Inc.		
c. Company		
4 School Street		
d. Street Address		
Foxborough	MA	02035
e. City/Town	f. State	g. Zip Code
508.543.3939	508.543.8866	billbuckley@baycolonygroup.com
h. Phone Number	i. Fax Number	j. Email address

5. Wetland Filing Fees Paid (to calculate fees, refer to attached NOI Wetland Fee Transmittal Form):

\$1,050	\$512.50	\$537.50	\$1,500
a. State WPA Fee/Total	b. WPA Fee/State's Share	c. WPA Fee/Town's Share	d. Town Bylaw (Ch. 267) Fee



WPA Form 3 – Notice of Intent

Massachusetts Wetlands Protection Act M.G.L. c. 131, §40
Foxborough Wetlands Protection Bylaw, Ch. 267

MassDEP File Number

Foxborough

Town

A. General Information *(continued)*

6. General Project Description:

The construction of a 12,000+/- sf addition off the existing building along with the associated parking, grading and utilities that lie partially within the buffer zone to a bordering vegetated wetland

7a. Project Type Checklist: (Limited Project Types see Section A. 7b.)

- | | |
|---|---|
| 1. <input type="checkbox"/> Single Family Home | 2. <input type="checkbox"/> Residential Subdivision |
| 3. <input checked="" type="checkbox"/> Commercial/Industrial | 4. <input type="checkbox"/> Dock/Pier |
| 5. <input type="checkbox"/> Utilities | 6. <input type="checkbox"/> N/A - Coastal engineering Structure |
| 7. <input type="checkbox"/> Agriculture (e.g., cranberries, forestry) | 8. <input type="checkbox"/> Transportation |
| 9. <input type="checkbox"/> Other | |

7b. Is any portion of the proposed activity eligible to be treated as a limited project (including Ecological Restoration Limited Project) subject to 310 CMR 10.53 (inland)?

1. Yes No If yes, describe which limited project applies to this project. (See 310 CMR 10.53 for a complete list and description of limited project types)

2. Limited Project Type

If the proposed activity is eligible to be treated as an Ecological Restoration Limited Project (310 CMR 10.53(4)), complete and attach Appendix A: Ecological Restoration Limited Project Checklist and Signed Certification.


8. Property recorded at the Registry of Deeds for:

<u>Norfolk</u>	<u>39246</u>	<u>114</u>
a. County	b. Certificate # (if registered land)	c. Book
		d. Page Number

B. Buffer Zone & Resource Area Impacts (temporary & permanent)

- Buffer Zone Only – Check if the project is located only in the Buffer Zone of a Bordering Vegetated Wetland, or Inland Bank.
- Inland Resource Areas (see 310 CMR 10.54-10.58).

Check all that apply below. Attach narrative and any supporting documentation describing how the project will meet all performance standards for each of the resource areas altered, including standards requiring consideration of alternative project design or location.



WPA Form 3 – Notice of Intent

Massachusetts Wetlands Protection Act M.G.L. c. 131, §40
Foxborough Wetlands Protection Bylaw, Ch. 267


MassDEP File Number

Foxborough
Town

B. Buffer Zone & Resource Area Impacts (temporary & permanent) (continued)

For all projects affecting other Resource Areas, please attach a narrative explaining how the resource area was delineated.

Resource Area	Size of Proposed Alteration	(if any) Proposed Replacement
a. <input type="checkbox"/> Bank	1. linear feet	2. linear feet
b. <input type="checkbox"/> Bordering Vegetated Wetland	1. square feet	2. square feet
c. <input type="checkbox"/> Land Under Waterbodies and Waterways	1. square feet	2. square feet
	3. cubic yards dredged	
d. <input type="checkbox"/> Bordering Land Subject to Flooding	1. square feet	2. square feet
	3. cubic feet of flood storage lost	4. cubic feet replaced
e. <input type="checkbox"/> Isolated Land Subject to Flooding	1. square feet	
	2. cubic feet of flood storage lost	3. cubic feet replaced
f. <input type="checkbox"/> Riverfront Area (if checked, complete #1-6)	1. Name of Waterway (if available)	
	2. Width of Riverfront Area (check one):	
	<input type="checkbox"/> 25 ft. - Designated Densely Developed Areas only <input type="checkbox"/> 100 ft. - New agricultural projects only <input type="checkbox"/> 200 ft. - All other projects	
	3. Total area of Riverfront Area on the site of the proposed project: _____ square feet	
4. Proposed alteration of the Riverfront Area:		
a. total square feet _____ b. square feet within 100 feet _____ c. square feet between 100 feet and 200 feet _____		
5. Has an alternatives analysis been done and is it attached to this NOI? <input type="checkbox"/> Yes <input type="checkbox"/> No		
6. Was the lot where the activity is proposed created prior to August 1, 1996? <input type="checkbox"/> Yes <input type="checkbox"/> No		
3. <input type="checkbox"/> Bylaw Resource Areas (Foxborough Wetlands Protection Bylaw, Ch. 267; No Activity Zones)		
a. <input type="checkbox"/> 100 Foot Vernal Pool Adjacent Upland Resource Area		
b. <input type="checkbox"/> 25 Foot No Activity Zone		
4. <input type="checkbox"/> Restoration/Enhancement - If the project is for the purpose of restoring or enhancing a wetland resource area in addition to the square footage that has been entered in Section B.2.b above, please enter the additional amount here.		
a. square feet of BVW _____		
5. <input type="checkbox"/> Project Involves Stream Crossings		
a. number of new stream crossings _____		b. number of replacement stream crossings _____



WPA Form 3 – Notice of Intent

Massachusetts Wetlands Protection Act M.G.L. c. 131, §40
Foxborough Wetlands Protection Bylaw, Ch. 267

MassDEP File Number

Foxborough

Town

C. Other Applicable Standards and Requirements

This is a proposal for an Ecological Restoration Limited Project. If checked, skip Section C and complete Appendix A: Ecological Restoration Notice of Intent – Required Actions (310 CMR 10.11).

Streamlined Massachusetts Endangered Species Act/Wetlands Protection Act Review

1. Is any portion of the proposed project located in **Estimated Habitat of Rare Wildlife** as indicated on the most recent Estimated Habitat Map of State-Listed Rare Wetland Wildlife published by the Natural Heritage and Endangered Species Program (NHESP)? To view habitat maps, see the Massachusetts Natural Heritage Atlas or go to http://maps.massgis.state.ma.us/PRI_EST_HAB/viewer.htm.

a. Yes No

If yes, include proof of mailing or hand delivery of NOI to:
Natural Heritage and Endangered Species Program
Division of Fisheries and Wildlife, 1 Rabbit Hill Road
Westborough, MA 01581 - Phone: (508) 389-6360

2023 Mass Mapper

b. Date of map

If yes, the project is also subject to Massachusetts Endangered Species Act (MESA) review (321 CMR 10.18). To qualify for a streamlined, 30-day, MESA/Wetlands Protection Act review, please complete Section C.1.c, and include requested materials with this Notice of Intent (NOI); OR complete Section C.1.f, if applicable. If MESA supplemental information is not included with the NOI, by completing Section 1 of this form, the NHESP will require a separate MESA filing which may take up to 90 days to review (unless noted exceptions in Section 2 apply, see below).

c. Submit Supplemental Information for Endangered Species Review*

1. Percentage/acreage of property to be altered:

(a) within wetland Resource Area

percentage/acreage

(b) outside Resource Area

percentage/acreage

2. Assessor's Map or right-of-way plan of site

2. Project plans for entire project site, including wetland resource areas and areas outside of wetlands jurisdiction, showing existing and proposed conditions, existing and proposed tree/vegetation clearing line, and clearly demarcated limits of work **

(a) Project description (include description of impacts outside of wetland resource area & buffer zone)

(b) Photographs representative of the site

(c) MESA filing fee - Make check payable to "Commonwealth of Massachusetts - NHESP" and mail to NHESP at above address (fee information available at <https://www.mass.gov/regulatory-review>)

Projects altering **10 or more acres** of land, also submit:

(d) Vegetation cover type map of site

(e) Project plans showing Priority & Estimated Habitat boundaries

(f) OR - see next page

* Some projects not in Estimated Habitat may be located in Priority Habitat (see <http://www.mass.gov/eea/agencies/dfg/dfw/natural-heritage/regulatory-review/>) and require NHESP review. Priority Habitat includes habitat for state-listed plants and strictly upland species not protected by the Wetlands Protection Act.

** MESA projects may not be segmented (321 CMR 10.16). The applicant must disclose full development plans even if such plans are not required as part of the Notice of Intent process.



WPA Form 3 – Notice of Intent

Massachusetts Wetlands Protection Act M.G.L. c. 131, §40
Foxborough Wetlands Protection Bylaw, Ch. 267

MassDEP File Number

Foxborough
Town

C. Other Applicable Standards and Requirements (continued)

(f) OR Check One of the Following

- 1. *Project is exempt from MESA review.*
Attach applicant letter indicating which MESA exemption applies. (See 321 CMR 10.14, <https://www.mass.gov/service-details/exemptions-from-review-for-projectsactivities-in-priority-habitat>; the NOI must still be sent to NHESP if the project is within estimated habitat pursuant to 310 CMR 10.59.)
- 2. *Separate MESA review ongoing.* a. NHESP Tracking # _____ b. Date submitted to NHESP _____
- 3. *Separate MESA review completed.*
Include copy of NHESP "no Take" determination or valid Conservation and Management Permit with approved plan.

3. For coastal projects only: Not applicable in Foxborough

4. Is any portion of the proposed project within an Area of Critical Environmental Concern (ACEC)?

a. Yes No If yes, provide name of ACEC.

Canoe River Aquifer

b. ACEC

5. Is any portion of the proposed project within an area designated as an Outstanding Resource Water (ORW) as designated in the Massachusetts Surface Water Quality Standards, 314 CMR 4.00?

a. Yes No

6. Is any portion of the site subject to a Wetlands Restriction Order under the Inland Wetlands Restriction Act (M.G.L. c. 131, § 40A)?

a. Yes No

7. Is this project subject to provisions of the MassDEP Stormwater Management Standards?

a. **Yes.** Attach a copy of the Stormwater Report as required by the Stormwater Management Standards per 310 CMR 10.05(6)(k)-(q) and check if:

- 1. Applying for Low Impact Development (LID) site design credits (as described in Stormwater Management Handbook Vol. 2, Chapter 3)
- 2. A portion of the site constitutes redevelopment
- 3. Proprietary BMPs are included in the Stormwater Management System.

b. **No.** Check why the project is exempt:

- 1. Single-family house
- 2. Emergency road repair
- 3. Small Residential Subdivision (less than or equal to 4 single-family houses or less than or equal to 4 units in multi-family housing project) with no discharge to Critical Areas.

8. **This is a proposed Ecological Restoration Limited Project.** [If checked, skip Section D and complete Appendix A: Ecological Restoration NOI; Minimum Required Documents (310 CMR 10.12).]



WPA Form 3 – Notice of Intent

Massachusetts Wetlands Protection Act M.G.L. c. 131, §40
Foxborough Wetlands Protection Bylaw, Ch. 267

MassDEP File Number

Foxborough

Town

D. Additional Information

Applicants must include the following with this Notice of Intent (NOI). *See instructions for details.*

1. USGS or other map of the area (along with a narrative description, if necessary) containing sufficient information for the Conservation Commission and the Department to locate the site.
2. Plans identifying the location of proposed activities (including activities proposed to serve as a Bordering Vegetated Wetland [BVW] replication area or other mitigating measure) relative to the boundaries of each affected resource area.
3. Identify the method for BVW and other resource area boundary delineations (MassDEP BVW Field Data Form(s), Determination of Applicability, Order of Resource Area Delineation, etc.), and attach documentation of the methodology.
4. List the titles and dates for all plans and other materials submitted with this NOI.

Site Development Plan of #7 Perry Drive

a. Plan Title

Bay Colony Group, Inc.

b. Prepared By

June 14, 2023

d. Final Revision Date

William Buckley, Jr., #35813

c. Signed and Stamped by

1"=30'

e. Scale

f. Additional Plan or Document Title

g. Date

h. Additional Plan or Document Title

i. Date

5. If more than one property owner, attach a list of property owners not listed on this form.
6. Attach proof of mailing for Natural Heritage and Endangered Species Program, if needed.
7. Notice of Intent Application checklist
8. Abutter Notification Form
9. Affidavit of Service Form
10. Attach Stormwater Report with signed, stamped Stormwater Checklist (unless exempt).

E. Fees

1. a. **Fee Exempt:** *No filing fee shall be assessed for projects of any town, county, or district of the Commonwealth, municipal housing authority, or the Massachusetts Bay Transportation Authority.*
- b. Applicants must submit the following information to confirm fee payment (in addition to pages 1 and 2 of the attached NOI Wetland Fee Transmittal Form):

37864
2. Check Number (town share of state fee [see A.5.c., page 1])

6/22/2023
3. Check date (town share of state fee)

37865
4. Check Number (Bylaw filing fee [see A.5.d, page 1])

6/22/2023
5. Check date (Bylaw filing fee)

37866
6. State Check Number (state share of state fee [see A.5.b.]

6/22/2023
7. Check date (state share of state filing fee)

Technimetals, Inc
8. First Name of Payor on checks

9. Last Name of Payor on checks



Massachusetts Department of Environmental Protection
Bureau of Resource Protection - Wetlands

WPA Form 3 – Notice of Intent

Massachusetts Wetlands Protection Act M.G.L. c. 131, §40
Foxborough Wetlands Protection Bylaw, Ch. 267

(To be provided by MassDEP)

MassDEP File Number

Foxborough

Town

F. Signatures and Submittal Requirements

I hereby certify under the penalties of perjury that the foregoing Notice of Intent and accompanying plans, documents, and supporting data are true and complete to the best of my knowledge.

I understand that the Conservation Commission will place notification of this Notice in a local newspaper at the expense of the applicant in accordance with the wetlands regulations, 310 CMR 10.05(5)(a).

I hereby grant permission, to the Agent or member of the Conservation Commission and the Department of Environmental Protection, to enter and inspect the area subject to this Notice at reasonable hours to evaluate the wetland resource boundaries, if included with this application, subject to this Notice, and to require the submittal of any data deemed necessary by the Conservation Commission or Department for that evaluation.

I further certify under penalties of perjury that all abutters were notified of this application, pursuant to the requirements of M.G.L. c. 131, § 40. Notice must be made by Certificate of Mailing or in writing by hand delivery or certified mail (return receipt requested) to all abutters within 100 feet of the property line of the project location.

1. Signature of Applicant

[Handwritten Signature]

6/22/23

2. Date

3. Signature of Property Owner (if different)

[Handwritten Signature]

6/27/23

4. Date

5. Signature of Representative (if any)

6/26/23

6. Date

Tax Collector's Release


The above referenced applicant is applying for a permit from the Conservation Commission and is in good standing with respect to any taxes, fees, assessments, betterments or other municipal charges as recorded with the Foxborough Treasurer's Office.

1. Signature of Tax Collector or Agent

[Handwritten Signature: Barbara Donahue]

6/26/23

2. Date



Massachusetts Department of Environmental Protection
Bureau of Resource Protection - Wetlands

WPA Form 3 – Notice of Intent

Massachusetts Wetlands Protection Act M.G.L. c. 131, §40
Foxborough Wetlands Protection Bylaw, Ch. 267

(To be provided by MassDEP)

MassDEP File Number

Foxborough

Town

F. Signatures and Submittal Requirements

Submittal Requirements (please refer to NOI Filing Instructions, downloadable at http://www.foxboroughma.gov/Pages/FoxboroughMA_Conservation/Forms)

For Foxborough Conservation Commission:

One original and seven (7) copies of this completed Notice of Intent (form 3), including supporting plans and documents (listed at section D. "Additional Information"), NOI Filing Check List, Abutter Notification, one copy of the NOI Wetland Fee Transmittal Form (see following page; attached), and the two town fee payments (Bylaw filing fee and town share of State filing fee), by certified mail or hand delivery to:

Foxborough Conservation Commission
Town Hall, 40 South Street, Foxborough, MA 02035

For MassDEP:

One copy of this completed Notice of Intent (form 3), including supporting plans and documents (listed at Section D), one copy of the NOI Wetland Fee Transmittal Form (attached), and a **copy** of the state fee payment (for State share, see below) by certified mail or hand delivery to:

MassDEP Southeast Regional Office
20 Riverside Drive, Lakeville, MA 02347

State share of the filing fee (check or money order, payable to the *Commonwealth of Massachusetts*) and the NOI Wetland Fee Transmittal Form by certified mail or hand delivery to:

Department of Environmental Protection
Box 4062, Boston, MA 02211

Other:

If the applicant has checked the "yes" box in any part of Section C, Item 3, above, refer to that section and the Instructions for additional submittal requirements. The original and copies must be sent simultaneously. Failure by the applicant to send copies in a timely manner may result in dismissal of the Notice of Intent.



Massachusetts Department of Environmental Protection
 Bureau of Resource Protection - Wetlands
NOI Wetland Fee Transmittal Form
 Massachusetts Wetlands Protection Act M.G.L. c. 131, §40
 Foxborough Wetlands Protection Bylaw, Chapter 267



Important: When filling out forms on the computer, use only the tab key to move your cursor - do not use the return key.



A. Applicant Information

1. Location of Project:
 7 Perry Drive _____ Foxborough _____
 a. Street Address _____ b. City/Town _____


2. Applicant Mailing Address:
 Peter _____ Berube _____
 a. First Name _____ b. Last Name _____
 Technimetals _____
 c. Organization _____
 7 Perry Drive _____ Foxborough _____ MA _____ 02035 _____
 d. Mailing Address _____ e. City/Town _____ f. State _____ g. Zip Code _____
 508.698.2444 _____ pberube@technimetals.com _____
 h. Phone Number _____ i. Fax Number _____ j. Email Address _____

3. Property Owner (if different from Applicant):
 Applicant is also owner _____
 a. First Name _____ b. Last Name _____
 BPAZ Holdings 31 LLC _____
 c. Organization _____
 1 Samsone St. 15th Flr. _____ San Francisco _____ CA _____ 94104 _____
 d. Mailing Address _____ e. City/Town _____ f. State _____ g. Zip Code _____
 302.658.7581 _____
 h. Phone Number _____ i. Fax Number _____ j. Email Address _____

To calculate filing fees, refer to the category fee list and examples in the instructions for filling out WPA Form 3 (Notice of Intent).

B. Fees - Please see NOI Instructions before filling out worksheet.

Fees should be calculated using the following process and the worksheet on the next page.
 Refer to Conservation Commission's website to download the Town and State Filing Fee Schedules:
http://www.foxboroughma.gov/Pages/FoxboroughMA_Conservation/Forms
State Wetlands Protection Act (WPA) Filing Fee Instructions
Step 1/ Type of Activity: Describe each type of activity that will occur in a wetland resource area and/or buffer zone (the area within 100 feet of a wetland, or 200 feet of a river).
Step 2/ Number of Activities: Identify the number of each type of activity.
Step 3/ Individual Activity Fee: Identify each activity fee from the six project categories listed in the instructions.
Step 4/ Subtotal Activity Fee: Multiply the number of activities (identified in Step 2) times the fee per category (identified in Step 3) to reach a subtotal fee amount.
Note: If any of these activities are in a Riverfront Area in addition to another Resource Area or the Buffer Zone, the fee per activity should be multiplied by 1.5 and then added to the subtotal amount.
Step 5/ Total State Project Fee: Determine the total project fee by adding the subtotal amounts from Step 4.
Step 6a-c/ Fee Payments (State):
 To calculate the state share of the fee, divide the total fee in half and subtract \$12.50.
 To calculate the town share of the fee, divide the total fee in half and add \$12.50.



Massachusetts Department of Environmental Protection
 Bureau of Resource Protection - Wetlands
NOI Wetland Fee Transmittal Form
 Massachusetts Wetlands Protection Act M.G.L. c. 131, §40
 Foxborough Wetlands Protection Bylaw, Chapter 267



B. Fees (continued)

Town Bylaw Filing Fee Instructions

Step 1a/ Type of Activity:

Describe each type of activity that will occur in wetland resource area and buffer zone.

Step 2a/ Number of Activities: Identify the number of each type of activity.

Step 3a/ Individual Activity Fee: Identify each activity fee from the six project categories listed in the instructions.

Step 4a/ Subtotal Activity Fee: Multiply the number of activities (identified in Step 2a) times the fee per category (identified in Step 3a) to reach a subtotal fee amount. Note: If any of these activities are in a Riverfront Area in addition to another Resource Area or the Buffer Zone, the fee per activity should be multiplied by 1.5 and then added to the subtotal amount.


Step 5a/ Total Bylaw Project Fees:

Determine the total project fee by adding the subtotal amounts from Step 4a.

Step 6d/ Fee Payment (Bylaw): *Insert Step 5a fee payment amount.*

Type of Activity	Number of Activities	Individual Activity Fee	Subtotal Activity Fee
State Filing Fees: (Step 1)	(Step 2)	(Step 3)	(Step 4)
3. b. - Construction of Commercial Building	1	\$1,050	\$1,050
Total State Filing Fee: (Step 5)			
Bylaw Filing Fees: (Step 1a)	(Step 2a)	(Step 3a)	(Step 4a)
3. b. - Construction of Commercial Building	1	\$1,500	\$1,500
Total Bylaw Filing Fee: (Step 5a)			
Filing Fee Payments: (Step 6)			
Total State Filing Fee:	(insert the following amount on this NOI form page 1, Section A.5.a)	\$1,050	a. Total State Fee from Step 5
State's share of filing fee: (Paid to State [Boston address])	(insert following amount on this NOI form page 1, Section A.5.b.)	\$512.50	b. 1/2 of (a), above, less \$12.50
Town's share of filing fee: (Paid to Town of Foxborough)	(insert following amount on this NOI form page 1, Section A.5.c.)	\$537.50	c. 1/2 of (a) above, plus \$12.50
Bylaw Filing Fee: (Paid to Town of Foxborough)	(insert following amount on this NOI form page 1, Section A.5.d.)	\$1,500	d. Total Bylaw Fee from Step 5a

See Submittal Requirements and Instructions on the next page.



Massachusetts Department of Environmental Protection
Bureau of Resource Protection - Wetlands
NOI Wetland Fee Transmittal Form
Massachusetts Wetlands Protection Act M.G.L. c. 131, §40
Foxborough Wetlands Protection Bylaw, Chapter 267



C. Submittal Requirements

a. To Department of Environmental Protection:

For additional instructions, please refer to the Submittal Instructions on the last page (page 7) of the attached NOI Form (above).

Complete pages 1 and 2 of this NOI Wetland Fee Transmittal Form and send with a check or money order for the **State share of the filing fee**, payable to the *Commonwealth of Massachusetts*.

Department of Environmental Protection
Box 4062
Boston, MA 02211

b. To the Foxborough Conservation Commission:

Send the Notice of Intent or Abbreviated Notice of Intent; one **copy** of this form and the Town fee payments (**Bylaw fee and town share of State fee**), payable to the *Town of Foxborough*.

Foxborough Conservation Commission
40 South Street
Foxborough, MA 02035

c. To MassDEP Regional Office:

Send a copy of the Notice of Intent or Abbreviated Notice of Intent; a **copy** of this form; and a **copy** of the state fee payment.

MassDEP, Southeast Regional Office
20 Riverside Drive
Lakeville, MA 02347

37864

TECHNIMETALS, INC.
140 INTRACOASTAL PT DR STE 110
JUPITER, FLORIDA 33477



**WALPOLE
CO-OPERATIVE
BANK**
Walpole, MA 02081
53-7306/2113



6/22/2023

PAY TO THE ORDER OF Town of Foxborough

\$ *****537.50*

*FIVE HUNDRED THIRTY-SEVEN AND 50 / 100 DOLLARS

Town of Foxborough
40 South St
Foxboro, MA 02035



[Signature]
AUTHORIZED SIGNATURE

MEMO

⑈037864⑈ ⑆211373063⑆ 22⑈805677⑈

37865

TECHNIMETALS, INC.
140 INTRACOASTAL PT DR STE 110
JUPITER, FLORIDA 33477



**WALPOLE
CO-OPERATIVE
BANK**
Walpole, MA 02081
53-7306/2113



6/22/2023

PAY TO THE ORDER OF Town of Foxborough

\$ *****1,500.00*

*ONE THOUSAND FIVE HUNDRED AND XX / 100 DOLLARS

Town of Foxborough
40 South St
Foxboro, MA 02035



[Signature]
AUTHORIZED SIGNATURE

MEMO

⑈037865⑈ ⑆211373063⑆ 22⑈805677⑈

37866

TECHNIMETALS, INC.
140 INTRACOASTAL PT DR STE 110
JUPITER, FLORIDA 33477



**WALPOLE
CO-OPERATIVE
BANK**
Walpole, MA 02081
53-7306/2113



6/22/2023

PAY TO THE ORDER OF Commonwealth of Massachusetts

\$ *****512.50*

*FIVE HUNDRED TWELVE AND 50 / 100 DOLLARS

Commonwealth of Massachusetts
PO Box 7046
Boston, MA 02204



[Signature]
AUTHORIZED SIGNATURE

MEMO

⑈037866⑈ ⑆211373063⑆ 22⑈805677⑈

NOTICE OF INTENT APPLICATION CHECKLIST

This checklist, which is referred to in the Conservation Commission's *Filing Instructions for Notices of Intent Under the Foxborough Wetlands Protection Bylaw, Chapter 267*, has been designed to efficiently assist the applicant and the Commission through the review process. It applies to all filings under the Foxborough Wetlands Protection Bylaw, Chapter 267 (unless otherwise specifically stated). Close adherence to this checklist and the referenced *Filing Instructions* is recommended.

All of the following information will be required, unless exempted in writing by the Commission. After completing each item below, please check the box next to the item and, when finished, **include a copy of the completed checklist in your NOI application package.**

INFORMATION TO BE INCLUDED IN NOTICE OF INTENT NARRATIVE

EXISTING CONDITIONS

- Description of topography, soils, and geology
- Description of vegetation types (upland or wetlands community types and plant species)
- USGS quadrangle map (most recent version), with site location circled (locus map)
- National Flood Insurance Program (NFIP) Flood Insurance Rate Map (FIRM), and associated Flood Profile Study if available, with site location circled

PROPOSED CONDITIONS

- Description of activities, construction sequencing and estimated timetable, including future phases
- Description of indirect and direct impacts, both temporary and permanent, on wetland resource areas
- Calculations of lot's impervious areas, comparing pre-construction to post construction conditions
- Volume of fill required, if applicable, and source of fill
- Description of soil erosion and sediment control plan, including monitoring and measures to be taken to prevent negative impacts to resource areas
- Detailed mitigation plan for activities in the buffer zone to prevent long term, indirect impacts to adjacent resource areas
- Description of storm water management plan, including existing and proposed drainage areas
- Description of wastewater management plan, if applicable
- Description of wetlands restoration plan, if proposed, including area to be restored with existing and proposed topography contours (at one-foot intervals), description of soils, stockpile areas, plantings (including Latin names of plants/seeds and source of materials [both plants and soils]), invasive species eradication and monitoring plan and a timetable of proposed work.

SITE VISIT REQUIREMENTS FOR REVIEW OF NOTICE OF INTENT

The following markings and flagging must be in place before the field inspection, where applicable. Failure to properly stake and mark the site may result in delays, non-review, or denial of a proposed project.

- Edges of wetlands must be flagged with numbered flags, as reflected on submitted project plans
- House number must be visible from the street, if work is proposed at a pre-existing house; if no house is on the property, the lot number must be posted and visible.
- Property boundaries must be staked with numbered stakes at all corners
- All proposed structures or additions, including decks, must be staked for identification purposes at all corners; stakes must be numbered and labeled, as reflected on submitted project plans
- Locations of septic tank, leaching field and wells (if in the buffer zone) must be staked and labeled

INFORMATION TO BE INCLUDED ON SITE PLANS

ALL PLANS

- Title Box: Include the date, name and address of proposed project; owner and/or applicant name; preparer's name; scale (1 inch = 30 feet or less); north arrow; assessor's map/parcel number
- Stamp/Signature: Plan to be prepared and stamped by a registered professional engineer (PE) or land surveyor, as appropriate. At least one original signed copy of each plan must be submitted
(Note: The professional who stamps the original plans must also stamp, sign and date revisions.)
- Locus Map: Include on a corner of plan's first page, at least 3" x 3" in size
- Topography: Contours at two-foot intervals or less; NAVD88 elevations (if available), or assumed datum and location of benchmark elevation
- Project Site: Include lot size(s) and property boundaries.
- Abutting Properties: Property owner names and property lines of abutting land parcels
- Watershed Areas: For projects that alter the stormwater runoff from the site, identify total watershed area in which site is located, all sub-watersheds on site, and on- and off-site discharge points
- Test Pits: Location, date and soil summaries of all soil borings and test pits on site; location, date and readings of groundwater level measurements on site
- Stone walls or other barriers located between the area of work and the area(s) subject to protection
- Easements: Location and type of easements, both on site and within 50 feet of property line

Resource Areas and Buffer Zones

- Wetland Resource Areas: Boundaries of wetland resource areas on or within 100 feet of the proposed project area (200 feet for perennial streams and rivers), with flow directions, if applicable
- Wetland Flags: Numbered flags/stakes; note date of flagging and name/firm of delineator/botanist
- Bank: Delineate the banks of streams, rivers, ponds and/or lakes
- 25 Foot No Activity Zone (Chapter 267)
- Bordering Land Subject to Flooding, including 100-year storm elevation (FEMA floodplain or highest observed or recorded elevation)
- Isolated Land Subject to Flooding, including highest observed or recorded water level
- Vernal Pools, (all) including highest observed or recorded water level
- Certified Vernal Pools: Boundary of 100 foot No Activity Zone (Chapter 267)
- High Water Level for all water bodies, from best available data (data source must be cited)
- Riverfront Area: Boundaries of 100 Foot Inner Riparian Area and 200 Foot Outer Riparian Area
- Mean Annual High Water Line (MAHWL) of any river
- 100 Foot Buffer Zone (100-foot radius from all wetland resources areas)

EXISTING CONDITIONS PLANS

- Existing Topography: Contours at two-foot intervals or less
- Above-Ground: All on-site above-ground structures, roadways, access ways, stone walls, fences
- Below-Ground: All on-site below-ground structures, including but not limited to utility lines, drainage structures, septic systems, cesspools, wells, storage tanks

PROPOSED CONDITIONS PLANS

- Proposed Topography: Contours at two-foot intervals or less; NAVD88 elevations or assumed datum
- Limit of Work: delineate all areas where vegetation or soil will be altered
- Erosion Controls: locations and type of temporary erosion controls, including installation details
- Stockpiles: locations of stockpiles
- Fill: Note the amount of fill required to be added or removed (in cubic yards and maximum thickness); pre- and post- development grades on all slopes

PROPOSED CONDITIONS PLANS (continued)

- Construction Equipment access routes and storage/parking areas during proposed work
- Construction Details, including cross-sections and elevations of drainage structures (including but not limited to catch basins, leaching basins, dry wells, swales, retention areas, ditches, etc.) and road crossings in wetland resource areas
- Above-Ground Alterations: All on-site structures, roadways, access ways, stone walls, fences, and all other physical alterations proposed in the buffer zone; location and elevation of lowest floor of all structures; identify roadway or surface material proposed
- Below-ground Alterations: All on-site below-ground alterations and structures in the buffer zone, including but not limited to utility lines, drainage structures, septic systems, cesspools, wells, tanks
- Drainage Patterns: Existing natural drainage patterns and proposed alterations
- Distance of proposed on-site leaching facility to wetlands or other resource areas
- Distance of proposed alteration to wetlands or other resource areas
- Wells: Location of all existing and proposed wells on property and within 200 feet of project on abutting properties, and minimum distance to all septic systems

DOCUMENT SUBMISSION DEADLINES

NOI Application:

All documentation (including plans, maps, tables, charts, reports, etc.) to be considered as part of an applicant's permit filing must be submitted to the Commission by the application deadline, as posted in the Conservation Office in Town Hall and on the Commission's website. Application forms, instructions and deadlines can all be downloaded on the Commission's website:

http://www.foxboroughma.gov/Pages/FoxboroughMA_Conservation/index

Continued Hearing Submissions:

All document and plan revisions must be received by the Conservation Department at least four business days before a scheduled (continued) hearing date.

Four days is the minimum time needed to allow the Conservation Commission and Conservation Manager to properly review and analyze new submissions. Documents that are not submitted at least four business days before the date of a continued hearing may be excluded from consideration during that hearing and held for discussion during a future Conservation Commission meeting.

NOTIFICATION TO ABUTTERS

Under the Massachusetts Wetlands Protection Act & Foxborough Wetlands and Groundwater Protection Bylaw (Article IX)

*(This form must be completed and mailed, certified mail return receipt requested,
to all abutters within 100 feet of the proposed project)*

In accordance with the second paragraph of Massachusetts Wetlands Protection Act (G.L. Ch. 131, §40), and §10.05(4)(a) of 310 CMR 10.00, and the Foxborough Wetlands and Groundwater Protection Bylaw (Article IX) and regulations, you are hereby notified of a public hearing on the matter described below:

- A. The applicant has filed a Notice of Intent with the Foxborough Conservation Commission seeking permission to alter an area subject to protection under the Wetlands Protection Act and the Foxborough Wetlands and Groundwater Protection Bylaw.
- B. The name of the applicant is Technimetals
- C. The address of the land where the activity is proposed is 7 Perry Drive Foxborough.
- D. The work proposed is The construction of a 12,000+/- sf additon along with the associated parking, grading and utilities.
- E. Copies of the Notice of Intent may be examined at the Conservation Commission's office, 40 South Street, Foxborough Town Hall, between 9 am and 4 pm, Monday through Thursday (please call first, to ensure that the Conservation Manager is in the office and not out on site visits).

For more information, please call: Bay Colony Group, Inc.

Check One: This is the applicant, applicant's representative, or other _____

- F. Copies of the Notice of Intent may be obtained from either (check one) the applicant or the applicant's representative by calling 508.543.3939 from 8:00-5:00 on Monday through Friday.
- G. Information regarding the date, time and place of the public hearing may be obtained from either (check one) the applicant or the applicant's representative by calling 508.543.3939 from 8:00-5:00 on Monday through Friday.

Conservation Commission meeting agendas may be viewed online at
http://www.foxboroughma.gov/Pages/FoxboroughMA_ConsAgendas/

Notice of the public hearing, including date, time and place, will be published at least five business days in advance in The Sun Chronicle and will be posted in the Town Hall and online at least 48 hours in advance.

Contact the Foxborough Conservation Commission for information about this application or the Foxborough Wetlands and Groundwater Protection Bylaw or the Department of Environmental Protection (DEP) Southeast Regional Office for more information about this application or the Wetlands Protection Act.

Conservation Commission:

508-543-1251

http://www.foxboroughma.gov/Pages/FoxboroughMA_Conservation/index

DEP, Southeast Regional Office (Lakeville):

508-946-2836



RECEIVED
BOARD OF ASSESSORS
JUN 15 2023
TOWN OF FOXBOROUGH

BOARD OF ASSESSORS
TOWN OF FOXBOROUGH
40 SOUTH STREET
FOXBOROUGH MASSACHUSETTS 02035

(508) 543-1215

Fax: (508) 543-6278

CERTIFICATION OF ABUTTERS

PROPERTY OWNER: 1776 Washington St RT

MAILING ADDESSS: 7 Perry Drive Foxborough, MA 02035

PROPERTY LOCATION: 7 Perry Drive, Foxboro

ASSESSORS MAP/PARCEL: 002//010/000/000

APPLICANT: Bay Colony Group PHONE: 508-543-3939

AUTHORITY REQUESTING LIST: Conservation Commission

DATE SUBMITTED: 06/15/2023

LIST REQUESTED: 500 FT 300 FT X 100FT ABUTTER TO ABUTTER

I, Karin P..., acting as a custodian of assessment records, do hereby certify that the attached documents contain true and complete information from the most recent tax list of the Town of Foxborough, Massachusetts.

I further state that these documents include the names and addresses of abutters to the abutters Map 2 Parcel 100 100ft

Date: 6/15/23

BOARD OF ASSESSORS
FOXBOROUGH MASSACHUSETTS

Massachusetts General Law c. 40A, s.11, "The assessors maintaining any applicable tax list shall certify to the permit granting authority or special permit granting authority the names and addresses of parties in interest and such certification shall be conclusive for all purposes."

The Assessors Office will complete the abutters list within 7-10 business days. There is a \$25.00 fee for an abutters list.

"The applicant is solely responsible for requesting the appropriate abutters list required by the applicable Mass General Law."

Abutting Properties for
 7 PERRY DRIVE
 FOXBOROUGH, MA 02035
 002-010-000-000-0000
 (100 Feet)
 6/15/2023


Parcel Number	Property Address	Owner Name	Owner Address	Owner City	Owner State	Owner Zip
002-001-000	2 PHELPS DRIVE	LIKARR LLC	6 PERRY DRIVE	FOXBOROUGH	MA	02035-0000
002-006-000	35 PANAS ROAD	BP AZ HOLDINGS 31 LLC	1 SAMSONE ST 15TH FL	SAN FRANCISCO	CA	94104
002-009-000	11 PERRY DRIVE #A	GREENBERG JASON	62 CARRIAGE DR	LINCOLN	RI	02865
002-009-000	11 PERRY DRIVE #D	HARDING DONALD H, JEANNE & J GREGORY	16 ARNOLD DR	MEDFIELD	MA	02052-0000
002-009-000	11 PERRY DRIVE #E	HARDING DONALD H, JEANNE & J GREGORY	16 ARNOLD DRIVE	MEDFIELD	MA	02052-0000
002-009-000	11 PERRY DRIVE #B	CHRISTMAN MARIANNE TR	16 COW HILL RD	SHARON	MA	02067
002-009-000	11 PERRY DRIVE #G	WALSH JAMES M & CATHERINE M TE	11 PERRY DRIVE UNIT G	FOXBOROUGH	MA	02035-0000
002-009-000	11 PERRY DRIVE #C	CHRISTMAN KEVIN M & MARIANNE TR	16 COW HILL RD	SHARON	MA	02067
002-009-000	11 PERRY DRIVE #F UNIT C	CHRISTMAN KEVIN M & MARIANNE TRS	16 COW HILL RD	SHARON	MA	02067
002-011-000	3 PHELPS DRIVE	MATTHEWS KEVIN TR	P O BOX 208	WAKEFIELD	MA	01880
002-012-000	8 PHELPS DRIVE	GRADAM LLC	2250 PROVIDENCE HWY	WALPOLE	MA	02081

APPENDIX A

*USGS Quadrangle Map


*FEMA Flood Insurance Rate Map

* Priority Habitat Map

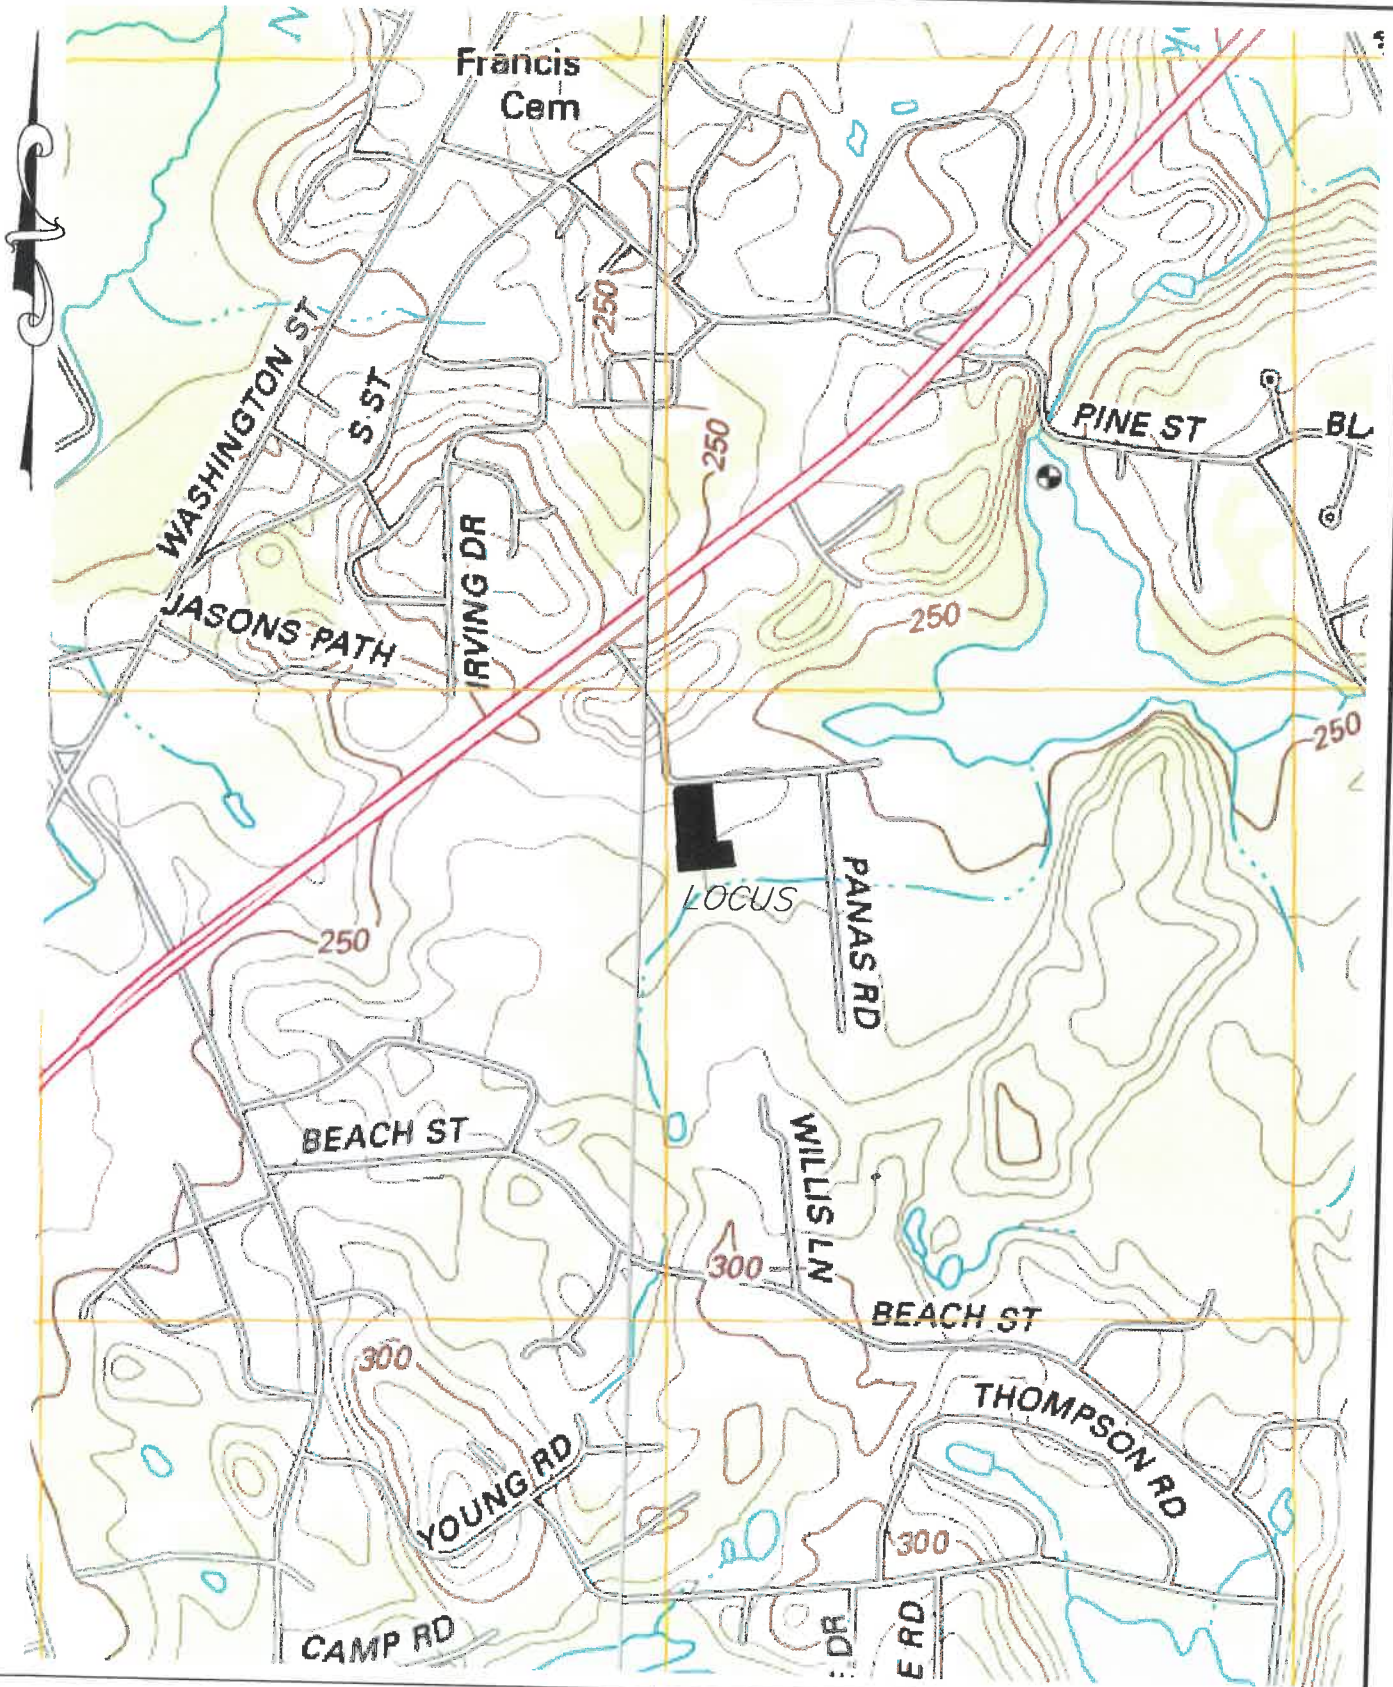

BAY COLONY GROUP, INC.
 FOUR SCHOOL STREET
 FOXBOROUGH, MA 02035
 (508) 543-3939

USGS EXTRACT
 7 PERRY DRIVE
 FOXBOROUGH, MA 02035
 MANSFIELD QUADRANGLE
 SCALE: 1" = 1000'

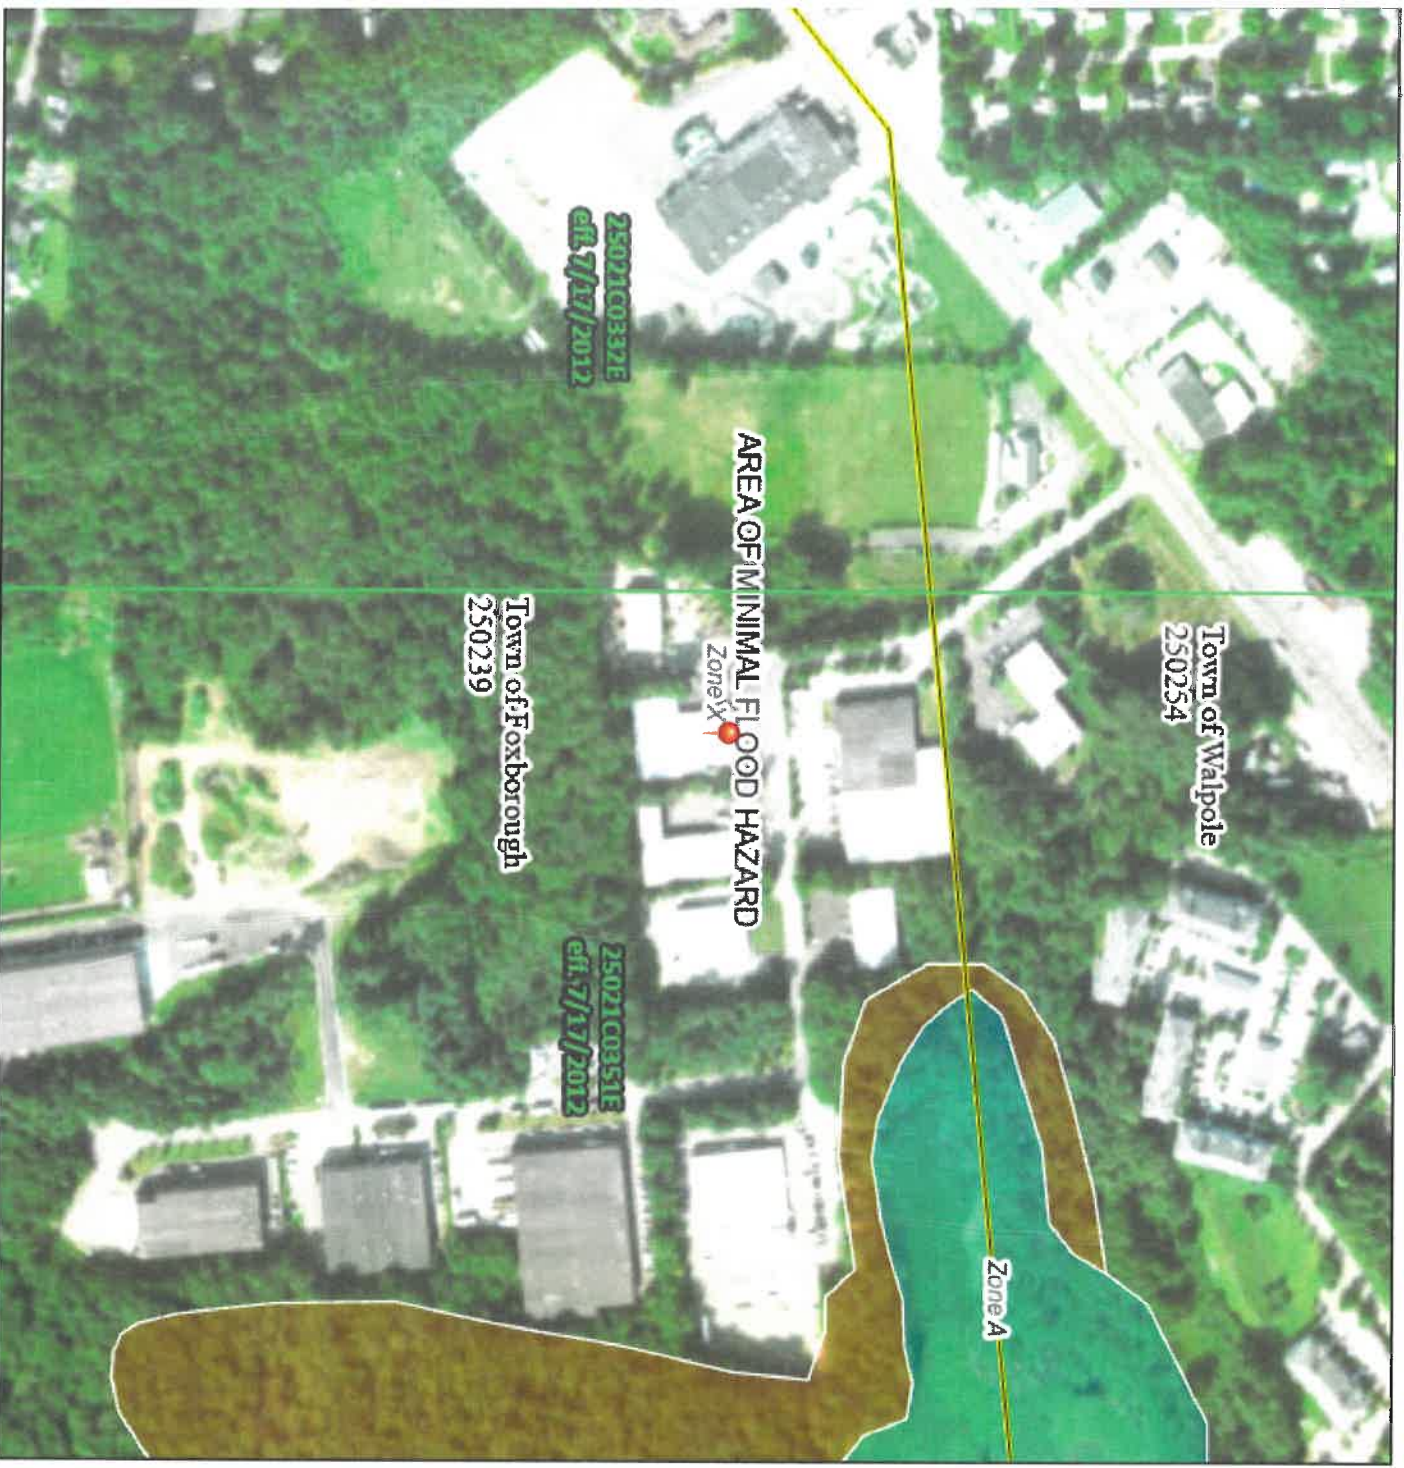

71°14'38"W 42°6'27"N

Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

SPECIAL FLOOD HAZARD AREAS

- Without Base Flood Elevation (BFE) Zone A, V, A99
- With BFE or Depth Zone AE, AO, AH, VE, AR
- Regulatory Floodway

0.2% Annual Chance Flood Hazard. Area of 1% annual chance flood with average depth less than one foot or with draining areas of less than one square mile Zone X.

Future Conditions 1% Annual Chance Flood Hazard Zone X

Area with Reduced Flood Risk due to Levee. See Notes, Zone X

Area with Flood Risk due to Levee Zone D

OTHER AREAS OF FLOOD HAZARD

- NO SCREEN
- Area of Minimal Flood Hazard Zone X
- Effective LOMRS

OTHER AREAS

- Area of Undetermined Flood Hazard Zone X

GENERAL STRUCTURES

- Channel, Culvert, or Storm Sewer
- Levee, Dike, or Floodwall

OTHER FEATURES

- 20.2 Cross Sections with 1% Annual Chance
- 17.5 Water Surface Elevation
- 8 Coastal Transect
- 31.5 Base Flood Elevation Line (BFE)
- Limit of Study
- Jurisdiction Boundary
- Coastal Transect Baseline
- Profile Baseline
- Hydrographic Feature

MAP PANELS

- Digital Data Available
- No Digital Data Available
- Unmapped


The pin displayed on the map is an approximate point selected by the user and does not represent an authoritative property location.

This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards.

The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on **6/15/2023 at 10:51 AM** and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or become superseded by new data over time.

This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmapped areas cannot be used for regulatory purposes.

7 Perry Drive

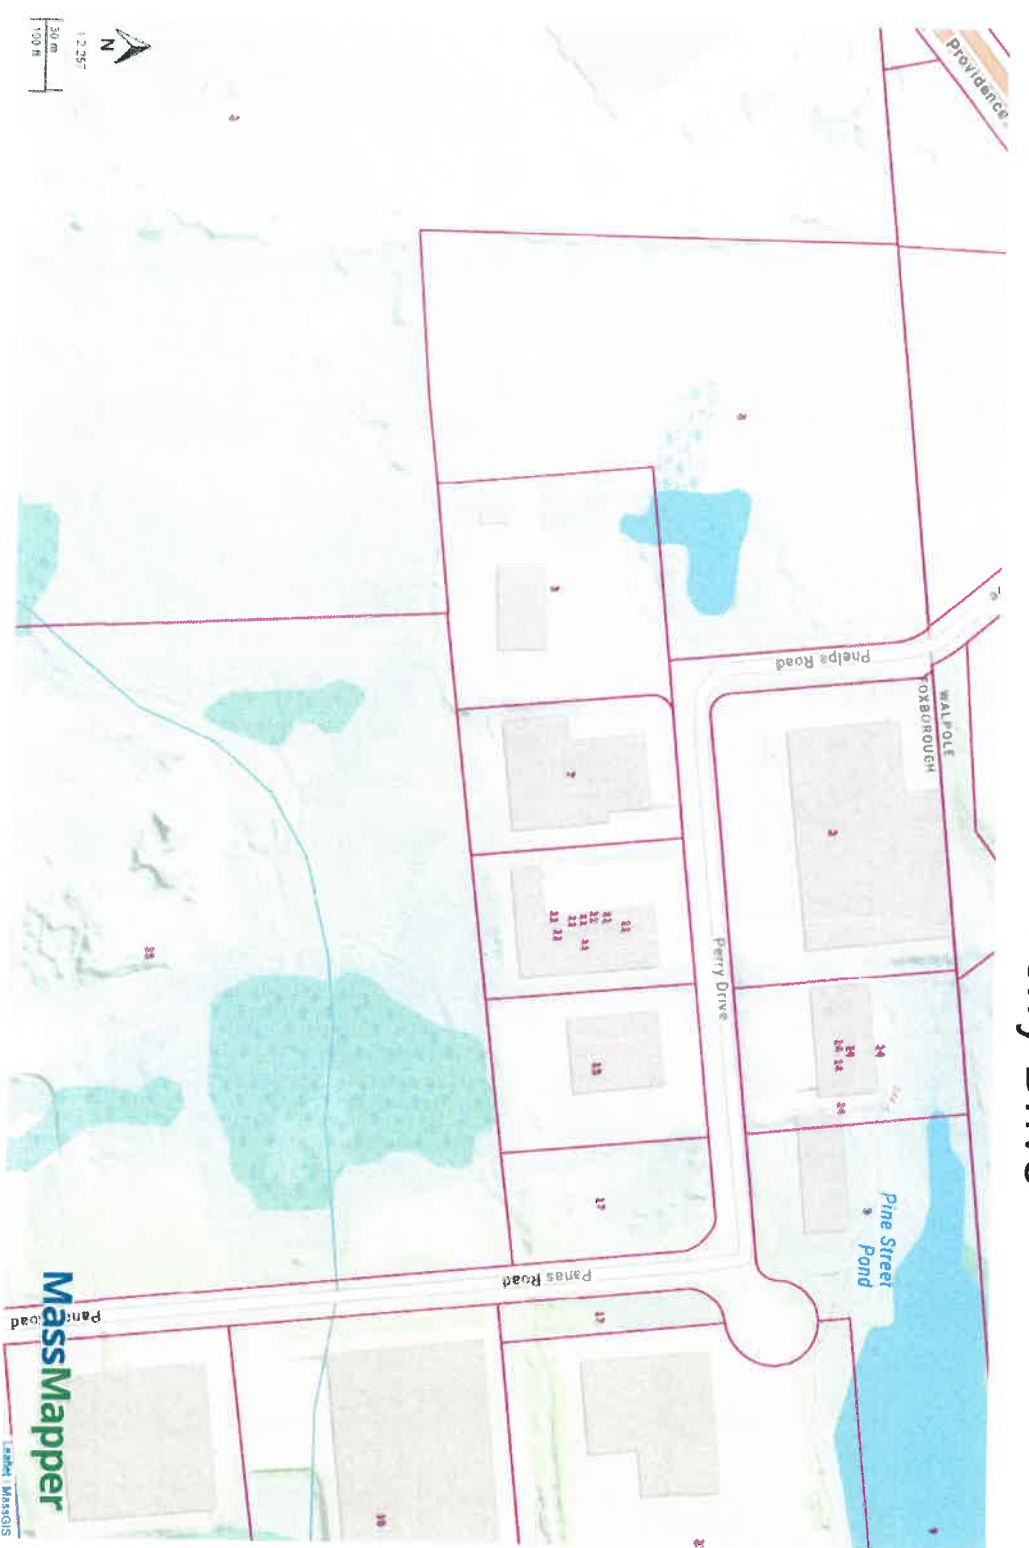

- Potential Vernal Pools
- NHESP Certified Vernal Pools
- * NHESP Priority Habitats of Rare Species:
- NHESP Estimated Habitats of Rare Wildlife
- Property Tax Parcels

APPENDIX B

*Pare Corporation Wetland Field Report



Engineers | Scientists | Planners

PARECORP.COM



November 9, 2021

Mr. William Buckley, P.E.
Bay Colony Group, Inc.
4 School Street
Foxborough, MA 02035

**Re: Wetland Delineation
2 Washington Street
Foxborough, MA
Pare Project No. 18170.30**

Dear Mr. Buckley,

Pare Corporation (Pare) delineated wetlands on the parcel of land located at 2 Washington Street in Foxborough. The subject property consists of a 30.5-acre parcel of commercial property on the south side of Washington Street (Route 1) which includes a restaurant and function facility, recreation complex, and undeveloped wooded areas to the south. The delineation was completed to establish the limits of wetlands, 25-foot No Activity Zones, and 100-foot Buffer Zones that may impact future development on the property. Pare's investigation and delineation of wetlands was completed on November 4, 2021.

The following report describes the delineated wetlands, discusses the delineation methodology, and summarizes review of available published mapping for the site. Attached to this report are the following materials: a Site Location Map, an Annotated Aerial Photograph, an excerpt from the FEMA Flood Insurance Rate Map for the area, annotated photographs of the site wetlands, a USGS StreamStats Report, and completed BVW Data Forms.

METHODOLOGY

Wetland edges were delineated in accordance with the Massachusetts Wetlands Protection Act Regulations (310 CMR 10.55, referred to as the WPA Regulations), and the methodology specified in the publication entitled Delineating Bordering Vegetated Wetlands under the Massachusetts Wetlands Protection Act (Jackson, 1995) and The Regional Supplement to the Corps of Engineers Wetland Delineation Manual: North Central and Northeast Region, Version 2.0 (U.S. Army Corps of Engineers, January 2012).

Pink field flags were placed at appropriate intervals along the wetland/upland borders affecting the proposed development. Primary parameters evaluated in wetland delineation included vegetation, hydric soil indicators, and visual indicators of wetland hydrology such as water-stained leaves, mound-and-pool microrelief, saturated soils, and surface water. During the delineation, BVW Data Forms were completed for representative plots along the wetland/upland borders.





WETLAND DESCRIPTIONS

Pare delineated the north and west edges of a forested wetland extending through the central and eastern portions of the site. The wetland interior contains a narrow intermittent stream channel that flows in a northeasterly direction, entering a culvert beneath Panas Road offsite to the east. The wetland is therefore classified as a **Bordering Vegetated Wetland (BVW)** under 310 CMR 10.55(2). The wetland edge has an associated **100-foot Buffer Zone** in addition to a **25-foot No Activity Zone** under the Foxborough Wetlands Protection Bylaw.

The unnamed stream channel in the wetland interior is mapped as intermittent on the USGS Topographic Quadrangle for the area. According to the USGS StreamStats program, the stream has a watershed size of 0.24 square miles when measured from a point downstream of the property at the Panas Road crossing. Therefore, the stream qualifies as intermittent under 310 CMR 10.58(2), does not have an associated 200-foot Riverfront Area, and was not flagged as part of Pare’s delineation. The USGS StreamStats Report is attached.

Flag series A-1 to A-82 defines the northern and western edge of the wetland complex on the property. This series begins at the northeast side of the wooded area, to the rear of the building at 11 Perry Drive. The series extends west along the northern wetland edge at the rear of the properties along Perry Drive, turning south to follow the intermittent stream for a short distance. The series continues southwest across a gradual slope where broad band of wetland borders the the stream. Most of the wetland edge is colonized by mature trees with a variable understory of shrubs and climbing vines, with invasive species prominent in the understory along the wetland/upland border. Other evidence of prior disturbance along the wetland edge included presence of trash and debris, and irregular topography indicative of former earthwork.

The vegetation community of the wetland is variable, however most of the wetland area appears to consist of a seasonally flooded Red Maple swamp. The northern portion of the wetland is less disturbed, and is colonized by a mixture of deciduous trees with an understory of wetland shrubs and few climbing vines. Portions of the wetland edge that closely border the stream at the east side of the site consist of an early successional plant community with more sparse trees and an understory dominated by invasive shrubs and dense climbing vines. Species of vegetation identified within the BVW included, but was not limited to, the following species:

Common Name	Scientific Name	Indicator Status
Red Maple	<i>Acer rubrum</i>	FAC
White Pine	<i>Pinus strobus</i>	FACU
Red Oak	<i>Quercus rubra</i>	FACU
Gray Birch	<i>Betula populifolia</i>	FAC
Wild Black Cherry	<i>Prunus serotina</i>	FACU
Sweet Pepperbush	<i>Clethra alnifolia</i>	FAC+
Glossy Buckthorn	<i>Frangula alnus</i>	FAC
Highbush Blueberry	<i>Vaccinium corymbosum</i>	FACW-
Spicebush	<i>Lindera benzoin</i>	FACW-
Winterberry	<i>Ilex verticillata</i>	FACW
Multiflora Rose	<i>Rosa multiflora</i>	FACU
Autumn Olive	<i>Elaeagnus umbellata</i>	NI
Green Briar	<i>Smilax rotundifolia</i>	FAC
Poison Ivy	<i>Toxicodendron radicans</i>	FAC



Mr. William Buckley

(3)

November 9, 2021

Tussock Sedge	<i>Carex stricta</i>	OBL
Royal Fern	<i>Osmunda regalis</i>	OBL
New York Fern	<i>Parathelypteris noveboracensis</i>	FAC
Cinnamon Fern	<i>Osmunda cinnamomea</i>	FACW

REVIEW OF PUBLISHED MAPPING


Review of published mapping and the relevant MassGIS data layers on November 9, 2021 revealed the following:

- The site does not contain any mapped NHESP Priority Habitats of Rare Species or Estimated Habitats of Rare Wildlife (MassGIS data layers PRIHAB_POLY and ESTHAB_POLY, August 2021).
- No Certified Vernal Pools (CVPs) or Potential Vernal Pools (PVPs) are located on the subject property.
- The site is not located in Outstanding Resource Waters.
- The site is not located within an Area of Critical Environmental Concern.
- According to the FEMA Flood Insurance Rate Map (FIRM) for the Town of Foxborough (Map No. 25021C0332E, revised July 17, 2012, there is no mapped floodplain on the property and the entire site is located within Areas of Minimal Flood Hazard (Zone X).

Thank you very much for the opportunity to assist you with this project. If you have any questions regarding project permitting or other issues, or require further assistance, please do not hesitate to call.

Sincerely,

Lauren H. Gluck, P.W.S.
Senior Environmental Scientist

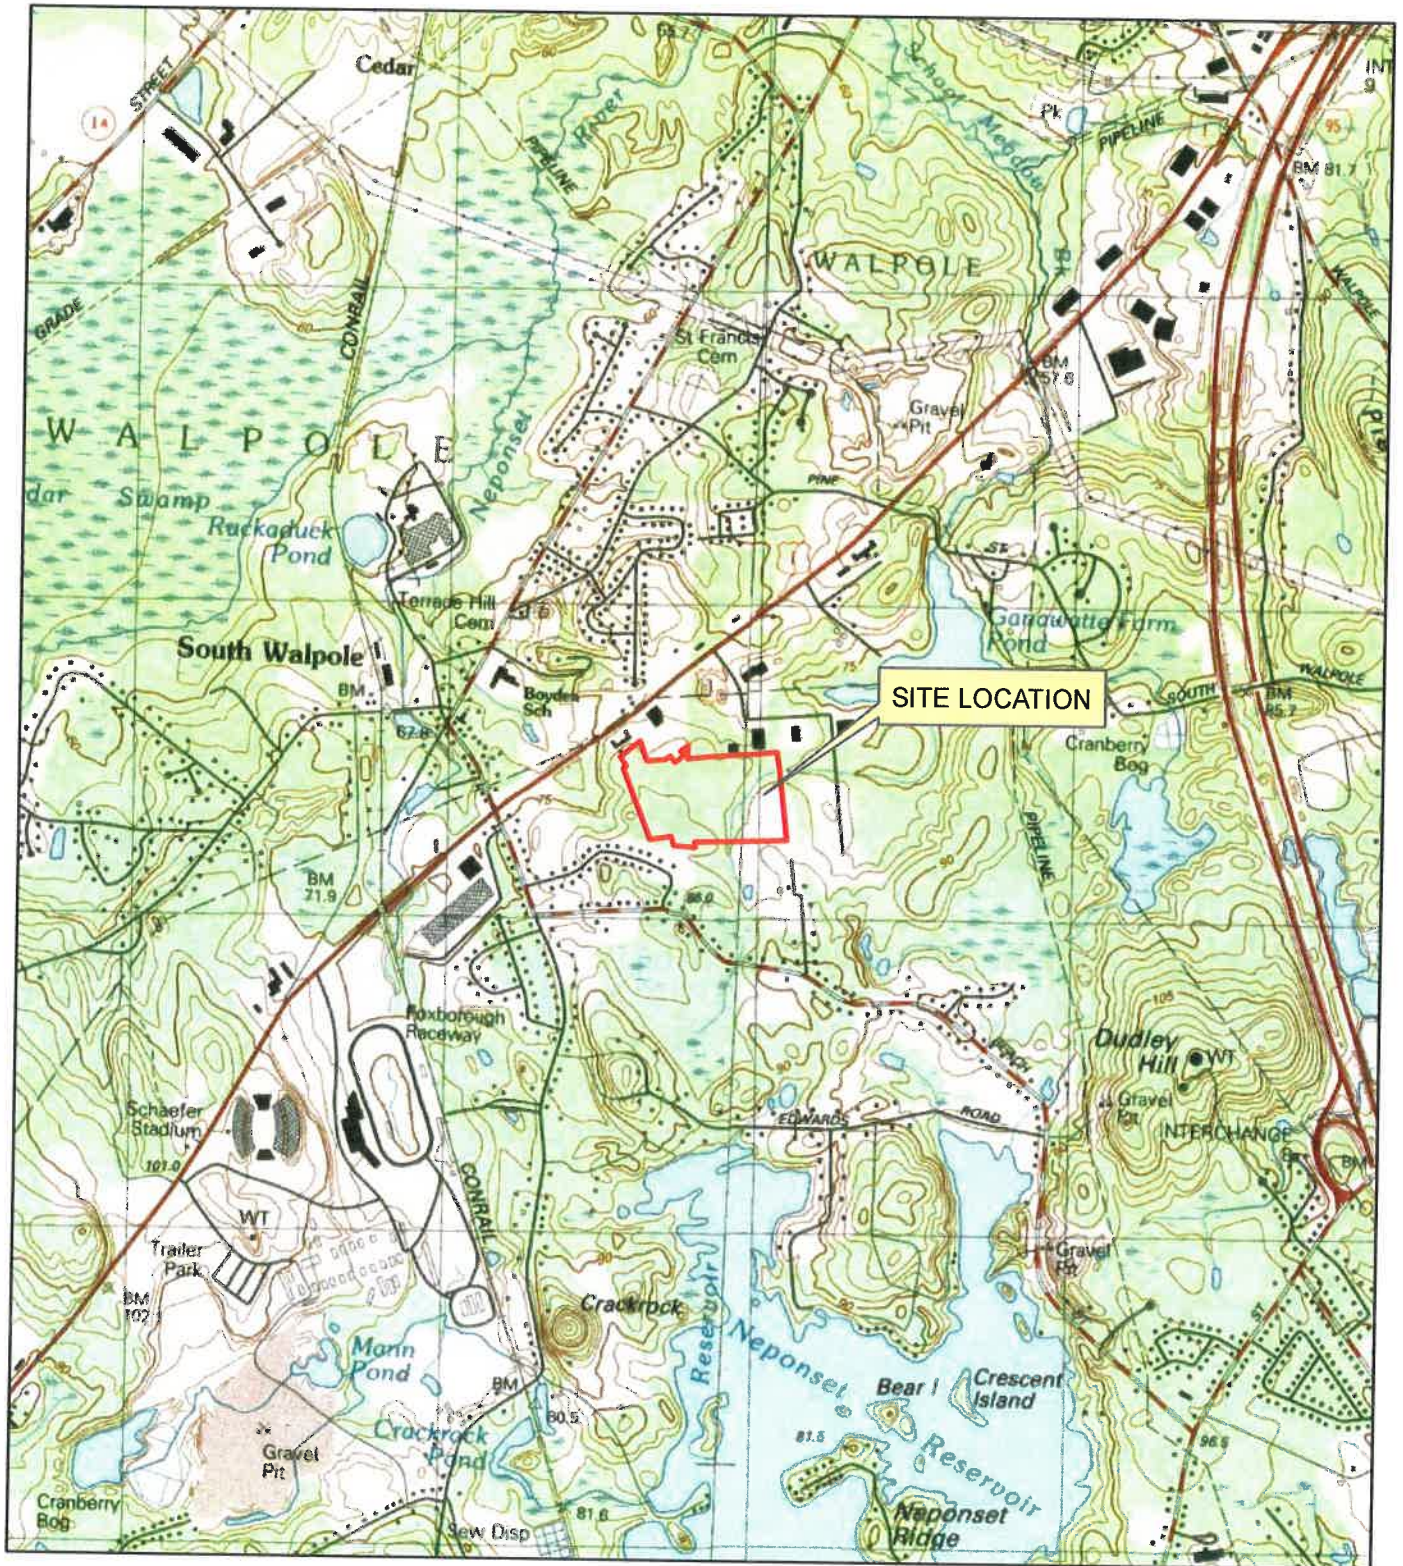

SITE LOCATION MAP

SCALE: 1" = 2,000'



8 BLACKSTONE VALLEY PLACE
LINCOLN, RI 02865
(401) 334-4100

10 LINCOLN ROAD, SUITE 210
FOXBORO, MA 02035
(508) 543-1755

FIGURE 1

2 WASHINGTON ST.
FOXBORO, MA



ANNOTATED AERIAL PHOTOGRAPH

SCALE: 1" = 300'



8 BLACKSTONE VALLEY PLACE
LINCOLN, RI 02865
(401) 334-4100

10 LINCOLN ROAD, SUITE 210
FOXBORO, MA 02035
(508) 543-1755

PARE PROJECT No. 18170.30

NOVEMBER 2021

FIGURE 2

2 WASHINGTON ST.
FOXBORO, MA

WETLAND DELINEATION REPORT

National Flood Hazard Layer FIRMette

71°15'28"W 42°6'17"N



FIGURE 3

Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

<p>SPECIAL FLOOD HAZARD AREAS</p> <ul style="list-style-type: none"> Without Base Flood Elevation (BFE) Zone A, V, A99 With BFE or Depth Zone AE, AO, AH, VE, AR Regulatory Floodway 	<p>OTHER AREAS OF FLOOD HAZARD</p> <ul style="list-style-type: none"> 0.2% Annual Chance Flood Hazard. Area of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile Zone X Future Conditions 1% Annual Chance Flood Hazard Zone X Area with Reduced Flood Risk due to Levee. See Notes. Zone X Area with Flood Risk due to Levee Zone D 	<p>OTHER AREAS</p> <ul style="list-style-type: none"> NO SCREEN Area of Minimal Flood Hazard Zone X Effective LOMRs Area of Undetermined Flood Hazard Zone 	<p>GENERAL STRUCTURES</p> <ul style="list-style-type: none"> Channel, Culvert, or Storm Sewer Levee, Dike, or Floodwall 	<p>OTHER FEATURES</p> <ul style="list-style-type: none"> Cross Sections with 1% Annual Chance Water Surface Elevation Coastal Traverset Base Flood Elevation Line (BFE) Limit of Study Jurisdiction Boundary Coastal Traverset Baseline Profile Baseline Hydrographic Feature 	<p>MAP PANELS</p> <ul style="list-style-type: none"> Digital Data Available No Digital Data Available Unmapped
---	--	---	--	--	---




The pin displayed on the map is an approximate point selected by the user and does not represent an authoritative property location.

This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards.

The flood hazard information is derived directly from the authoritative NFHL web services provided by FEMA. This map was exported on 11/9/2021 at 11:08 AM and does not reflect changes or amendments subsequent to this date and time. The NFHL and effective information may change or become superseded by new data over time.

This map image is void if the one or more of the following map elements do not appear: basemap imagery, flood zone labels, legend, scale bar, map creation date, community identifiers, FIRM panel number, and FIRM effective date. Map images for unmapped and unmodernized areas cannot be used for regulatory purposes.

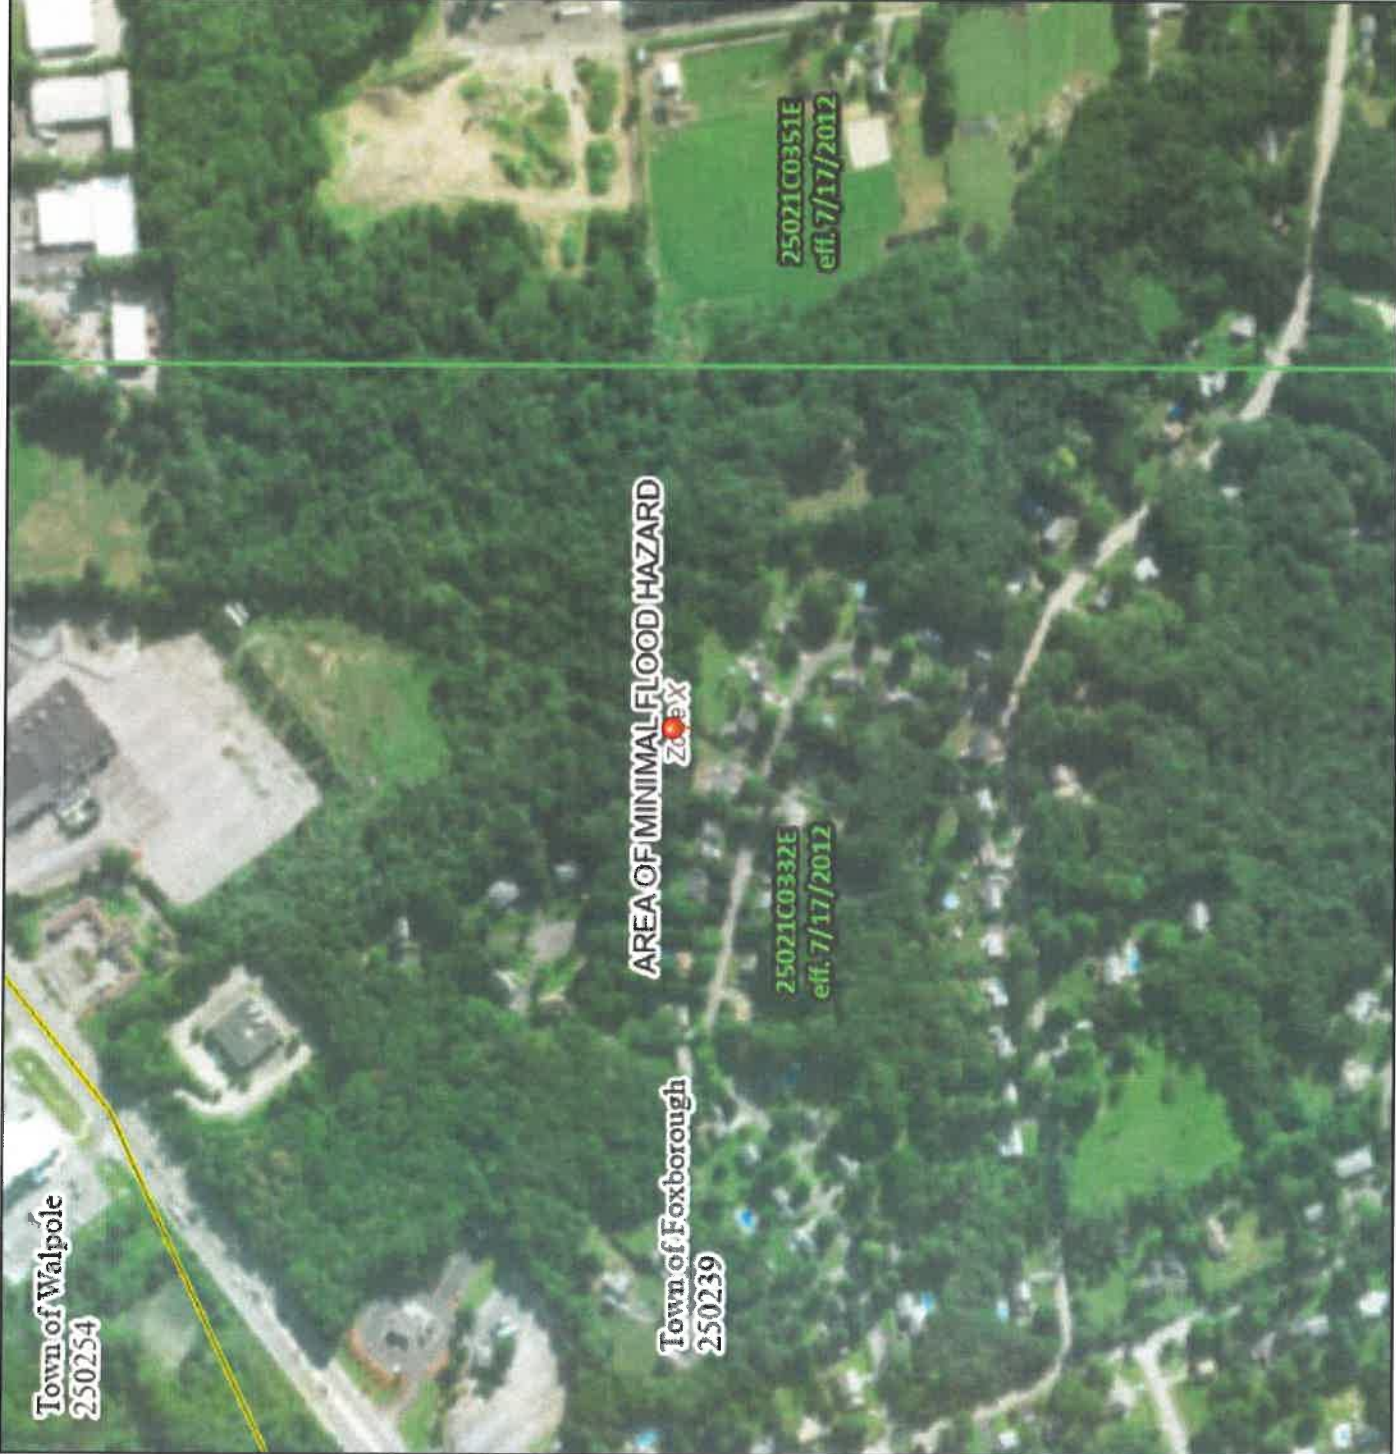

71°14'51"W 42°5'50"N



Photo 1: Wetland edge at northeast side of site near flag A-4



Photo 2: Typical view of wetland interior at northeast side of site



Photo 3: Early-successional plant community along wetland edge near flag A-13



Photo 4: Typical view of intermittent stream channel in wetland interior.





Photo 5: Seasonally flooded areas adjacent to stream channel near flag A-36



Photo 6: Southwest end of delineated edge bordering agricultural property to the south.


StreamStats Report - 2 Washington St, Foxborough

Region ID: MA

Workspace ID: MA20211109151834106000

Clicked Point (Latitude, Longitude): 42.10338, -71.24638

Time: 2021-11-09 10:18:53 -0500

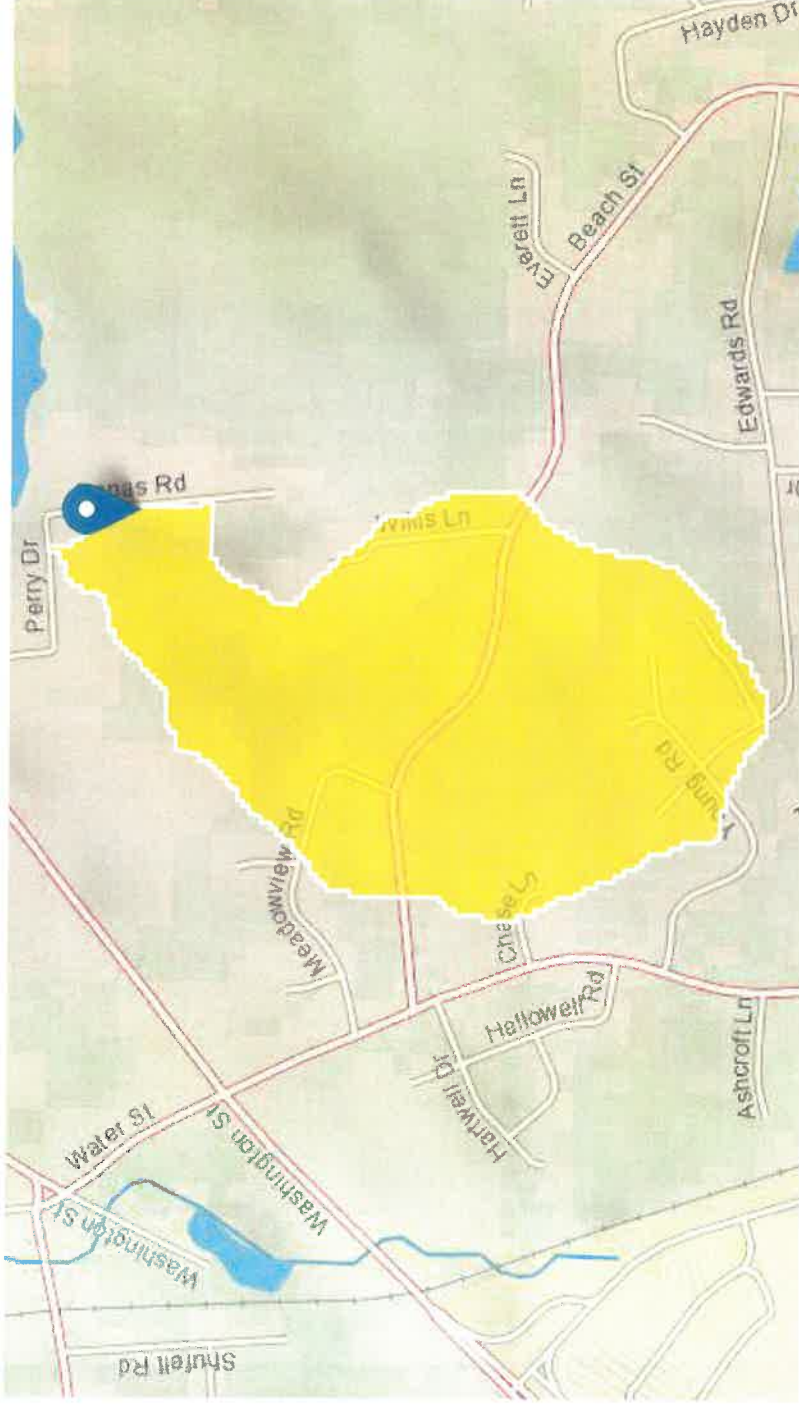

Basin Characteristics

Parameter Code	Parameter Description	Value	Unit
ACRSDF1	Area underlain by stratified drift	0.21	square miles
BSLDEM10M	Mean basin slope computed from 10 m DEM	3.554	percent
BSLDEM250	Mean basin slope computed from 1:250K DEM	1.724	percent
CAT1ROADS	Length of interstates lmted access highways and ramps for lmted access highways, includes cloverleaf interchanges (USGS Ntl Transp Dataset)	0	miles
CAT2ROADS	Length of sec hwy or maj connecting roads; main arteries & hwys not lmted access, usually in the US Hwy or State Hwy systems (USGS Ntl Transp Dataset)	0	miles
CAT3ROADS	Length of local connecting roads; roads that collect traffic from local roads & connect towns, subdivisions & neighborhoods (USGS Nat Transp Dataset)	0	miles
CAT4ROADS	Length of local roads; generally paved street, road, or byway that usually have single lane of traffic in each direction (USGS Ntnl Transp Dataset)	1.64	miles
CENTROIDX	Basin centroid horizontal (x) location in state plane coordinates	220644.7	meters
CENTROIDY	Basin centroid vertical (y) location in state plane units	872046.5	meters
CROSCOUNT1	Number of intersections between streams and roads, where the roads are interstate, limited access highway, or ramp (CAT1ROADS)	0	dimensionless
CROSCOUNT2	Number of intersections between streams and roads, where the roads are secondary highway or major connecting road (CAT2ROADS)	0	dimensionless
CROSCOUNT3	Number of intersections between streams and roads, where roads are local connecting roads (CAT3ROADS)	0	dimensionless
CROSCOUNT4	Number of intersections between streams and roads, where roads are local roads (CAT4ROADS)	2	dimensionless
CRSDFT	Percentage of area of coarse-grained stratified drift	90.48	percent
CSL10_85	Change in elevation divided by length between points 10 and 85 percent of distance along main channel to basin divide - main channel method not known	0.84	feet per mi

Parameter Code	Parameter Description	Value	Unit
DRFTPERSTR	Area of stratified drift per unit of stream length	0.31	square mile per mile
DRNAREA	Area that drains to a point on a stream	0.24	square miles
ELEV	Mean Basin Elevation	282	feet
FOREST	Percentage of area covered by forest	38.26	percent
LAKEAREA	Percentage of Lakes and Ponds	0.06	percent
LC06STOR	Percentage of water bodies and wetlands determined from the NLCD 2006	6.91	percent
LC11DEV	Percentage of developed (urban) land from NLCD 2011 classes 21-24	41.8	percent
LC11IMP	Average percentage of impervious area determined from NLCD 2011 impervious dataset	11.8	percent
LFPLENGTH	Length of longest flow path	1.18	miles
MAREGION	Region of Massachusetts 0 for Eastern 1 for Western	0	dimensionless
MAXTE MPC	Mean annual maximum air temperature over basin area, in degrees Centigrade	15.2	degrees C
OUTLETX	Basin outlet horizontal (x) location in state plane coordinates	220975	feet
OUTLETY	Basin outlet vertical (y) location in state plane coordinates	872585	feet
PCTSDNGRV	Percentage of land surface underlain by sand and gravel deposits	90.48	percent
PRECPRIS00	Basin average mean annual precipitation for 1971 to 2000 from PRISM	48.8	inches
STRMTOT	total length of all mapped streams (1:24,000-scale) in the basin	0.69	miles
WETLAND	Percentage of Wetlands	9.33	percent

USGS Data Disclaimer: Unless otherwise stated, all data, metadata and related materials are considered to satisfy the quality standards relative to the purpose for which the data were collected. Although these data and associated metadata have been reviewed for accuracy and completeness and approved for release by the U.S. Geological Survey (USGS), no warranty expressed or implied is made regarding the display or utility of the data for other purposes, nor on all computer systems, nor

shall the act of distribution constitute any such warranty.

USGS Software Disclaimer: This software has been approved for release by the U.S. Geological Survey (USGS). Although the software has been subjected to rigorous review, the USGS reserves the right to update the software as needed pursuant to further analysis and review. No warranty, expressed or implied, is made by the USGS or the U.S. Government as to the functionality of the software and related material nor shall the fact of release constitute any such warranty. Furthermore, the software is released on condition that neither the USGS nor the U.S. Government shall be held liable for any damages resulting from its authorized or unauthorized use.

USGS Product Names Disclaimer: Any use of trade, firm, or product names is for descriptive purposes only and does not imply endorsement by the U.S. Government.

Application Version: 4.6.2

StreamStats Services Version: 1.2.22

NSS Services Version: 2.1.2

DEP Bordering Vegetated Wetland (310 CMR 10.55) Delineation Field Data Form

Applicant: **Prepared by:** Pare Corporation **Project location:** 2 Washington St, Foxboro **DEP File #:** None
 L. Gluck

Check all that apply:

- Vegetation alone presumed adequate to delineate BVW boundary: fill out section I only.
- Vegetation and other indicators of hydrology used to delineate BVW boundary: fill out Sections I and II.
- Method other than dominance test used (attach additional information).

Section I. Observation Plot Number: 1		Transect Number: A	(Wetland Station)	5' ± D/G WF A-8	Date of Delineation: November 4, 2021
A. Sample Layer and Plant Species (by common/ scientific name)	B. Percent Cover (or basal area)	C. Percent Dominance	D. Dominant Plant (Yes or No)	E. Wetland Indicator Category *	
Tree					
Red Maple (<i>Acer rubrum</i>)	51-75 (63.0)	75	Y	FAC*	
White Pine (<i>Pinus strobus</i>)	16-25 (20.5)	25	Y	FACU	
Total	83.5	100			
Sapling					
White Pine (<i>Pinus strobus</i>)	16-25 (20.5)	87	Y	FACU	
Wild Black Cherry (<i>Prunus serotina</i>)	0-5 (3.0)	13	N		
Total	23.5	100			
Shrub					
Winterberry (<i>Ilex verticillata</i>)	16-25 (20.5)	23	Y	FACW*	
Glossy Buckthorn (<i>Frangula alnus</i>)	16-25 (20.5)	23	Y	FAC*	
Highbush Blueberry (<i>Vaccinium corymbosum</i>)	26-50 (38.0)	42	Y	FACW*	
Greenbrier (<i>Smilax rotundifolia</i>)	6-15 (10.5)	12	N		
Total	89.5	100			
Herb					
Woodfern (<i>Dryopteris marginalis</i>)	6-15 (10.5)	25	Y	FACU	
Cinnamon Fern (<i>Osmunda cinnamomea</i>)	16-25 (20.5)	49	Y	FACW*	
Dewberry (<i>Rubus flagellaris</i>)	6-15 (10.5)	25	Y	FACU	
Total	41.5	99**			

**Total does not equal 100 due to rounding

*Use an asterisk to mark wetland indicator plants species listed in the Wetlands Protection Act (MGL c. 131, s. 40); plants in the genus Sphagnum; plants listed as FAC, FAC+, FACW-, FACW+, or OBL; or plants with physiological or morphological adaptations. If any plants are identified as wetland indicator plants due to physiological adaptations, describe the adaptation next to the asterisk.

Vegetation Conclusion:

Number of dominant wetland indicator plants: 5 Number of dominant non-wetland indicator plants: 4
 Is the number of dominant wetland plants equal to or greater than the number of dominant non-wetland plants? YES NO
 If vegetation alone is presumed adequate to delineate the BVW boundary, submit this form with the Request for Determination of Applicability or Notice of Intent.

Section II. Indicators of Hydrology

Hydric Soil Interpretation

1. Soil Survey

Is there a published soil survey for this site? Yes No

Title/Date: Soil Survey of Norfolk and Suffolk Counties, Massachusetts, 2020

Map Number: Accessed via Web Soil Survey <http://websoilsurvey.nrcs.usda.gov/>

Soil type mapped: 71B—Ridgebury fine sandy loam, 3 to 8 percent slopes, extremely stony

Hydric Soil Inclusions: Whitman

Are field observations consistent with soil survey? Yes No

Remarks:

2. Soil Description

Horizon	Depth (in)	Matrix Color	Mottles Color
A	0-6"	10YR 2/1	
B	6+"	10YR 4/2	10YR 2/1

Remarks: dark streaking in B horizon

3. Other:

Conclusion: Is soil hydric? Yes No

Other Indicators of Hydrology: (check all that apply and describe)

- Site inundated:
- Depth to free water in observation hole:
- Depth to soil saturation in observation hole:
- Water Marks:
- Drift lines:
- Sediment deposits:
- Drainage patterns in BVW:
- Oxidized rhizospheres:
- Water-stained leaves:
- Recorded data (stream, lake, or tidal gauge; aerial photo; other):

Other: mound and pool microrelief

Vegetation and Hydrology Conclusion	Yes	No
Number of wetland indicator plants ≥ number of non-wetland indicator plants	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Wetland hydrology present: hydric soil present	<input checked="" type="checkbox"/>	<input type="checkbox"/>
other indicators of hydrology present	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Sample location is in a BVW	<input checked="" type="checkbox"/>	<input type="checkbox"/>

Submit this form with the Request for Determination of Applicability or Notice of Intent

DEP Bordering Vegetated Wetland (310 CMR 10.55) Delineation Field Data Form

Applicant: **Prepared by:** Pare Corporation **Project location:** 2 Washington St, Foxboro **DEP File #:** None
 L. Gluck

Check all that apply:

- Vegetation alone presumed adequate to delineate BVW boundary: fill out section I only.
- Vegetation and other indicators of hydrology used to delineate BVW boundary: fill out Sections I and II.
- Method other than dominance test used (attach additional information).

Section I. Observation Plot Number: 2		Transect Number: A (Upland Station)		5 ± U/G WF A-8		Date of Delineation: November 4, 2021	
A. Sample Layer and Plant Species (by common/ scientific name)	B. Percent Cover (or basal area)	C. Percent Dominance	D. Dominant Plant (Yes or No)	E. Wetland Indicator Category *			
Tree							
Red Maple (<i>Acer rubrum</i>)	26-50 (38.0)	50	Y				FAC*
White Pine (<i>Pinus strobus</i>)	26-50 (38.0)	50	Y				FACU
Total	76.0	100					
Sapling							
White Pine (<i>Pinus strobus</i>)	16-25 (20.5)	100	Y				FACU
Total	20.5	100					
Shrub							
Winterberry (<i>Ilex verticillata</i>)	6-15 (10.5)	13	N				
Highbush Blueberry (<i>Vaccinium corymbosum</i>)	6-15 (10.5)	13	N				
Glossy Buckthorn (<i>Frangula alnus</i>)	26-50 (38.0)	48	Y				FAC*
Greenbrier (<i>Smitax rotundifolia</i>)	6-15 (10.5)	13	N				
Witch Hazel (<i>Hamamelis virginiana</i>)	6-15 (10.5)	13	N				
Total	80.0	100					
Herb							
Dewberry (<i>Rubus flagellaris</i>)	26-50 (38.0)	65	Y				FACU
Woodfern (<i>Dryopteris marginalis</i>)	16-25 (20.5)	35	Y				FACU
Total	58.5	100					

*Use an asterisk to mark wetland indicator plants species listed in the Wetlands Protection Act (MGL c. 131, s. 40); plants in the genus Sphagnum; plants listed as FAC, FAC+, FACW-, FACW+, or OBL; or plants with physiological or morphological adaptations. If any plants are identified as wetland indicator plants due to physiological adaptations, describe the adaptation next to the asterisk.

Vegetation Conclusion:

Number of dominant wetland indicator plants: 2 Number of dominant non-wetland indicator plants: 4
 Is the number of dominant wetland plants equal to or greater than the number of dominant non-wetland plants? YES NO
 If vegetation alone is presumed adequate to delineate the BVW boundary, submit this form with the Request for Determination of Applicability or Notice of Intent.

Section II. Indicators of Hydrology

Hydric Soil Interpretation

1. Soil Survey

Is there a published soil survey for this site? Yes No

Title/Date: Soil Survey of Norfolk and Suffolk Counties, Massachusetts, 2020

Map Number: Accessed via Web Soil Survey <http://websoilsurvey.nrcs.usda.gov/>

Soil type mapped: 260B—Sudbury fine sandy loam, 2 to 8 percent slopes

Hydric Soil Inclusions: Walpole

Are field observations consistent with soil survey? Yes No

Remarks:

2. Soil Description

Horizon	Depth (in)	Matrix Color	Mottles Color
A	0-3"	10YR 2/2	
B	3+"	10YR 4/3	

Remarks:

3. Other:

Conclusion: Is soil hydric? Yes No

Other Indicators of Hydrology: (check all that apply and describe)

- Site inundated:
- Depth to free water in observation hole:
- Depth to soil saturation in observation hole:
- Water Marks:
- Drift lines:
- Sediment deposits:
- Drainage patterns in BVW:
- Oxidized rhizospheres:
- Water-stained leaves:
- Recorded data (stream, lake, or tidal gauge; aerial photo; other):
- Other:

Vegetation and Hydrology Conclusion	Yes	No
Number of wetland indicator plants \geq number of non-wetland indicator plants	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Wetland hydrology present: hydric soil present	<input type="checkbox"/>	<input checked="" type="checkbox"/>
other indicators of hydrology present	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Sample location is in a BVW	<input type="checkbox"/>	<input checked="" type="checkbox"/>

Submit this form with the Request for Determination of Applicability or Notice of Intent

DEP Bordering Vegetated Wetland (310 CMR 10.55) Delineation Field Data Form

Applicant: **Prepared by:** Pare Corporation **Project location:** 2 Washington St, Foxboro **DEP File #:** None
L. Gluck

Check all that apply:

- Vegetation alone presumed adequate to delineate BVW boundary: fill out section I only.
- Vegetation and other indicators of hydrology used to delineate BVW boundary: fill out Sections I and II.
- Method other than dominance test used (attach additional information).

Section I. Observation Plot Number: 3		Transect Number: A	(Wetland Station)	5' ± D/G WF A-48	Date of Delineation: November 4, 2021
A. Sample Layer and Plant Species (by common/ scientific name)	B. Percent Cover (or basal area)	C. Percent Dominance	D. Dominant Plant (Yes or No)	E. Wetland Indicator Category *	
Tree Red Maple (<i>Acer rubrum</i>)	51-75 (63.0)	75	Y	FAC*	
Gray Birch (<i>Betula populifolia</i>)	6-15 (10.5)	13	N		
Wild Black Cherry (<i>Prunus serotina</i>)	6-15 (10.5)	13	N		
Total	84.0	101**			
Sapling White Pine (<i>Pinus strobus</i>)	6-15 (10.5)	50	Y	FACU	
Red Maple (<i>Acer rubrum</i>)	6-15 (10.5)	50	Y	FAC*	
Total	21.0	100			
Shrub Sweet Pepperbush (<i>Clethra alnifolia</i>)	51-75 (63.0)	55	Y	FAC*	
Glossy Buckthorn (<i>Frangula alnus</i>)	16-25 (20.5)	18	N		
Highbush Blueberry (<i>Vaccinium corymbosum</i>)	16-25 (20.5)	18	N		
Greenbrier (<i>Smilax rotundifolia</i>)	6-15 (10.5)	9	N		
Total	114.5	100			
Herb Sweet Pepperbush seedling (<i>Clethra alnifolia</i>)	16-25 (20.5)	100	Y	FAC*	
Total	20.5	100			

**Total does not equal 100 due to rounding

*Use an asterisk to mark wetland indicator plants species listed in the Wetlands Protection Act (MGL c. 131, s. 40); plants in the genus Sphagnum; plants listed as FAC, FAC+, FACW-, FACW+, or OBL; or plants with physiological or morphological adaptations. If any plants are identified as wetland indicator plants due to physiological adaptations, describe the adaptation next to the asterisk.

Vegetation Conclusion:

Number of dominant wetland indicator plants: 4

Number of dominant non-wetland indicator plants: 1

Is the number of dominant wetland plants equal to or greater than the number of dominant non-wetland plants? YES NO

If vegetation alone is presumed adequate to delineate the BVW boundary, submit this form with the Request for Determination of Applicability or Notice of Intent.

Section II. Indicators of Hydrology

Hydric Soil Interpretation

1. Soil Survey

Is there a published soil survey for this site? Yes No
 Title/Date: Soil Survey of Norfolk and Suffolk Counties, Massachusetts, 2020

Map Number: Accessed via Web Soil Survey <http://websoilsurvey.nrcs.usda.gov/>

Soil type mapped: 260B—Sudbury fine sandy loam, 2 to 8 percent slopes

Hydric Soil Inclusions: Walpole

Are field observations consistent with soil survey? Yes No

Remarks:

2. Soil Description

Horizon	Depth (in)	Matrix Color	Mottles Color
O	1-0"	10YR 2/2	
A	0-6"	10YR 2/2	
B	6+?"	10YR 4/2	7.5YR 4/6

Remarks: strong redox in B horizon

3. Other:

Conclusion: Is soil hydric? Yes No

Other Indicators of Hydrology: (check all that apply and describe)

- Site inundated:
- Depth to free water in observation hole:
- Depth to soil saturation in observation hole:
- Water Marks:
- Drift lines:
- Sediment deposits:
- Drainage patterns in BVW:
- Oxidized rhizospheres:
- Water-stained leaves:
- Recorded data (stream, lake, or tidal gauge; aerial photo; other):

Other: microrrelief

Vegetation and Hydrology Conclusion	Yes	No
Number of wetland indicator plants \geq number of non-wetland indicator plants	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Wetland hydrology present: hydric soil present	<input checked="" type="checkbox"/>	<input type="checkbox"/>
other indicators of hydrology present	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Sample location is in a BVW	<input checked="" type="checkbox"/>	<input type="checkbox"/>

Submit this form with the Request for Determination of Applicability or Notice of Intent

DEP Bordering Vegetated Wetland (310 CMR 10.55) Delineation Field Data Form

Applicant: **Prepared by:** Pare Corporation **Project location:** 2 Washington St, Foxboro **DEP File #:** None
 L. Gluck

Check all that apply:

- Vegetation alone presumed adequate to delineate BVW boundary: fill out section I only.
- Vegetation and other indicators of hydrology used to delineate BVW boundary: fill out Sections I and II.
- Method other than dominance test used (attach additional information).

Section I. Observation Plot Number: 4		Transect Number: A (Upland Station)		5 ± U/G WF A-48		Date of Delineation: November 4, 2021	
A. Sample Layer and Plant Species (by common/ scientific name)	B. Percent Cover (or basal area)	C. Percent Dominance	D. Dominant Plant (Yes or No)	E. Wetland Indicator Category *			
Tree							
Red Maple (<i>Acer rubrum</i>)	26-50 (38.0)	42	Y	FAC*			
White Oak (<i>Quercus alba</i>)	16-25 (20.5)	23	Y	FACU			
Wild Black Cherry (<i>Prunus serotina</i>)	6-15 (10.5)	12	N				
Red Oak (<i>Quercus rubra</i>)	6-15 (10.5)	12	N				
Gray Birch (<i>Betula populifolia</i>)	6-15 (10.5)	12	N				
Total	90.0	101**					
Sapling							
White Pine (<i>Pinus strobus</i>)	26-50 (38.0)	70	Y	FACU			
Red Maple (<i>Acer rubrum</i>)	0-5 (3.0)	6	N				
Red Oak (<i>Quercus rubra</i>)	0-5 (3.0)	6	N				
American Beech (<i>Fagus grandifolia</i>)	6-15 (10.5)	19	N				
Total	54.5	101**					
Shrub							
Glossy Buckthorn (<i>Frangula alnus</i>)	16-25 (20.5)	60	Y	FAC*			
Sweet Pepperbush (<i>Clethra alnifolia</i>)	6-15 (10.5)	31	Y	FAC*			
Highbush Blueberry (<i>Vaccinium corymbosum</i>)	0-5 (3.0)	9	N				
Total	34.0	100					
Herb							
White Oak seedling (<i>Quercus alba</i>)	6-15 (10.5)	34	Y	FACU			
Woodfern (<i>Dryopteris marginalis</i>)	16-25 (20.5)	66	Y	FACU			
Total	31.0	100					

**Total does not equal 100 due to rounding

*Use an asterisk to mark wetland indicator plants species listed in the Wetlands Protection Act (MGL c. 131, s. 40); plants in the genus Sphagnum; plants listed as FAC, FAC+, FACW-, FACW+, or OBL; or plants with physiological or morphological adaptations. If any plants are identified as wetland indicator plants due to physiological adaptations, describe the adaptation next to the asterisk.

Vegetation Conclusion:

Number of dominant wetland indicator plants: 3

Number of dominant non-wetland indicator plants: 4

Is the number of dominant wetland plants equal to or greater than the number of dominant non-wetland plants? YES NO

If vegetation alone is presumed adequate to delineate the BVW boundary, submit this form with the Request for Determination of Applicability or Notice of Intent.

Section II. Indicators of Hydrology

Hydric Soil Interpretation

1. Soil Survey

Is there a published soil survey for this site? Yes No

Title/Date: Soil Survey of Norfolk and Suffolk Counties, Massachusetts, 2020

Map Number: Accessed via Web Soil Survey <http://websoilsurvey.nrcs.usda.gov/>

Soil type mapped: 260B—Sudbury fine sandy loam, 2 to 8 percent slopes

Hydric Soil Inclusions: Walpole

Are field observations consistent with soil survey? Yes No

Remarks:

2. Soil Description

Horizon	Depth (in)	Matrix Color	Mottles Color
O	1/2-0"	10YR 2/2	
A	0-2"	10YR 2/2	
B	2+"	10YR 4/2	

Remarks: Rocky B horizon

3. Other:

Conclusion: Is soil hydric? Yes No

Other Indicators of Hydrology: (check all that apply and describe)

- Site inundated:
- Depth to free water in observation hole:
- Depth to soil saturation in observation hole:
- Water Marks:
- Drift lines:
- Sediment deposits:
- Drainage patterns in BVW:
- Oxidized rhizospheres:
- Water-stained leaves:
- Recorded data (stream, lake, or tidal gauge; aerial photo; other):
- Other:

Vegetation and Hydrology Conclusion	Yes	No
Number of wetland indicator plants \geq number of non-wetland indicator plants	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Wetland hydrology present: hydric soil present	<input type="checkbox"/>	<input checked="" type="checkbox"/>
other indicators of hydrology present	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Sample location is in a BVW	<input type="checkbox"/>	<input checked="" type="checkbox"/>

Submit this form with the Request for Determination of Applicability or Notice of Intent

DEP Bordering Vegetated Wetland (310 CMR 10.55) Delineation Field Data Form

Applicant: **Prepared by:** Pare Corporation **Project location:** 2 Washington St, Foxboro **DEP File #:** None
L. Gluck

Check all that apply:

- Vegetation alone presumed adequate to delineate BVW boundary: fill out section I only.
- Vegetation and other indicators of hydrology used to delineate BVW boundary: fill out Sections I and II.
- Method other than dominance test used (attach additional information).

Section I. Observation Plot Number: 5		Transect Number: A	(Wetland Station)	5' ± D/G WF A-76	Date of Delineation: November 4, 2021
A. Sample Layer and Plant Species (by common/ scientific name)	B. Percent Cover (or basal area)	C. Percent Dominance	D. Dominant Plant (Yes or No)	E. Wetland Indicator Category *	
Tree					
Red Maple (<i>Acer rubrum</i>)	26-50 (38.0)	48	Y	FAC*	
White Oak (<i>Quercus alba</i>)	6-15 (10.5)	13	N		
Red Oak (<i>Quercus rubra</i>)	16-25 (20.5)	26	Y	FACU	
Gray Birch (<i>Betula populifolia</i>)	6-15 (10.5)	13	N		
Total	79.5	100			
Sapling					
White Pine (<i>Pinus strobus</i>)	16-25 (20.5)	60	Y	FACU	
Red Oak (<i>Quercus rubra</i>)	0-5 (3.0)	9	N		
White Oak (<i>Quercus alba</i>)	6-15 (10.5)	31	Y	FACU	
Total	34.0	100			
Shrub					
Highbush Blueberry (<i>Vaccinium corymbosum</i>)	16-25 (20.5)	50	Y	FAC*	
Glossy Buckthorn (<i>Frangula alnus</i>)	16-25 (20.5)	50	Y	FAC*	
Total	41.0				
Herb					
Royal Fern (<i>Osmunda regalis</i>)	6-15 (10.5)	50	Y	OBL*	
Cinnamon Fern (<i>Osmunda cinnamomea</i>)	6-15 (10.5)	50	Y	FACW*	
Total	21.0	100			

**Total does not equal 100 due to rounding

*Use an asterisk to mark wetland indicator plants species listed in the Wetlands Protection Act (MGL c. 131, s. 40); plants in the genus Sphagnum; plants listed as FAC, FAC+, FACW-, FACW+, or OBL; or plants with physiological or morphological adaptations. If any plants are identified as wetland indicator plants due to physiological adaptations, describe the adaptation next to the asterisk.

Vegetation Conclusion:

Number of dominant wetland indicator plants: 5

Number of dominant non-wetland indicator plants: 3

Is the number of dominant wetland plants equal to or greater than the number of dominant non-wetland plants? YES NO

If vegetation alone is presumed adequate to delineate the BVW boundary, submit this form with the Request for Determination of Applicability or Notice of Intent.

Section II. Indicators of Hydrology

Hydric Soil Interpretation

1. Soil Survey

Is there a published soil survey for this site? Yes No

Title/Date: Soil Survey of Norfolk and Suffolk Counties, Massachusetts, 2020

Map Number: Accessed via Web Soil Survey <http://websoilsurvey.nrcs.usda.gov/>

Soil type mapped: 260B—Sudbury fine sandy loam, 2 to 8 percent slopes

Hydric Soil Inclusions: Walpole

Are field observations consistent with soil survey? Yes No

Remarks:

2. Soil Description

Horizon	Depth (in)	Matrix Color	Mottles Color
O	1-0"	10YR 2/1	
A	0-6"	10YR 2/1	
B	6+"	10YR 4/4	10YR 2/1

Remarks: dark streaking in b horizon

3. Other:

Conclusion: Is soil hydric? Yes No

Other Indicators of Hydrology: (check all that apply and describe)

Site inundated: pockets of standing water downslope

Depth to free water in observation hole:

Depth to soil saturation in observation hole:

Water Marks:

Drift lines:

Sediment deposits:

Drainage patterns in BVW:

Oxidized rhizospheres:

Water-stained leaves:

Recorded data (stream, lake, or tidal gauge; aerial photo; other):

Other: microrelief

Vegetation and Hydrology Conclusion

Number of wetland indicator plants Yes No
 ≥ number of non-wetland indicator plants Yes No

Wetland hydrology present:
 hydric soil present Yes No

other indicators of hydrology present Yes No

Sample location is in a BVW Yes No

Submit this form with the Request for Determination of Applicability or Notice of Intent

DEP Bordering Vegetated Wetland (310 CMR 10.55) Delineation Field Data Form

Applicant: **Prepared by:** Pare Corporation **Project location:** 2 Washington St, Foxboro **DEP File #:** None
 L. Gluck

Check all that apply:
 Vegetation alone presumed adequate to delineate BVW boundary: fill out section I only.
 Vegetation and other indicators of hydrology used to delineate BVW boundary: fill out Sections I and II.
 Method other than dominance test used (attach additional information).

Section I. Observation Plot Number: 6		Transect Number: A (Upland Station)	5'± U/G WF A-76	Date of Delineation: November 4, 2021
A. Sample Layer and Plant Species (by common/ scientific name)	B. Percent Cover (or basal area)	C. Percent Dominance	D. Dominant Plant (Yes or No)	E. Wetland Indicator Category *
Tree				
Red Maple (<i>Acer rubrum</i>)	16-25 (20.5)	26	Y	FAC*
Red Oak (<i>Quercus rubra</i>)	26-50 (38.0)	48	Y	FACU
Wild Pine (<i>Pinus strobus</i>)	16-25 (20.5)	26	Y	FACU
Total	79.0	100		
Sapling				
White Pine (<i>Pinus strobus</i>)	26-50 (38.0)	62	Y	FACU
White Oak (<i>Quercus alba</i>)	16-25 (20.5)	33	Y	FACU
Wild Black Cherry (<i>Prunus serotina</i>)	0-5 (3.0)	5	N	
Total	61.5	100		
Shrub				
Highbush Blueberry (<i>Vaccinium corymbosum</i>)	6-15 (10.5)	33	Y	FACW*
Huckleberry (<i>Gaylussacia baccata</i>)	6-15 (10.5)	33	Y	FACU
Glossy Buckthorn (<i>Frangula alnus</i>)	6-15 (10.5)	33	Y	FAC*
Total	31.5	99**		
Herb				
Wild Black Cherry seedling (<i>Prunus serotina</i>)	6-15 (10.5)	100	Y	FACU
Total	10.5	100		

**Total does not equal 100 due to rounding

*Use an asterisk to mark wetland indicator plants species listed in the Wetlands Protection Act (MGL c. 131, s. 40); plants in the genus Sphagnum; plants listed as FAC, FAC+, FACW-, FACW+, or OBL; or plants with physiological or morphological adaptations. If any plants are identified as wetland indicator plants due to physiological adaptations, describe the adaptation next to the asterisk.

Vegetation Conclusion:

Number of dominant wetland indicator plants: 3

Number of dominant non-wetland indicator plants: 6

Is the number of dominant wetland plants equal to or greater than the number of dominant non-wetland plants? YES NO
 If vegetation alone is presumed adequate to delineate the BVW boundary, submit this form with the Request for Determination of Applicability or Notice of Intent.

Section II. Indicators of Hydrology

Hydric Soil Interpretation

1. Soil Survey

Is there a published soil survey for this site? Yes No

Title/Date: Soil Survey of Norfolk and Suffolk Counties, Massachusetts, 2020

Map Number: Accessed via Web Soil Survey <http://websoilsurvey.nrcs.usda.gov/>

Soil type mapped: 254B—Merrimac fine sandy loam, 3 to 8 percent slopes

Hydric Soil Inclusions: none

Are field observations consistent with soil survey? Yes No

Remarks:

2. Soil Description

Horizon	Depth (in)	Matrix Color	Mottles Color
O	1/2-0"	10YR 2/2	
A	0-5"	10YR 2/2	
B	5+"	10YR 4/4	

Remarks:

3. Other:

Conclusion: Is soil hydric? Yes No

Other Indicators of Hydrology: (check all that apply and describe)

- Site inundated:
- Depth to free water in observation hole:
- Depth to soil saturation in observation hole:
- Water Marks:
- Drift lines:
- Sediment deposits:
- Drainage patterns in BVW:
- Oxidized rhizospheres:
- Water-stained leaves:
- Recorded data (stream, lake, or tidal gauge; aerial photo; other):
- Other:

Vegetation and Hydrology Conclusion

Number of wetland indicator plants Yes No

≥ number of non-wetland indicator plants

Wetland hydrology present: hydric soil present

other indicators of hydrology present

Sample location is in a BVW

Submit this form with the Request for Determination of Applicability or Notice of Intent

APPENDIX C

***Stormwater Management Report
(not included in all copies)**

Bay Colony Group, Inc.

Professional Civil Engineers & Land Surveyors

4 School Street, PO Box 9136
Foxborough, Massachusetts 02035
Telephone (508) 543-3939 • Fax (508) 543-8866
E-mail: mailbox@baycolonygroup.com

Storm Water Management Report 7 Perry Drive Foxborough, MA



June, 2023

Prepared for:

Technimetals
7 Perry Drive
Foxborough, MA 02035

Table of Contents:

Contents	Page
1.0 Introduction.....	1
2.0 Existing Conditions.....	1
3.0 Flood Condition Analysis and Flood Control.....	3
4.0 Storm Water Management.....	5
Figure 1- Locus Plan.....	2
Figure 2- Existing Drainage Subareas and Soils.....	Appendix A
Figure 3- Proposed Drainage Subareas and Soils.....	Appendix A
Appendix A: Pre- and Post-development Analysis and Storm Water Pond Designs.....	A-1
Appendix B: Storm Water Worksheets	B-1
Appendix C: Operation and Maintenance Plan.....	C-1
Appendix D: Soil Data	D-1

1.0 Introduction

The project involves the construction of a 12,000 square foot addition on existing commercial facility at 7 Perry Drive. The parcel is located on the southern side of Perry Drive just to the east of the intersection with Phelps Road. The property is bordered by commercial properties to the north, east, south and west. The property is located within the General Industrial and Limited Industrial Zoning districts. **Figure 1** is an extract from the USGS Mansfield quadrangle and shows the site locus.


Bay Colony Group, Inc. conducted a storm water management study to ensure that the proposed project meets the ten MA DEP Storm Water Management Standards, the storm water standards outlined in the Town of Foxborough Stormwater Management Bylaws, and standard engineering practice. The scope of this study includes:

- Determining existing flood conditions and storm water quality calculations and analysis;
- Developing proposed flood conditions and storm water quality calculations and analysis;
- Designing a storm water management system.

2.0 Existing Conditions

The site is located on Perry Drive on an existing parcel of land totaling 2.23+/- acres listed as Assessors' Map 002, Parcel 006 & 010. A portion of the property has been developed and contains an existing 23,900-sf commercial facility along with the associated parking and shipping area. The remainder of the property is currently undeveloped and consists of a wooded area. The front of the lot currently slopes to the north towards Perry Drive, while the rear of the lot slopes to the east from a high point located behind the building. There are bordering vegetated wetlands located in the southwestern portion of the property.

The NRCS has logged the soils on the site as Ridgebury fine sandy loam, Sudbury fine sandy loam, Paxton fine sandy loam and Urban Land **Appendix D**. The Ridgebury soil is classified as a D soil, Sudbury soil is classified as a B soil, Paxton soil is classified as a C soil and Urban Land is unclassified. For the purposes of this report, we have assumed Urban Land as a C soil, which we believe is a conservative assumption based on soil evaluations conducted at the front of the parcel during the septic repair, which classified the soil as a Class 1 sand. The wooded area on the site consists of a mixture of primary and secondary growth consisting of deciduous and coniferous trees. BCG has conducted soil evaluations in the area of the infiltration basin to determine the general soil condition, depth to ground water and depth to refusal in order to design a storm water system in accordance with the DEP Stormwater Standards. We also conducted a laboratory textural analysis in accordance with Standard 3 of the DEP Stormwater Standards. A laboratory sieve analysis was run on the sample under the subsurface infiltration basins and the textural analysis determined that the soils are Sandy Loam for the infiltration basin. The RAWLS table found in the DEP Stormwater Management Standards, Volume 3, Chapter 1 yields an infiltration rate of 1.02 inches per hour for Sandy Loam. Copies of the basin soil logs and laboratory textural analyses are included in **Appendix D** and the locations of the test pits are shown on the existing conditions plan **Sheet 2**.

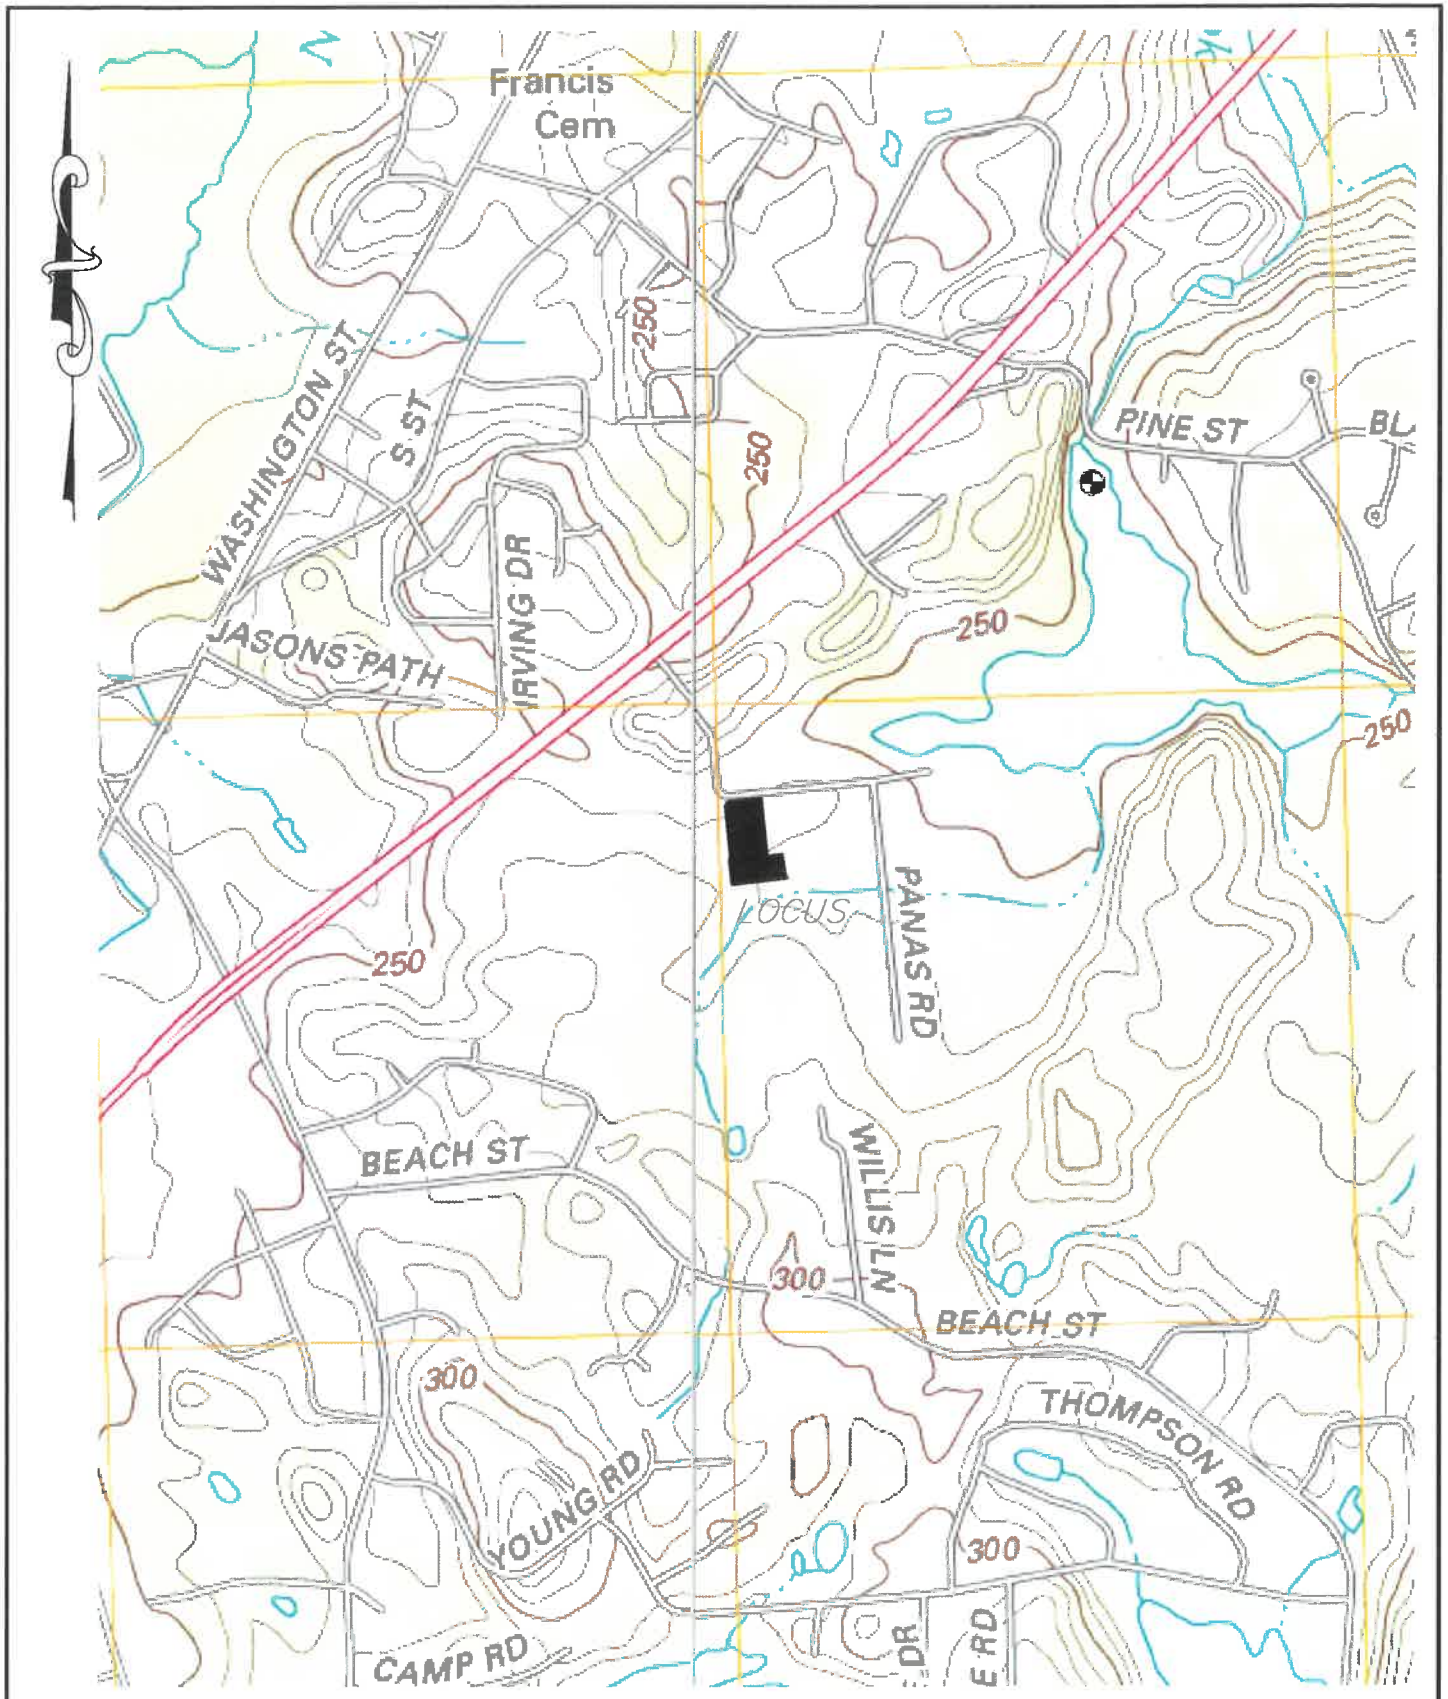

BAY COLONY GROUP, INC.
FOUR SCHOOL STREET
FOXBOROUGH, MA 02035
(508) 543-3939

USGS EXTRACT
7 PERRY DRIVE
FOXBOROUGH, MA 02035
MANSFIELD QUADRANGLE
SCALE: 1" = 1000'

3.0 Flood Condition Analyses and Flood Control

The storm water management system will consist of roof drainage, parking area drainage (runoff collection, pretreatment, and conveyance) and flood control and treatment. This report will concentrate on the storm water basin design, the ten DEP storm water management standards and the Town of Foxborough performance standards. It shall comply with all other requirements and improve existing conditions.

The proposed design will achieve runoff control through a system that includes a subsurface infiltration basin located southeast of the addition that will capture, treat, infiltrate and control the runoff from the roof and parking lot. All of the runoff from the parking area and a small portion of the driveway will be pretreated by deep sump catch basins with oil traps, before discharging to the basin. The system has been designed to control the 100-year storm event by infiltrating some fraction of the storm while allowing the rest to discharge. The system will ensure that the post-development rate of runoff is less than the pre-development condition.

The current land uses include a commercial building, parking areas, gravel and woods. The proposed land will be similar but will include the added area for the proposed addition and parking area, as well as more landscaping. Even though our site plan proposes permeable pavers, in order to be conservative for our design it was counted as pavement. The land uses for existing and proposed conditions are summarized in **Tables 1a** and **1b**. We have chosen 2 study lines to develop the existing and proposed condition models. Subarea EA is located in the northerly portion of the property and drains to the North to Perry Drive. Subarea EB is located in the southerly portion of the site and drains to the east towards southerly property lines. See the plan in **Appendix A – Existing Subareas**

Table 1a – Summary of Existing Land Uses

Subarea	Total Area (acre)	Land use	Area (acre)
EA	1.304	Woods, Fair, HSG B	0.170
		Woods, Fair, HSG C	0.110
		Woods, Fair, HSG D	0.051
		Paved Parking, HSG B	0.033
		Paved Parking, HSG C	0.348
		Gravel Surface HSG C	0.043
		Unconnected roofs, HSG B	0.212
		Unconnected roofs, HSG C	0.337
EB	0.929	Woods, Fair, HSG B	0.076
		Woods, Fair, HSG C	0.002
		Woods, Fair, HSG D	0.851
Total:	2.233	Total:	2.233

For the proposed conditions the watershed is divided into three separate subareas. Subarea PA is located in the northerly portion of the site. It contains the existing building, the redeveloped parking area and the redeveloped landscaping and it will continue to drain towards Perry Drive. Subarea PB is located in the southerly portion of the site and contains the proposed addition and

parking area. It discharges to 2 catch basins before being conveyed to the infiltration basin. The catch basins are located in the parking area and loading dock area. The roof runoff from the addition will be conveyed directly to the infiltration basin. Subarea PC is also located in the southerly portion of the property and will discharge to the southerly property lines. See the plan in **Appendix A – Developed Subareas**

Table 1b – Summary of Proposed Land Uses

Subarea	Total Area (acre)	Land use	Area (acre)
PA	1.167	Woods, Fair, HSG C	0.015
		Woods, Fair, HSG D	0.002
		Paved Parking, HSG B	0.025
		Paved Parking, HSG C	0.383
		Paved Parking, HSG D	0.024
		Woods/grass comb, HSG B	0.064
		>75% Grass Cover, HSG C	0.101
		>75% Grass Cover, HSG D	0.004
		Unconnected roofs, HSG B	0.212
		Unconnected roofs, HSG C	0.337
PB	0.653	Roofs, HSG B	0.136
		Roofs, HSG C	0.005
		Roofs, HSG D	0.138
		Paved parking, HSG D	0.374
PC	0.413	Woods/grass comb., Fair, HSG B	0.054
		>75% Grass Cover, Good, HSG D	0.081
		Woods, fair, HSG D	0.278
Total: 2.233		Total: 2.233	

The runoff conditions based on the land uses in **Tables 1a** and **1b** are summarized in **Table 2** and detailed calculations can be found in **Appendix A**. Storm water control is necessary due to the change in land use.

Table 2: Summary of Peak Runoff (cfs) at the Study Lines

Condition		2-year (cfs)	10-year (cfs)	100-year (cfs)
Existing Conditions	Perry Drive	3.1	4.9	7.2
	Southern Property Line	1.0	2.1	3.6
	Total	4.1	7.0	10.8
Proposed Conditions	Perry Drive	2.9	4.4	6.5
	Southern Property Line	0.5	1.0	1.7
	Total	3.4	5.4	8.2

The detailed storm routing calculations are attached in **APPENDIX A**. The infiltration rates used were those outlined in the RAWLS Table in the DEP Stormwater Management Standards and were discussed in **Section 2.0 Existing Conditions**.

4.0 Stormwater Management

The site is not located in a groundwater protection district (Zone II). There are no private drinking water wells around the project site. There are no other critical areas downgradient of the project site based on 314 CMR 4.00 (Massachusetts Surface Water Quality Standards). There are no certified vernal pools near the site. The DEP Stormwater Standards apply to this proposed project and the project design is based on the latest edition of these documents.

DEP STORMWATER MANAGEMENT STANDARDS

Standard #1: NO UNTREATED DISCHARGE OR EROSION TO WETLANDS

No untreated stormwater from the proposed project area will be discharged to a resource area. Runoff from all the proposed parking area will be discharged to deep sump catch basins equipped with oil traps and to the subsurface infiltration basin. This treatment train will achieve a TSS removal rate of 85%. All of the outfalls have been designed to accept the 25-year storm flow from the basin without causing erosion in the wetlands or soils **Appendix B**.

Standard #2: PEAK RATE ATTENUATION

Stormwater controls have been designed for 2, 10, and 100-year storms according to both state and local regulations. Measurement of peak discharge rates is calculated at a design point, typically the lowest point of discharge at the downgradient property line (Massachusetts Stormwater Handbook, Vol. 1, Ch. 1, P.5). The design ensures that the post-development peak rates of runoff do not exceed the pre-development condition at any of the design points chosen. Proponents must also evaluate the impact of peak discharges from the 100-year storm. If this evaluation shows that increased off-site flooding will result from peak discharge from the storm then BMPs must also attenuate that discharge (Massachusetts Stormwater Handbook, Vol. 1, Ch. 1, P.5). In this case, the post-development peak rates for the 100-year event are less than the pre-development condition everywhere **Table 2**.

Standard #3: STORMWATER RECHARGE

- 1) The proposed project area is located on a plot with hydrologic class B through D soils based on the NRCS soil survey. The target depth factor for an B soil is 0.35 inches, for C soils is 0.25 inches and for D soils is 0.10 inches. Soil textural analyses have been conducted in the area where recharge is proposed and it was found to be Sandy Loam under the basin. The RAWLS rate for Sandy Loam is 1.02 inches per hour and this rate will be used for the recharge calculations. **Appendix B**.
- 2) The infiltration BMP that will be used will be the subsurface infiltration basin. **Appendix B**.

- 3) Using the RAWLS rates for the infiltration basins shows that the drawdown of the Required Recharge Volume will be 0.8 hours, which meets the required 72 hours dewatering standard **APPENDIX B**.
- 4) Capture area adjustment is necessary since the runoff from a portion of the proposed driveway will not be directed to the infiltration structure. The calculations can be found in **APPENDIX B**. Runoff from 85% of the proposed impervious area will be discharged to the recharge facility which meets the 65% standard.
- 5) A mounding analysis is necessary under the infiltration Basin per the DEP Stormwater standards since the vertical separation from the bottom of the basins and the estimated high ground water elevation is less than 4'. In accordance with the "Simple Dynamic" methodology, the RAWLS rate is used as the hydraulic conductivity and the mounding analysis assumes that the Required Recharge Volume is applied during a 2-hour period during the storm. The specific yield at the basins is based on the USDA Textural Analysis and USGS Water Supply Paper 1662-D **Appendix D**. The model used is the AQTESOLV V.4.50.002 program that uses the ground water mounding solution by Hantush (1967). The analysis found that the top of the mound is 1.64' below the bottom of the basin. Therefore, the mound does not breach the bottom of the pond and will not impact the ability of the basin to drain within 72 hours as was previously discussed.
Appendix B

Standard # 4: WATER QUALITY

- 1) The required water quality volume is based on 0.766 acres of impervious area and 1 inch water quality depth, which yields a water quality volume of 2,780 cubic feet or 0.0638 ac-ft. The infiltration basin can handle a water volume of 5,837 cubic feet or 0.134 ac-ft prior to discharge.
- 2) The BMPs used for the proposed project to enhance water quality include: deep sump catch basins and subsurface infiltration basins. All of the runoff from the parking area will go through deep sump catch basins with "Snout" water quality elbows then to the above ground infiltration basin. The estimated overall TSS removal will be 85% and phosphorous removal will be 60%. **Appendix B**.
- 3) Because the subsurface basin is being used to fulfill the requirements of Standards 3 and 4 it must handle the larger of the water quality volumes. The basin has a Required Water Quality Volume of 0.0638 ac-ft and a storage volume 0.134 ac-ft below discharge
Appendix B

Standard # 5: LAND USES WITH HIGHER POTENTIAL POLLUTION LOADS

The site will consist of a typical commercial building with 42 parking spaces, which is not considered to have a high potential pollutant load. The site will be compatible with the surrounding environment, which is a primarily commercial property.

Standard #6: CRITICAL AREAS

According to 314 CMR 14.400 and MASS MAPPER the project site does not contain any critical resource areas

Standard #7: REDEVELOPMENT

The proposed activity is a combination of redevelopment/development project. The new addition and parking area must meet all of the DEP standards, which it does. Standard 7 Redevelopment Projects of the DEP Stormwater Standards requires the following standards be met to the maximum extent practical: Standard 2, Standard 3, and the pretreatment and structural stormwater BMPs of standards 4, 5 and 6. It shall comply with all other requirements and improve existing conditions. This project meets those criteria.

Standard #8: CONSTRUCTION PERIOD CONTROLS

Silt sock barriers will be installed at the limit of work if within 100' of any wetland resource area before any excavation starts. A stone pad shall be spread at the entrance of the proposed driveway to the project site to prevent mud from escaping the site during construction. Silt sacks will be installed within the catch basins.

A Draft Stormwater Pollution Prevention Plan has been developed. The site is not disturbing more than 1 acre, therefore does not fall under the EPA NPDES regulation and a final SWPPP will be prepared once the construction schedule is finalized and the contractors are chosen. A copy of the Draft SWPPP is included in **Sheet 7 & Appendix C**

Standard #9: OPERATION AND MAINTENANCE PLAN

Pre- and Post-Development Operation and Maintenance Plans have been developed for the project **Appendix C**.

Standard # 10: ILLICIT DISCHARGES TO DRAINAGE SYSTEM

I certify to the best of my professional knowledge, information and belief that there are no illicit discharges to the stormwater management system, including wastewater discharges and discharges of stormwater contaminated by contact with process wastes, raw materials, toxic pollutants, hazardous substances, oil, or grease. The proposed systems as shown on the referenced plans do not allow entry of any illicit discharges into the system and there are no connections between the stormwater and wastewater management systems.

To be signed prior to construction _____
Owner

Date

**APPENDIX A – Pre- and Post-DEVELOPMENT ANALYSIS
AND STORM WATER POND DESIGNS**

PROJECT
7 Perry Drive
Foxborough, MA

OWNER
1776 Washington
Street Realty TR
Michael R Barube
Jr Trustee
7 Perry Drive
Foxborough, MA



FOUR SCHOOL STREET
P.O. BOX 9138
FOXBOROUGH, MA 01533
508-545-3332


DATE APPROVED:
DATE ENFORCED:
FOXBOROUGH PLANNING BOARD

STAMP

DRAINING TITLE

Existing Subarea

SCALE: 1" = 20'
MAY 18, 2023
SHEET NUMBER
27-0103C
EX

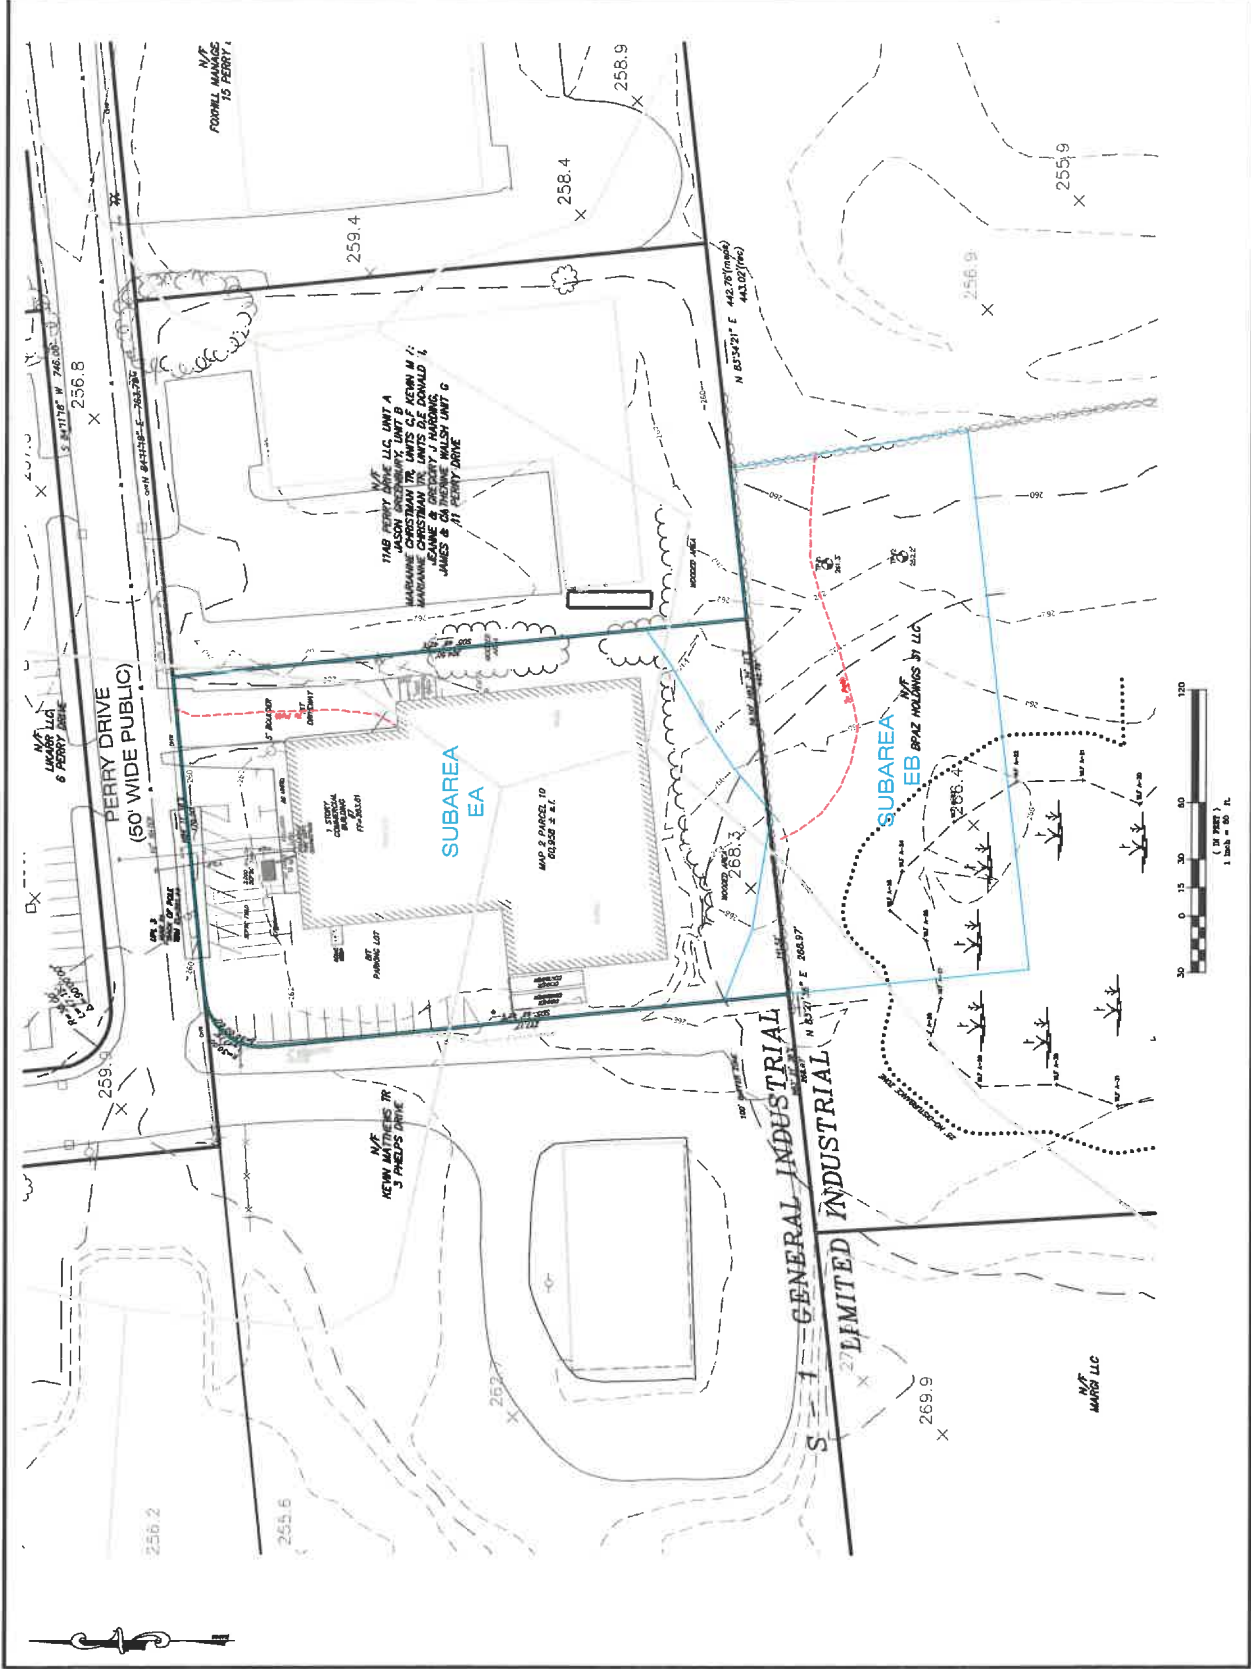



Subarea EA



Perry Drive



Subarea EB



Southern Property Line



21-0102 Existing

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive

Table of Contents

Printed 5/26/2023

TABLE OF CONTENTS

Project Reports

- 1 Routing Diagram
- 2 Area Listing (all nodes)
- 3 Soil Listing (all nodes)
- 4 Ground Covers (all nodes)

2-Year Event

- 5 Node Listing
- 6 Subcat 1S: Subarea EA
- 8 Subcat 2S: Subarea EB
- 9 Reach 3R: Perry Drive
- 10 Reach 4R: Southern Property Line

10-Year Event

- 11 Node Listing
- 12 Subcat 1S: Subarea EA
- 14 Subcat 2S: Subarea EB
- 15 Reach 3R: Perry Drive
- 16 Reach 4R: Southern Property Line

100-Year Event

- 17 Node Listing
- 18 Subcat 1S: Subarea EA
- 20 Subcat 2S: Subarea EB
- 21 Reach 3R: Perry Drive
- 22 Reach 4R: Southern Property Line

21-0102 Existing

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

Printed 5/26/2023

Page 2

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
0.102	96	Gravel surface, HSG B (1S)
0.043	96	Gravel surface, HSG C (1S)
0.033	98	Paved parking, HSG B (1S)
0.348	98	Paved parking, HSG C (1S)
0.212	98	Unconnected roofs, HSG B (1S)
0.337	98	Unconnected roofs, HSG C (1S)
0.144	60	Woods, Fair, HSG B (1S, 2S)
0.112	73	Woods, Fair, HSG C (1S, 2S)
0.902	79	Woods, Fair, HSG D (1S, 2S)
2.233	86	TOTAL AREA

21-0102 Existing

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

Printed 5/26/2023

Page 3

Soil Listing (all nodes)

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
0.491	HSG B	1S, 2S
0.840	HSG C	1S, 2S
0.902	HSG D	1S, 2S
0.000	Other	
2.233		TOTAL AREA

21-0102 Existing

Prepared by Bay Colony Group

Printed 5/26/2023

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

Page 4

Ground Covers (all nodes)

HSG-A (acres)	HSG-B (acres)	HSG-C (acres)	HSG-D (acres)	Other (acres)	Total (acres)	Ground Cover	Subcatchment Numbers
0.000	0.102	0.043	0.000	0.000	0.145	Gravel surface	1S
0.000	0.033	0.348	0.000	0.000	0.381	Paved parking	1S
0.000	0.212	0.337	0.000	0.000	0.549	Unconnected roofs	1S
0.000	0.144	0.112	0.902	0.000	1.158	Woods, Fair	1S, 2S
0.000	0.491	0.840	0.902	0.000	2.233	TOTAL AREA	

21-0102 Existing

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

Time span=5.00-20.00 hrs, dt=0.05 hrs, 301 points
 Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
 Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: Subarea EA

Runoff Area=1.304 ac 71.32% Impervious Runoff Depth>2.31"
 Flow Length=118' Tc=10.0 min CN=93 Runoff=3.1 cfs 0.251 af

Subcatchment 2S: Subarea EB

Runoff Area=0.929 ac 0.00% Impervious Runoff Depth>1.11"
 Flow Length=223' Tc=12.3 min CN=77 Runoff=1.0 cfs 0.086 af

Reach 3R: Perry Drive

Inflow=3.1 cfs 0.251 af
 Outflow=3.1 cfs 0.251 af

Reach 4R: Southern Property Line

Inflow=1.0 cfs 0.086 af
 Outflow=1.0 cfs 0.086 af

Total Runoff Area = 2.233 ac Runoff Volume = 0.337 af Average Runoff Depth = 1.81"
58.35% Pervious = 1.303 ac 41.65% Impervious = 0.930 ac

21-0102 Existing

Prepared by Bay Colony Group

Printed 5/26/2023

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

Page 6

Summary for Subcatchment 1S: Subarea EA

Runoff = 3.1 cfs @ 12.14 hrs, Volume= 0.251 af, Depth> 2.31"
 Routed to Reach 3R : Perry Drive

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2-Year Rainfall=3.20"

Area (ac)	CN	Description
0.068	60	Woods, Fair, HSG B
0.110	73	Woods, Fair, HSG C
0.051	79	Woods, Fair, HSG D
0.033	98	Paved parking, HSG B
0.348	98	Paved parking, HSG C
0.102	96	Gravel surface, HSG B
0.043	96	Gravel surface, HSG C
0.212	98	Unconnected roofs, HSG B
0.337	98	Unconnected roofs, HSG C
1.304	93	Weighted Average
0.374		28.68% Pervious Area
0.930		71.32% Impervious Area
0.549		59.03% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	50	0.0140	1.04		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.20"
0.5	68	0.0150	2.49		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.3	118	Total, Increased to minimum Tc = 10.0 min			

21-0102 Existing

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC


7 Perry Drive
Type III 24-hr 2-Year Rainfall=3.20"

Printed 5/26/2023

Page 7

Subcatchment 1S: Subarea EA

Hydrograph

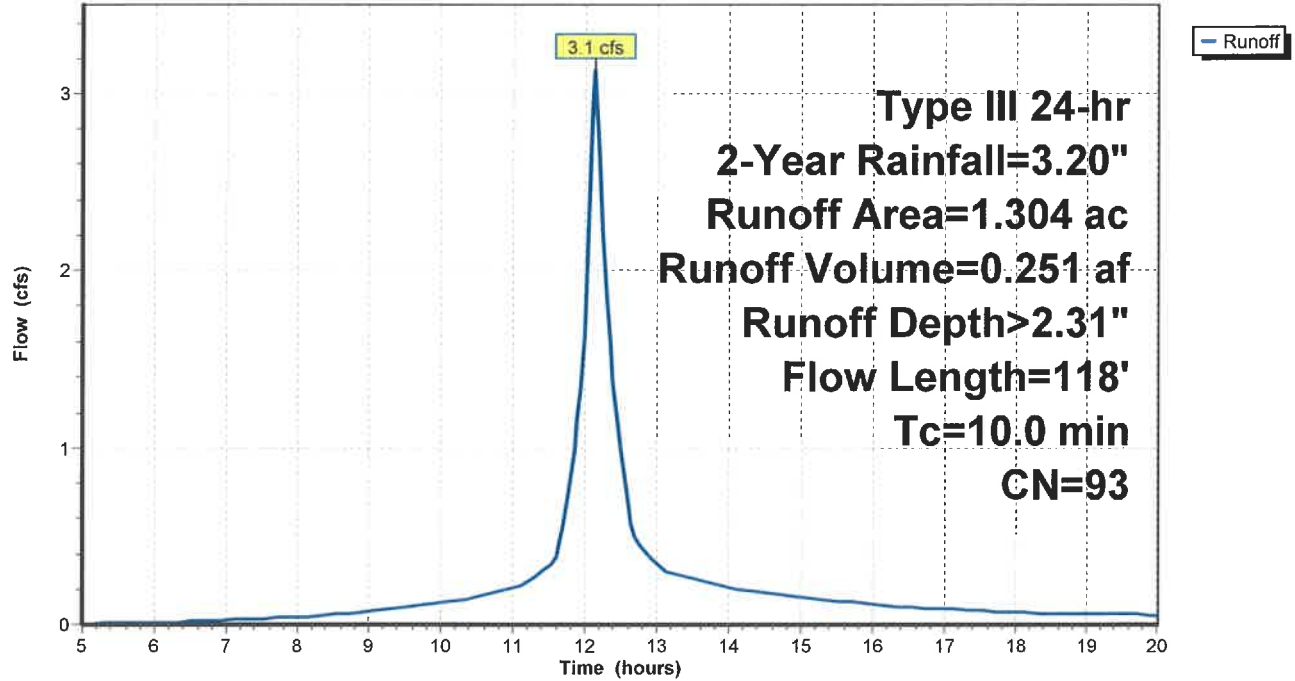

21-0102 Existing

Prepared by Bay Colony Group

Printed 5/26/2023

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

Page 8

Summary for Subcatchment 2S: Subarea EB

Runoff = 1.0 cfs @ 12.18 hrs, Volume= 0.086 af, Depth> 1.11"
 Routed to Reach 4R : Southern Property Line


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2-Year Rainfall=3.20"

Area (ac)	CN	Description
0.076	60	Woods, Fair, HSG B
0.002	73	Woods, Fair, HSG C
0.851	79	Woods, Fair, HSG D
0.929	77	Weighted Average
0.929		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.5	50	0.0380	0.09		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 3.20"
2.8	173	0.0430	1.04		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
12.3	223	Total			

Subcatchment 2S: Subarea EB

Hydrograph

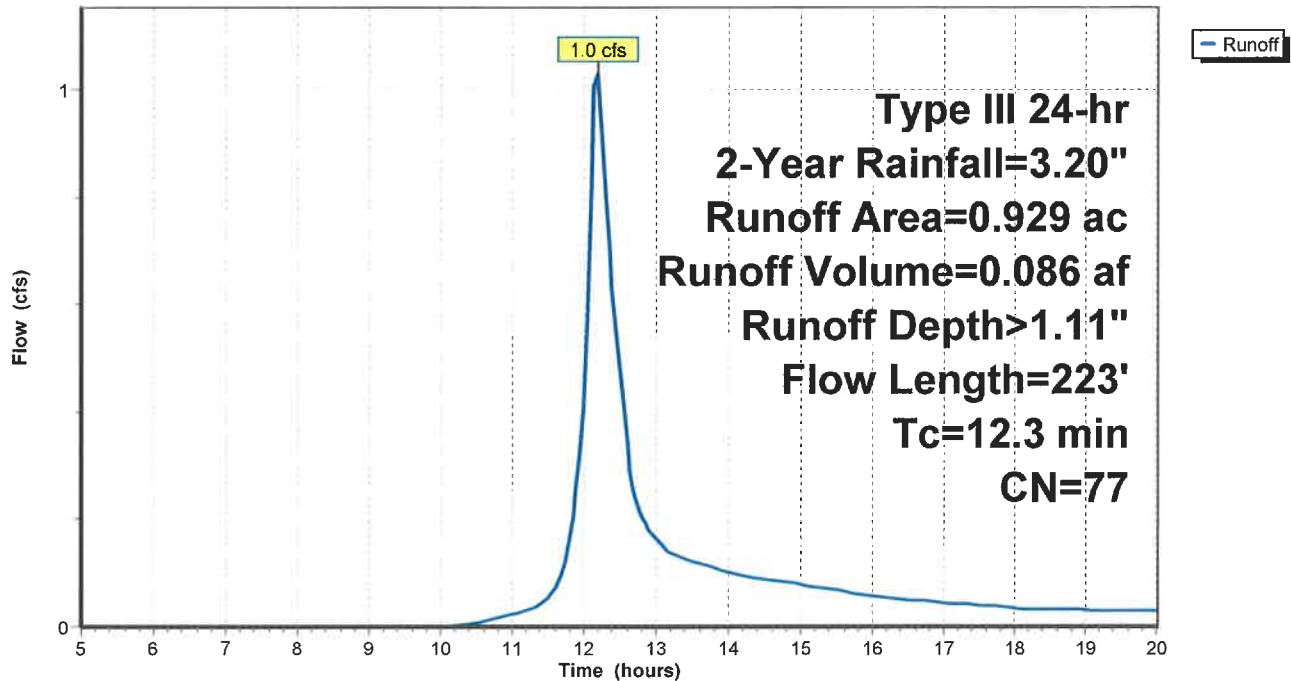

21-0102 Existing

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive
Type III 24-hr 2-Year Rainfall=3.20"

Printed 5/26/2023

Page 9


Summary for Reach 3R: Perry Drive

Inflow Area = 1.304 ac, 71.32% Impervious, Inflow Depth > 2.31" for 2-Year event
Inflow = 3.1 cfs @ 12.14 hrs, Volume= 0.251 af
Outflow = 3.1 cfs @ 12.14 hrs, Volume= 0.251 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Reach 3R: Perry Drive

Hydrograph

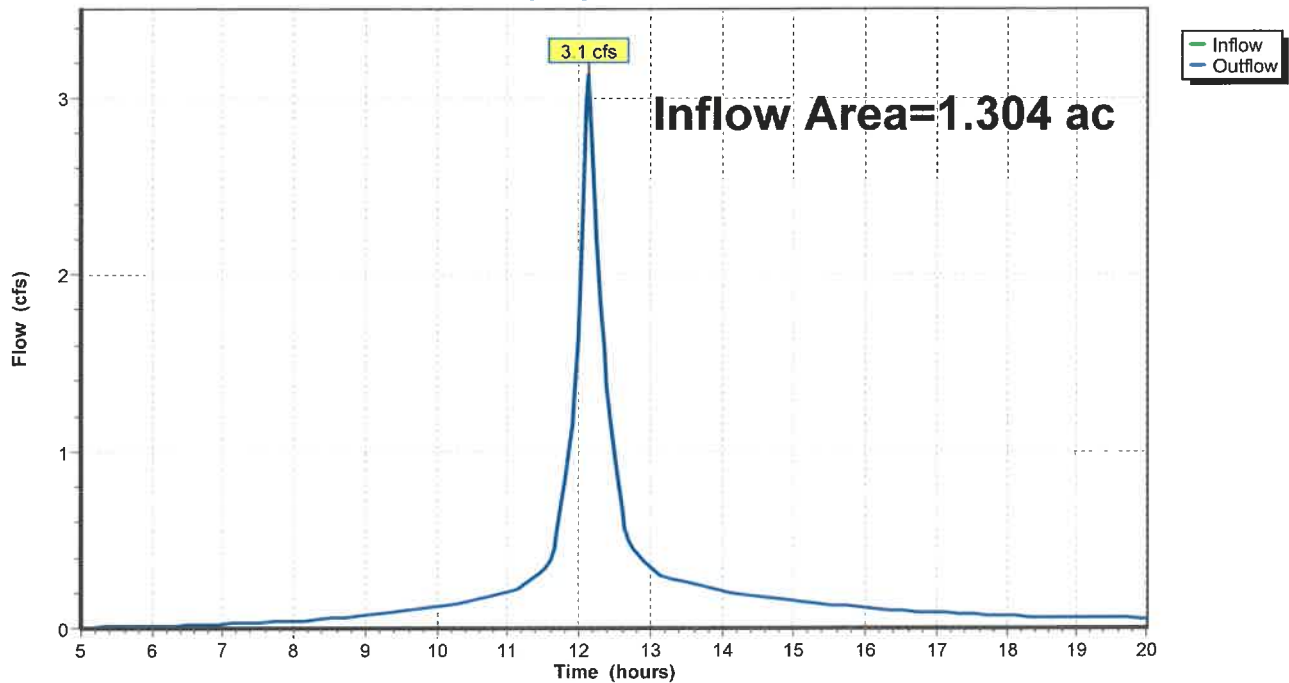

21-0102 Existing

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC


Summary for Reach 4R: Southern Property Line

Inflow Area = 0.929 ac, 0.00% Impervious, Inflow Depth > 1.11" for 2-Year event
Inflow = 1.0 cfs @ 12.18 hrs, Volume= 0.086 af
Outflow = 1.0 cfs @ 12.18 hrs, Volume= 0.086 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Reach 4R: Southern Property Line

Hydrograph

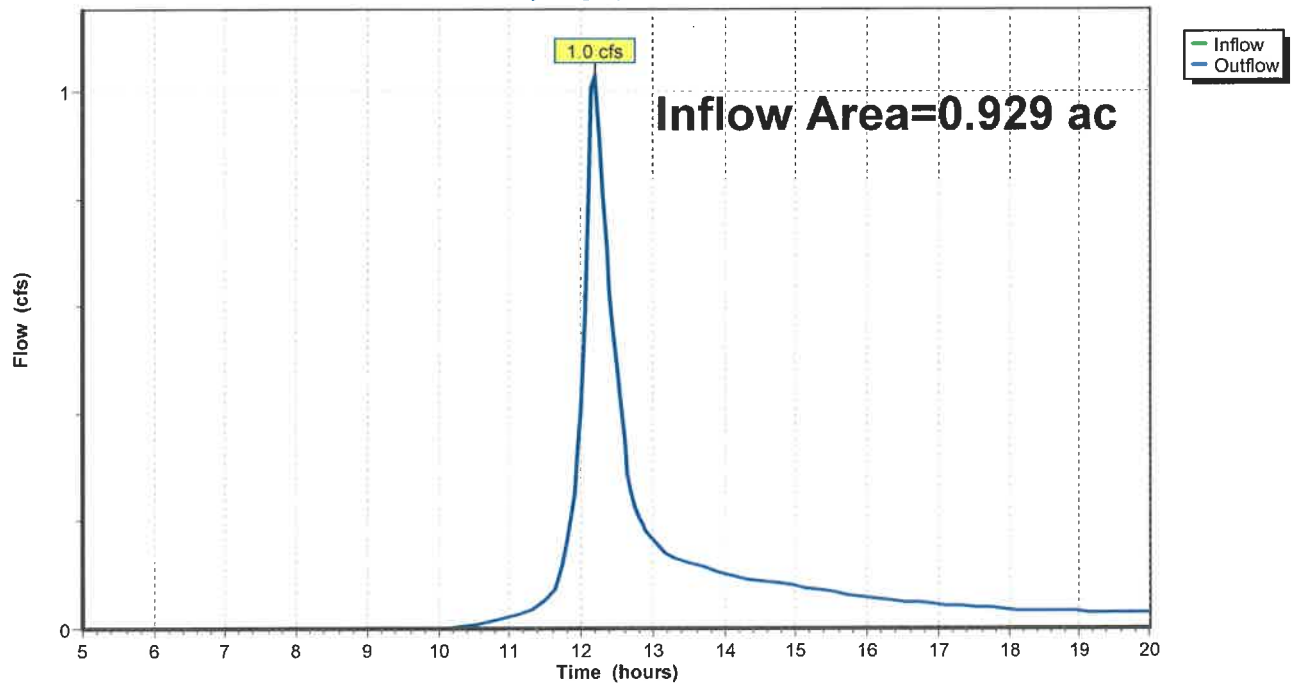

21-0102 Existing

Type III 24-hr 10-Year Rainfall=4.70"

Prepared by Bay Colony Group

Printed 5/26/2023

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

Page 11

Time span=5.00-20.00 hrs, dt=0.05 hrs, 301 points
 Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
 Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: Subarea EA

Runoff Area=1.304 ac 71.32% Impervious Runoff Depth>3.69"
 Flow Length=118' Tc=10.0 min CN=93 Runoff=4.9 cfs 0.400 af

Subcatchment 2S: Subarea EB

Runoff Area=0.929 ac 0.00% Impervious Runoff Depth>2.20"
 Flow Length=223' Tc=12.3 min CN=77 Runoff=2.1 cfs 0.170 af

Reach 3R: Perry Drive

Inflow=4.9 cfs 0.400 af
 Outflow=4.9 cfs 0.400 af

Reach 4R: Southern Property Line

Inflow=2.1 cfs 0.170 af
 Outflow=2.1 cfs 0.170 af

Total Runoff Area = 2.233 ac Runoff Volume = 0.571 af Average Runoff Depth = 3.07"
58.35% Pervious = 1.303 ac 41.65% Impervious = 0.930 ac

21-0102 Existing

Prepared by Bay Colony Group

Printed 5/26/2023

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

Page 12

Summary for Subcatchment 1S: Subarea EA

Runoff = 4.9 cfs @ 12.14 hrs, Volume= 0.400 af, Depth> 3.69"
 Routed to Reach 3R : Perry Drive

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10-Year Rainfall=4.70"

Area (ac)	CN	Description
0.068	60	Woods, Fair, HSG B
0.110	73	Woods, Fair, HSG C
0.051	79	Woods, Fair, HSG D
0.033	98	Paved parking, HSG B
0.348	98	Paved parking, HSG C
0.102	96	Gravel surface, HSG B
0.043	96	Gravel surface, HSG C
0.212	98	Unconnected roofs, HSG B
0.337	98	Unconnected roofs, HSG C
1.304	93	Weighted Average
0.374		28.68% Pervious Area
0.930		71.32% Impervious Area
0.549		59.03% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	50	0.0140	1.04		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.20"
0.5	68	0.0150	2.49		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.3	118	Total, Increased to minimum Tc = 10.0 min			

21-0102 Existing

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC


7 Perry Drive
Type III 24-hr 10-Year Rainfall=4.70"

Printed 5/26/2023

Page 13

Subcatchment 1S: Subarea EA

Hydrograph

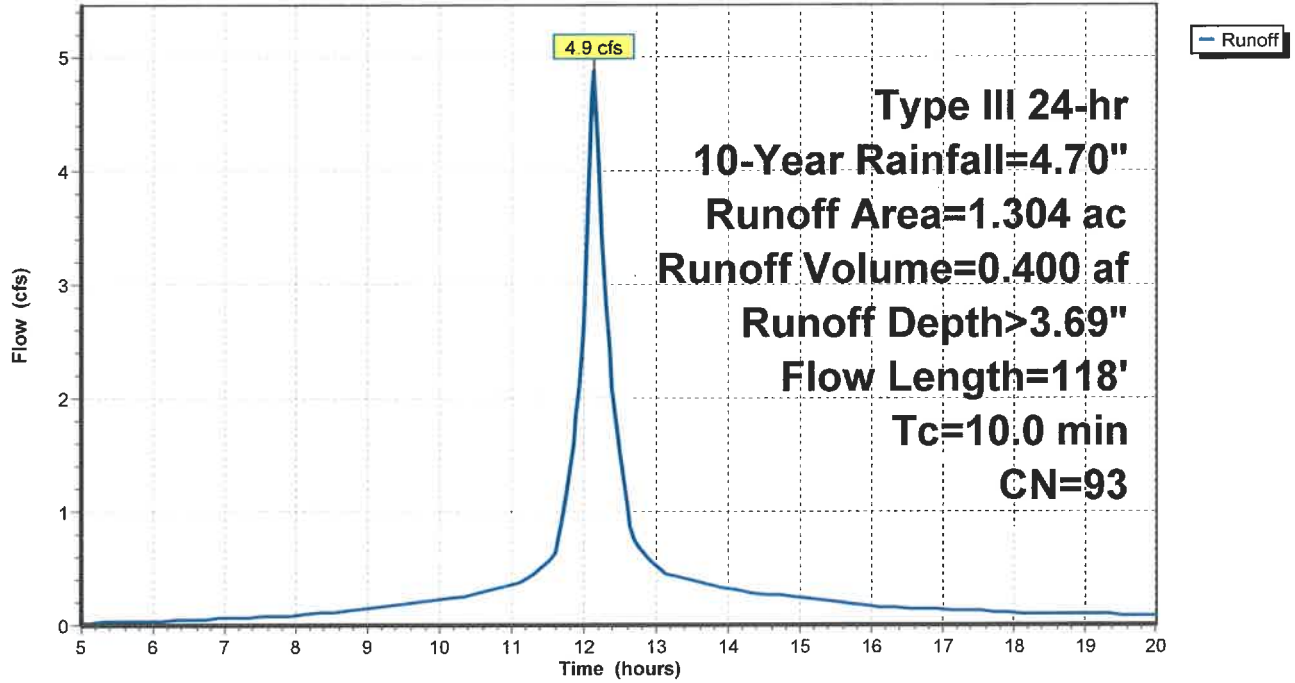

21-0102 Existing

Prepared by Bay Colony Group

Printed 5/26/2023

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

Page 14

Summary for Subcatchment 2S: Subarea EB

Runoff = 2.1 cfs @ 12.17 hrs, Volume= 0.170 af, Depth> 2.20"
 Routed to Reach 4R : Southern Property Line


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10-Year Rainfall=4.70"

Area (ac)	CN	Description
0.076	60	Woods, Fair, HSG B
0.002	73	Woods, Fair, HSG C
0.851	79	Woods, Fair, HSG D
0.929	77	Weighted Average
0.929		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.5	50	0.0380	0.09		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 3.20"
2.8	173	0.0430	1.04		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
12.3	223	Total			

Subcatchment 2S: Subarea EB

Hydrograph

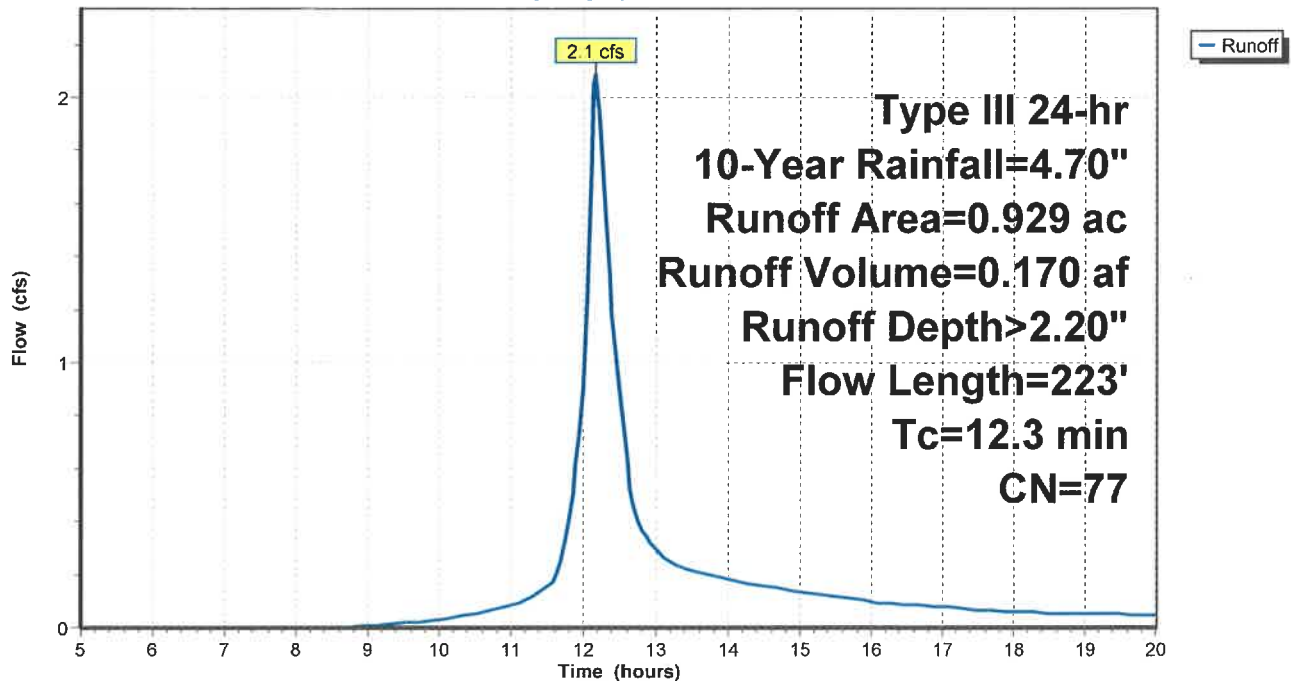

21-0102 Existing

Prepared by Bay Colony Group

Printed 5/26/2023

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

Page 15


Summary for Reach 3R: Perry Drive

Inflow Area = 1.304 ac, 71.32% Impervious, Inflow Depth > 3.69" for 10-Year event
Inflow = 4.9 cfs @ 12.14 hrs, Volume= 0.400 af
Outflow = 4.9 cfs @ 12.14 hrs, Volume= 0.400 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Reach 3R: Perry Drive

Hydrograph

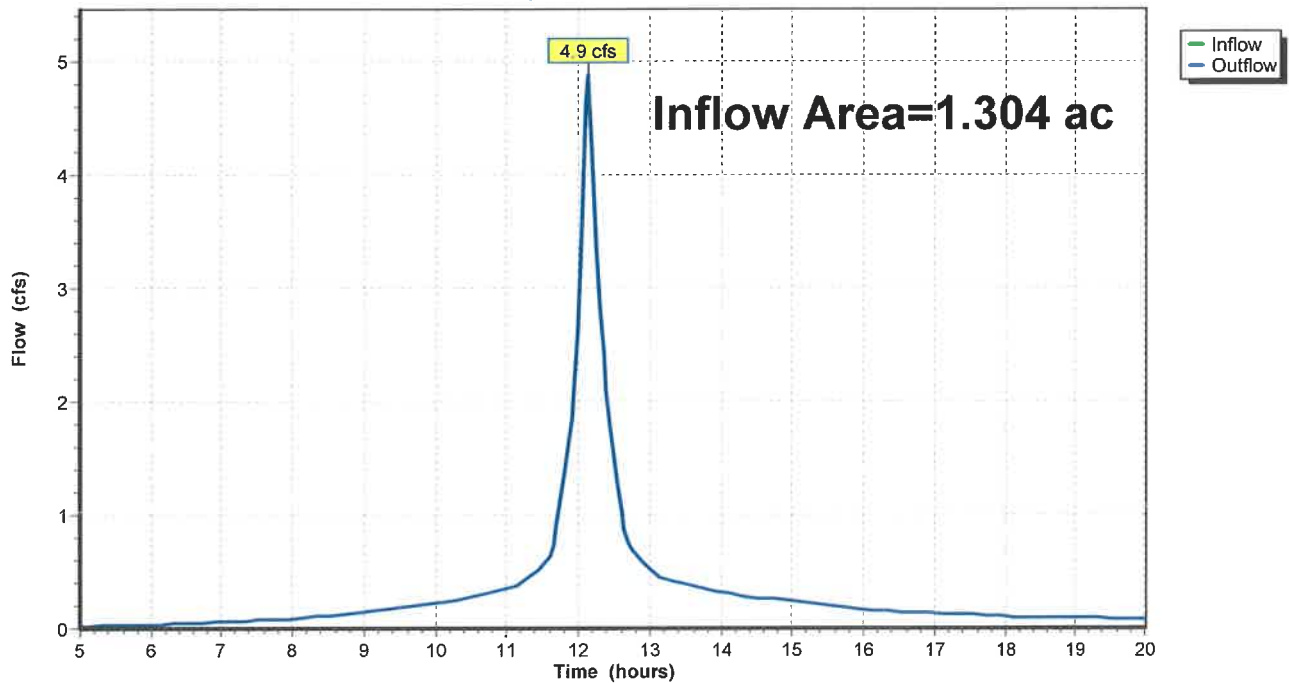

21-0102 Existing

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive
Type III 24-hr 10-Year Rainfall=4.70"

Printed 5/26/2023


Page 16

Summary for Reach 4R: Southern Property Line

Inflow Area = 0.929 ac, 0.00% Impervious, Inflow Depth > 2.20" for 10-Year event
Inflow = 2.1 cfs @ 12.17 hrs, Volume= 0.170 af
Outflow = 2.1 cfs @ 12.17 hrs, Volume= 0.170 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Reach 4R: Southern Property Line

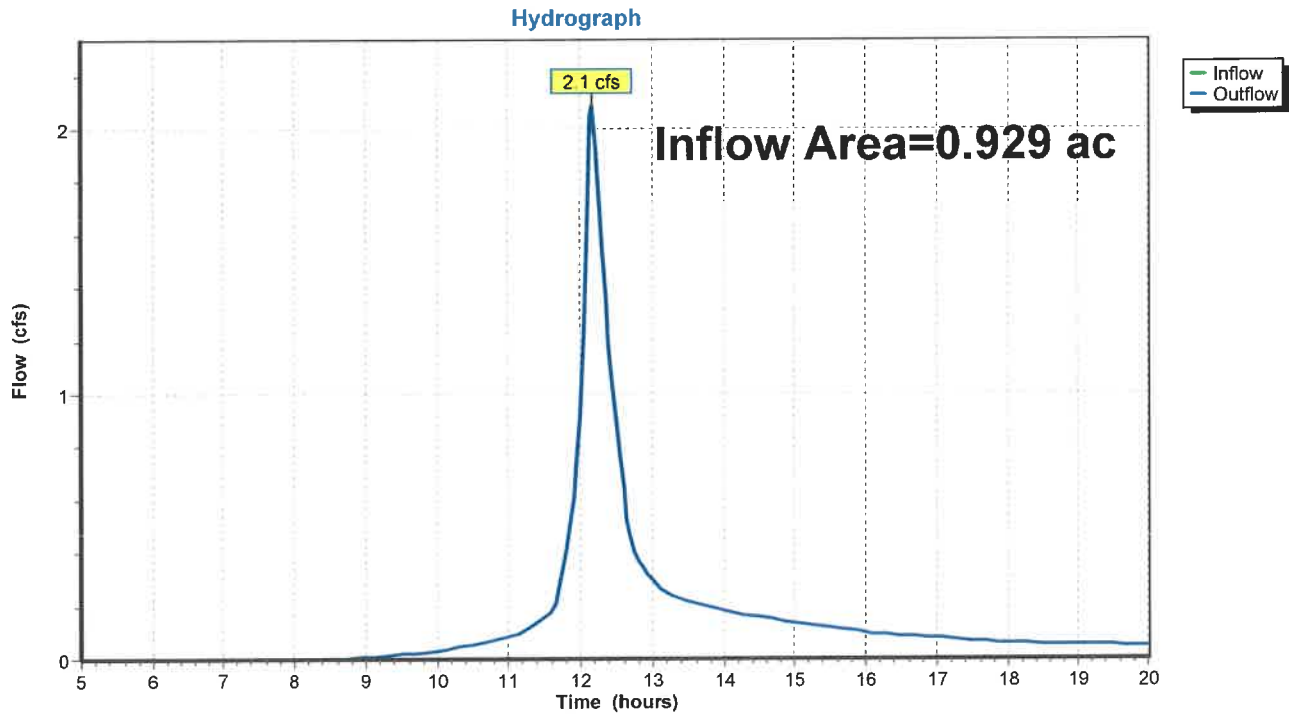

21-0102 Existing

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive
Type III 24-hr 100-Year Rainfall=6.70"

Printed 5/26/2023

Page 17

Time span=5.00-20.00 hrs, dt=0.05 hrs, 301 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: Subarea EA

Runoff Area=1.304 ac 71.32% Impervious Runoff Depth>5.53"
Flow Length=118' Tc=10.0 min CN=93 Runoff=7.2 cfs 0.601 af

Subcatchment 2S: Subarea EB

Runoff Area=0.929 ac 0.00% Impervious Runoff Depth>3.83"
Flow Length=223' Tc=12.3 min CN=77 Runoff=3.6 cfs 0.296 af

Reach 3R: Perry Drive

Inflow=7.2 cfs 0.601 af
Outflow=7.2 cfs 0.601 af

Reach 4R: Southern Property Line

Inflow=3.6 cfs 0.296 af
Outflow=3.6 cfs 0.296 af

Total Runoff Area = 2.233 ac Runoff Volume = 0.897 af Average Runoff Depth = 4.82"
58.35% Pervious = 1.303 ac 41.65% Impervious = 0.930 ac

21-0102 Existing

Prepared by Bay Colony Group

Printed 5/26/2023

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

Page 18

Summary for Subcatchment 1S: Subarea EA

Runoff = 7.2 cfs @ 12.14 hrs, Volume= 0.601 af, Depth> 5.53"
 Routed to Reach 3R : Perry Drive

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100-Year Rainfall=6.70"

Area (ac)	CN	Description
0.068	60	Woods, Fair, HSG B
0.110	73	Woods, Fair, HSG C
0.051	79	Woods, Fair, HSG D
0.033	98	Paved parking, HSG B
0.348	98	Paved parking, HSG C
0.102	96	Gravel surface, HSG B
0.043	96	Gravel surface, HSG C
0.212	98	Unconnected roofs, HSG B
0.337	98	Unconnected roofs, HSG C
1.304	93	Weighted Average
0.374		28.68% Pervious Area
0.930		71.32% Impervious Area
0.549		59.03% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	50	0.0140	1.04		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.20"
0.5	68	0.0150	2.49		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.3	118	Total, Increased to minimum Tc = 10.0 min			

21-0102 Existing

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC


7 Perry Drive
Type III 24-hr 100-Year Rainfall=6.70"

Printed 5/26/2023

Page 19

Subcatchment 1S: Subarea EA

Hydrograph

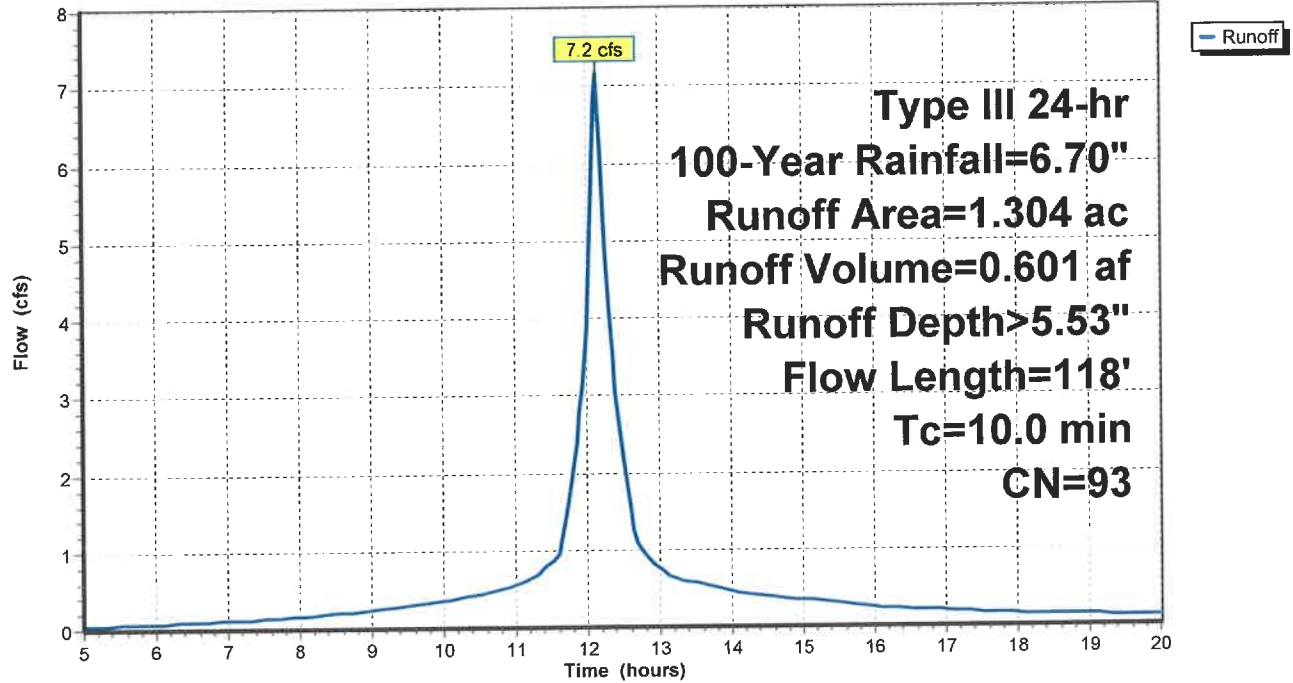

21-0102 Existing

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

Summary for Subcatchment 2S: Subarea EB

Runoff = 3.6 cfs @ 12.17 hrs, Volume= 0.296 af, Depth> 3.83"
 Routed to Reach 4R : Southern Property Line


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100-Year Rainfall=6.70"

Area (ac)	CN	Description
0.076	60	Woods, Fair, HSG B
0.002	73	Woods, Fair, HSG C
0.851	79	Woods, Fair, HSG D
0.929	77	Weighted Average
0.929		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.5	50	0.0380	0.09		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 3.20"
2.8	173	0.0430	1.04		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
12.3	223	Total			

Subcatchment 2S: Subarea EB

Hydrograph

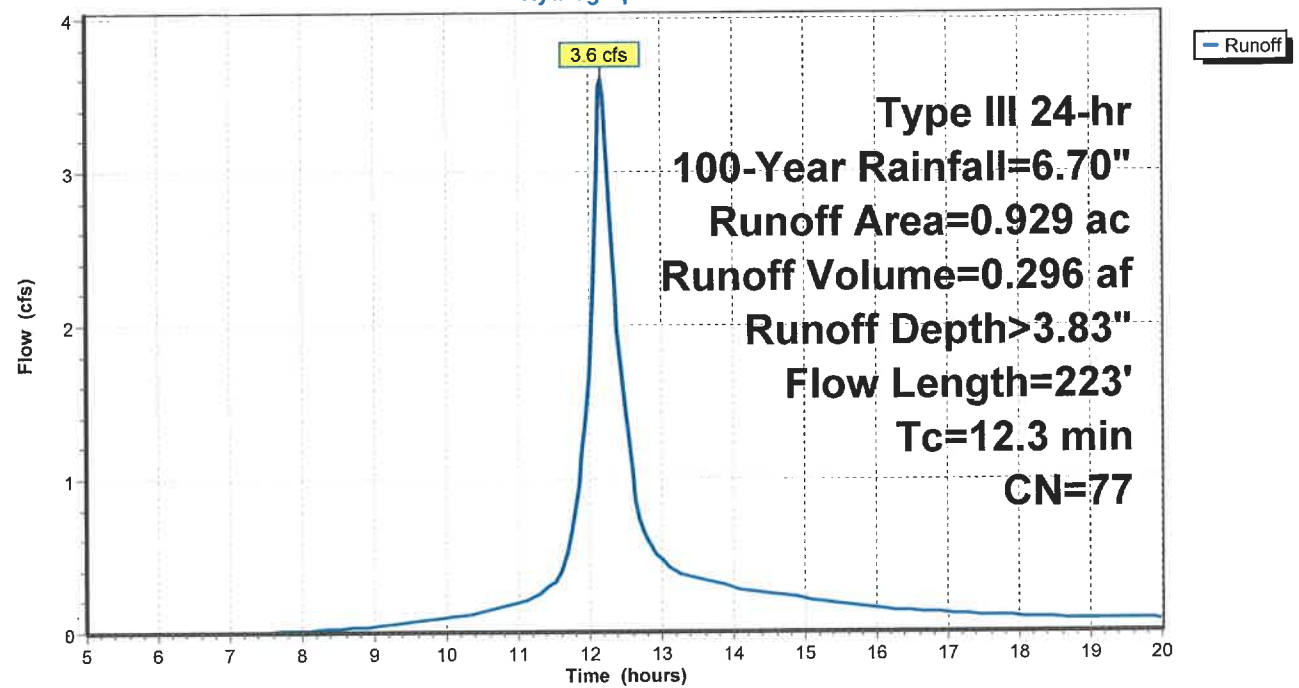

21-0102 Existing

Prepared by Bay Colony Group

Printed 5/26/2023

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

Page 21


Summary for Reach 3R: Perry Drive

Inflow Area = 1.304 ac, 71.32% Impervious, Inflow Depth > 5.53" for 100-Year event
Inflow = 7.2 cfs @ 12.14 hrs, Volume= 0.601 af
Outflow = 7.2 cfs @ 12.14 hrs, Volume= 0.601 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Reach 3R: Perry Drive

Hydrograph

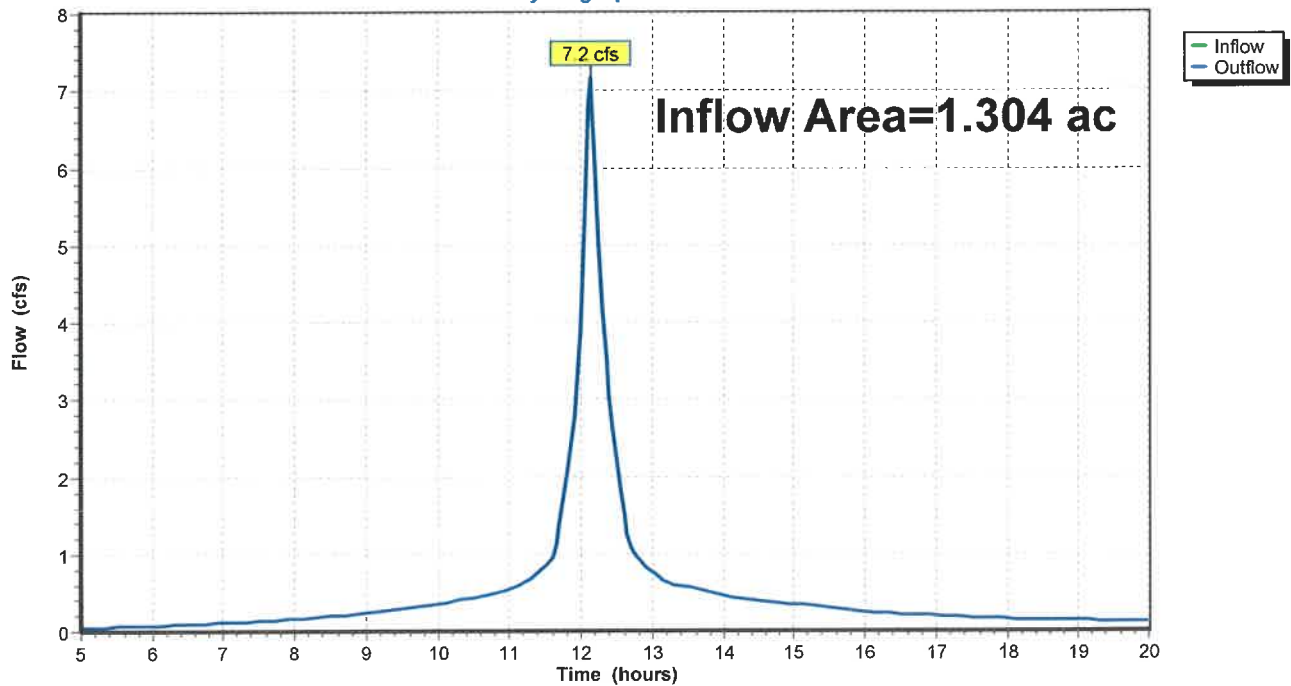

21-0102 Existing

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive
Type III 24-hr 100-Year Rainfall=6.70"

Printed 5/26/2023


Page 22

Summary for Reach 4R: Southern Property Line

Inflow Area = 0.929 ac, 0.00% Impervious, Inflow Depth > 3.83" for 100-Year event
Inflow = 3.6 cfs @ 12.17 hrs, Volume= 0.296 af
Outflow = 3.6 cfs @ 12.17 hrs, Volume= 0.296 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Reach 4R: Southern Property Line

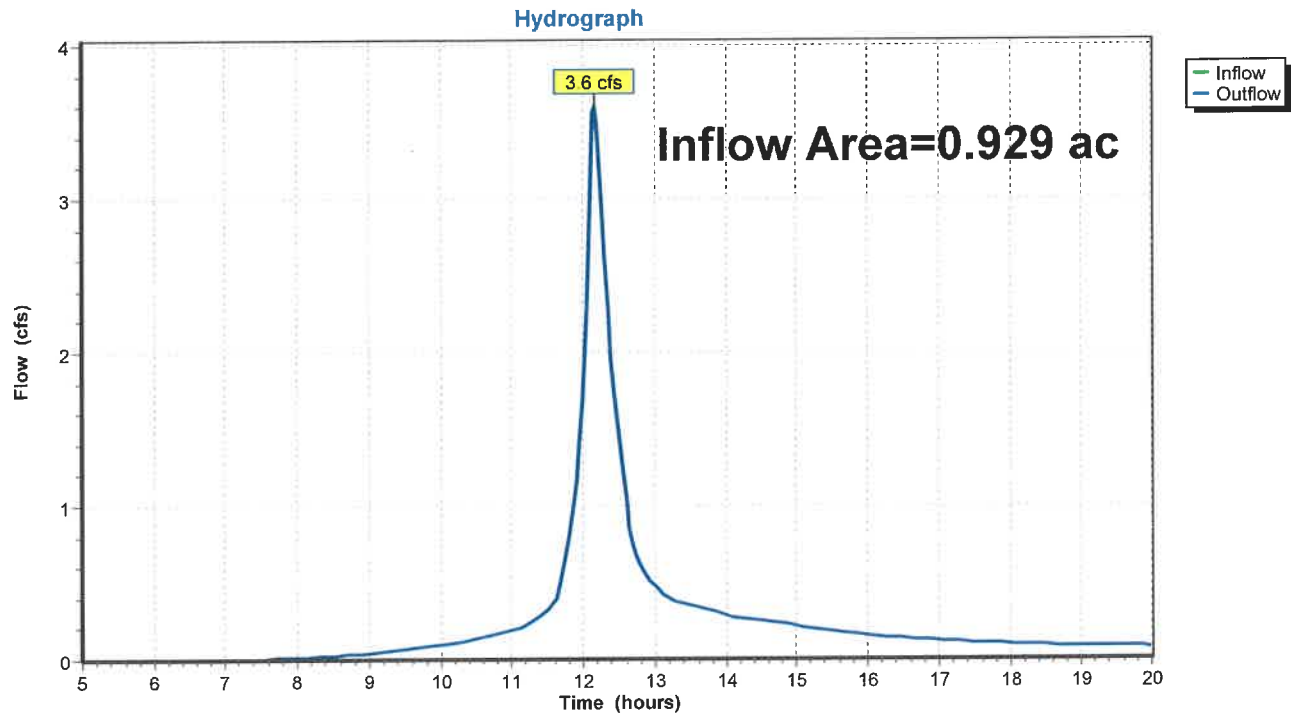

PROJECT:
7 Perry Drive
Foxborough, MA

OWNER:
1776 Washington
Street Realty TR
Michael R Bernbe
Jr Trustee
7 Perry Drive
Foxborough, MA



PLANNING BOARD
1776 WASHINGTON STREET
FOXBOROUGH, MA 01903
508-543-3339

DATE APPROVED: _____
DATE ORDERED: _____
FOXBOROUGH PLANNING BOARD

STAMP

DRAWING TITLE


Proposed Subareas

SCALE: 1" = 20'

MAY 18, 2023 SHEET NUMBER

21-0102C

Pr

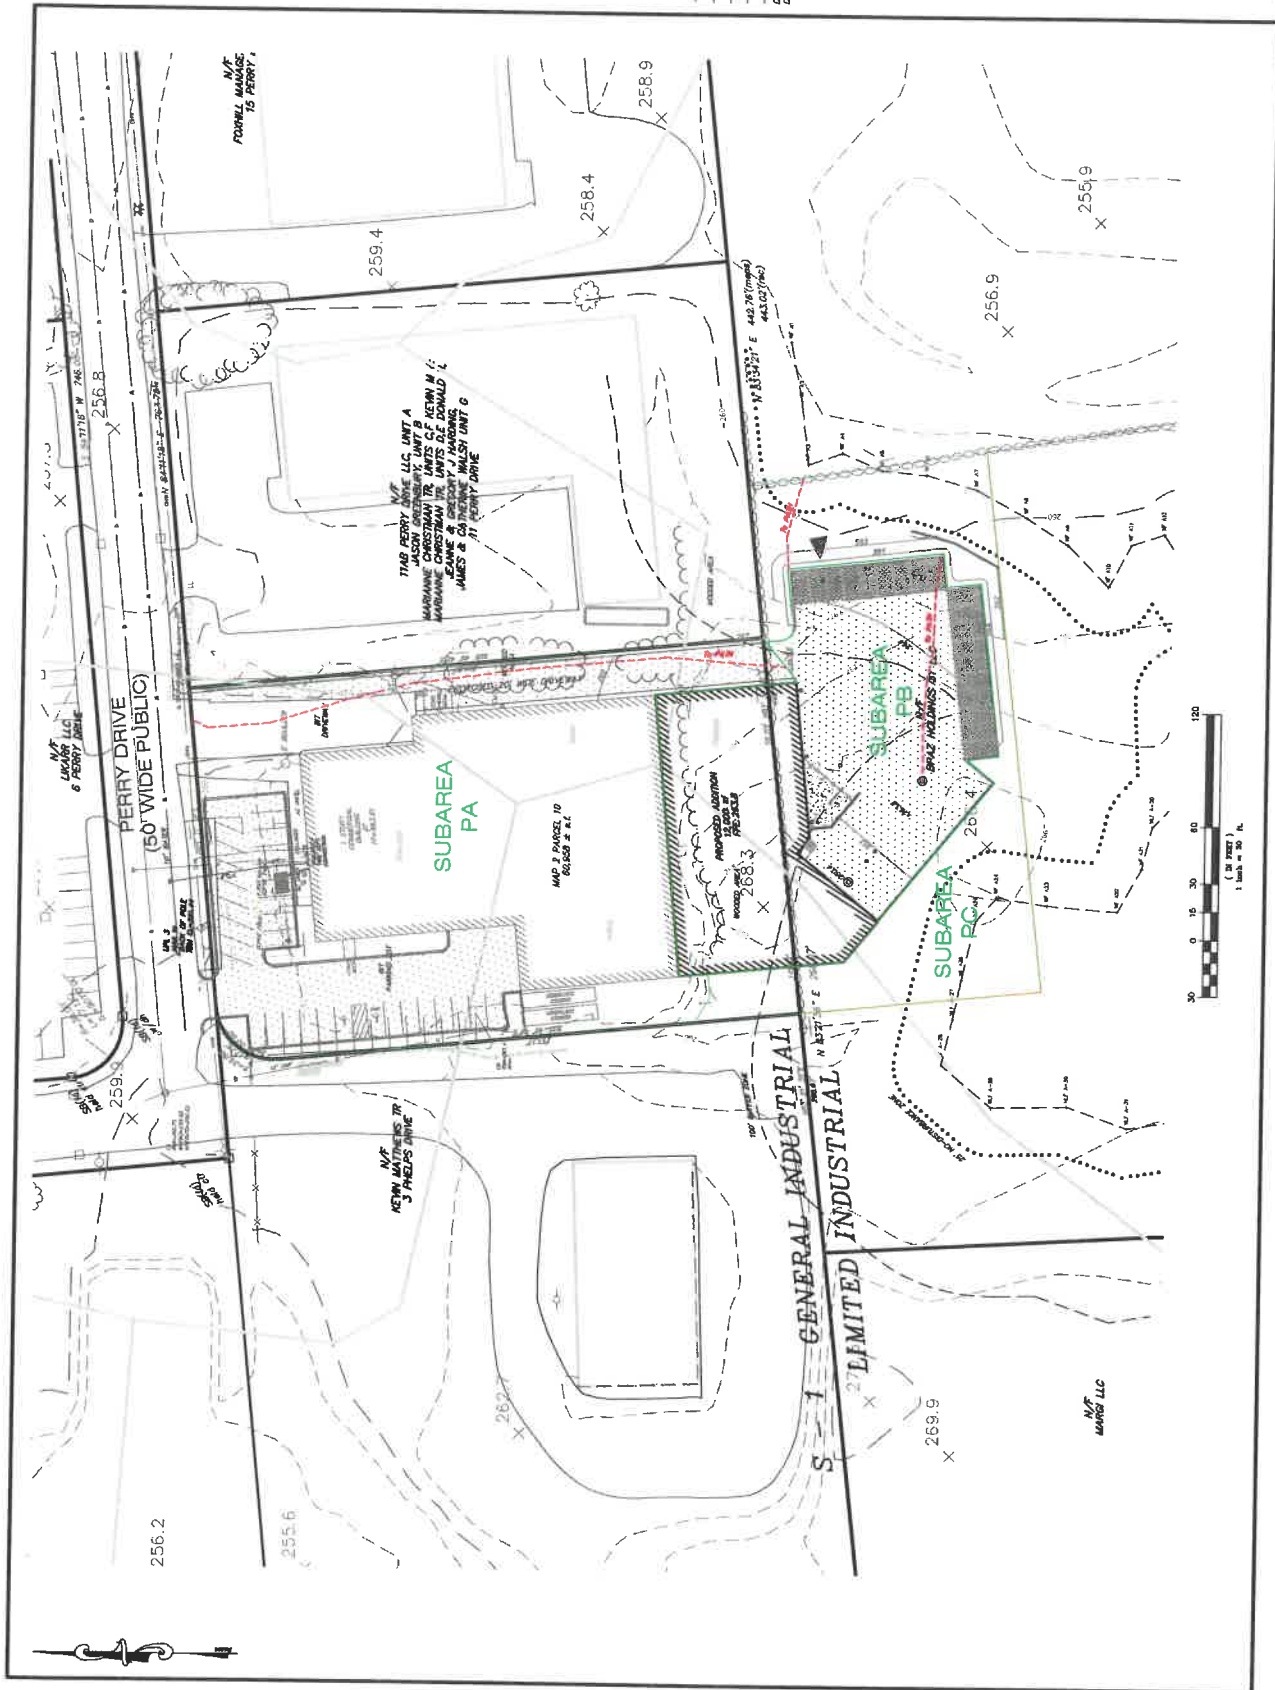



Subarea PA



Perry Drive




Subarea PB




Subsurface basin



Subarea PC



Southern Property Line

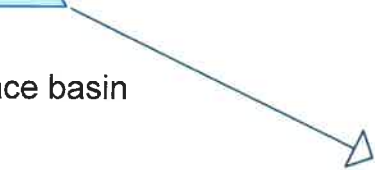

Routing Diagram for 21-0102 Proposed
Prepared by Bay Colony Group, Printed 6/14/2023
HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive

Table of Contents

Printed 6/14/2023

TABLE OF CONTENTS

Project Reports

- 23 Routing Diagram
- 24 Area Listing (all nodes)
- 25 Soil Listing (all nodes)
- 26 Ground Covers (all nodes)

2-Year Event

- 27 Node Listing
- 28 Subcat 1S: Subarea PA
- 30 Subcat 2S: Subarea PB
- 31 Subcat 3S: Subarea PC
- 32 Reach 4R: Perry Drive
- 33 Reach 6R: Southern Property Line
- 34 Pond 5P: Subsurface basin

10-Year Event

- 37 Node Listing
- 38 Subcat 1S: Subarea PA
- 40 Subcat 2S: Subarea PB
- 41 Subcat 3S: Subarea PC
- 42 Reach 4R: Perry Drive
- 43 Reach 6R: Southern Property Line
- 44 Pond 5P: Subsurface basin

100-Year Event

- 47 Node Listing
- 48 Subcat 1S: Subarea PA
- 50 Subcat 2S: Subarea PB
- 51 Subcat 3S: Subarea PC
- 52 Reach 4R: Perry Drive
- 53 Reach 6R: Southern Property Line
- 54 Pond 5P: Subsurface basin

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive

Printed 6/14/2023

Page 24

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
0.100	74	>75% Grass cover, Good, HSG C (1S)
0.086	80	>75% Grass cover, Good, HSG D (1S, 3S)
0.025	98	Paved parking, HSG B (1S)
0.383	98	Paved parking, HSG C (1S)
0.398	98	Paved parking, HSG D (1S, 2S)
0.136	98	Roofs, HSG B (2S)
0.005	98	Roofs, HSG C (2S)
0.138	98	Roofs, HSG D (2S)
0.212	98	Unconnected roofs, HSG B (1S)
0.337	98	Unconnected roofs, HSG C (1S)
0.015	73	Woods, Fair, HSG C (1S)
0.280	79	Woods, Fair, HSG D (1S, 3S)
0.118	65	Woods/grass comb., Fair, HSG B (1S, 3S)
2.233	92	TOTAL AREA

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive

Printed 6/14/2023

Page 25

Soil Listing (all nodes)

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
0.491	HSG B	1S, 2S, 3S
0.840	HSG C	1S, 2S
0.902	HSG D	1S, 2S, 3S
0.000	Other	
2.233		TOTAL AREA

21-0102 Proposed

Prepared by Bay Colony Group

Printed 6/14/2023

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

Page 26

Ground Covers (all nodes)

HSG-A (acres)	HSG-B (acres)	HSG-C (acres)	HSG-D (acres)	Other (acres)	Total (acres)	Ground Cover	Subcatchment Numbers
0.000	0.000	0.100	0.086	0.000	0.186	>75% Grass cover, Good	1S, 3S
0.000	0.025	0.383	0.398	0.000	0.806	Paved parking	1S, 2S
0.000	0.136	0.005	0.138	0.000	0.279	Roofs	2S
0.000	0.212	0.337	0.000	0.000	0.549	Unconnected roofs	1S
0.000	0.000	0.015	0.280	0.000	0.295	Woods, Fair	1S, 3S
0.000	0.118	0.000	0.000	0.000	0.118	Woods/grass comb., Fair	1S, 3S
0.000	0.491	0.840	0.902	0.000	2.233	TOTAL AREA	

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive
Type III 24-hr 2-Year Rainfall=3.20"

Printed 6/14/2023

Page 27

Time span=5.00-20.00 hrs, dt=0.05 hrs, 301 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: Subarea PA Runoff Area=1.167 ac 84.06% Impervious Runoff Depth>2.40"
Flow Length=318' Tc=10.0 min CN=94 Runoff=2.9 cfs 0.234 af

Subcatchment 2S: Subarea PB Runoff Area=0.653 ac 100.00% Impervious Runoff Depth>2.77"
Flow Length=120' Slope=0.0100 '/' Tc=10.0 min CN=98 Runoff=1.8 cfs 0.151 af

Subcatchment 3S: Subarea PC Runoff Area=0.413 ac 0.00% Impervious Runoff Depth>1.11"
Flow Length=50' Tc=10.0 min CN=77 Runoff=0.5 cfs 0.038 af

Reach 4R: Perry Drive Inflow=2.9 cfs 0.234 af
Outflow=2.9 cfs 0.234 af

Reach 6R: Southern Property Line Inflow=0.5 cfs 0.038 af
Outflow=0.5 cfs 0.038 af

Pond 5P: Subsurface basin Peak Elev=261.53' Storage=0.057 af Inflow=1.8 cfs 0.151 af
Discarded=0.2 cfs 0.151 af Primary=0.0 cfs 0.000 af Outflow=0.2 cfs 0.151 af

Total Runoff Area = 2.233 ac Runoff Volume = 0.423 af Average Runoff Depth = 2.27"
26.82% Pervious = 0.599 ac 73.18% Impervious = 1.634 ac

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive
Type III 24-hr 2-Year Rainfall=3.20"

Printed 6/14/2023

Page 28

Summary for Subcatchment 1S: Subarea PA

Runoff = 2.9 cfs @ 12.14 hrs, Volume= 0.234 af, Depth> 2.40"
 Routed to Reach 4R : Perry Drive

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2-Year Rainfall=3.20"

Area (ac)	CN	Description
0.015	73	Woods, Fair, HSG C
0.002	79	Woods, Fair, HSG D
0.025	98	Paved parking, HSG B
0.383	98	Paved parking, HSG C
0.024	98	Paved parking, HSG D
0.064	65	Woods/grass comb., Fair, HSG B
0.100	74	>75% Grass cover, Good, HSG C
0.005	80	>75% Grass cover, Good, HSG D
0.212	98	Unconnected roofs, HSG B
0.337	98	Unconnected roofs, HSG C
1.167	94	Weighted Average
0.186		15.94% Pervious Area
0.981		84.06% Impervious Area
0.549		55.96% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	50	0.0200	1.20		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.20"
1.7	268	0.0160	2.57		Shallow Concentrated Flow, Paved Kv= 20.3 fps
2.4	318	Total, Increased to minimum Tc = 10.0 min			

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC


7 Perry Drive
Type III 24-hr 2-Year Rainfall=3.20"

Printed 6/14/2023

Page 29

Subcatchment 1S: Subarea PA

Hydrograph

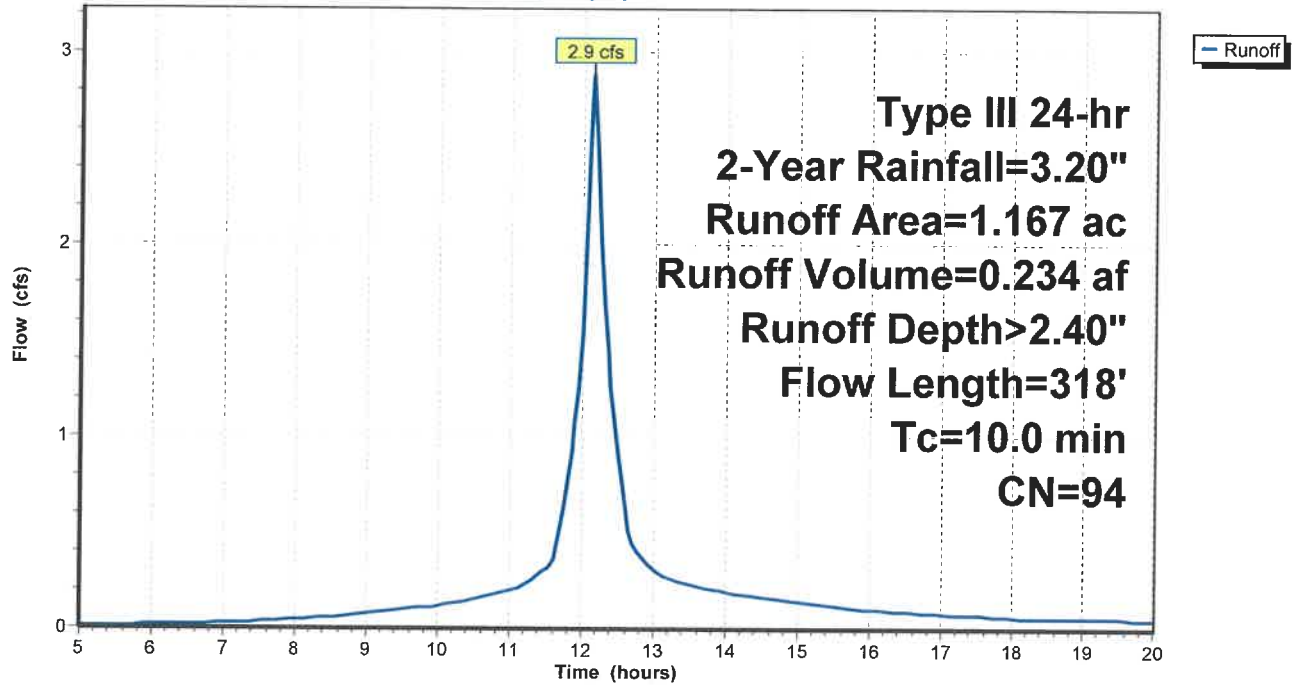

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive
Type III 24-hr 2-Year Rainfall=3.20"

Printed 6/14/2023

Page 30

Summary for Subcatchment 2S: Subarea PB

Runoff = 1.8 cfs @ 12.14 hrs, Volume= 0.151 af, Depth> 2.77"
Routed to Pond 5P : Subsurface basin


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.20"

Area (ac)	CN	Description
0.136	98	Roofs, HSG B
0.005	98	Roofs, HSG C
0.138	98	Roofs, HSG D
0.374	98	Paved parking, HSG D
0.653	98	Weighted Average
0.653		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.9	50	0.0100	0.91		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.20"
0.6	70	0.0100	2.03		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.5	120	Total, Increased to minimum Tc = 10.0 min			

Subcatchment 2S: Subarea PB

Hydrograph

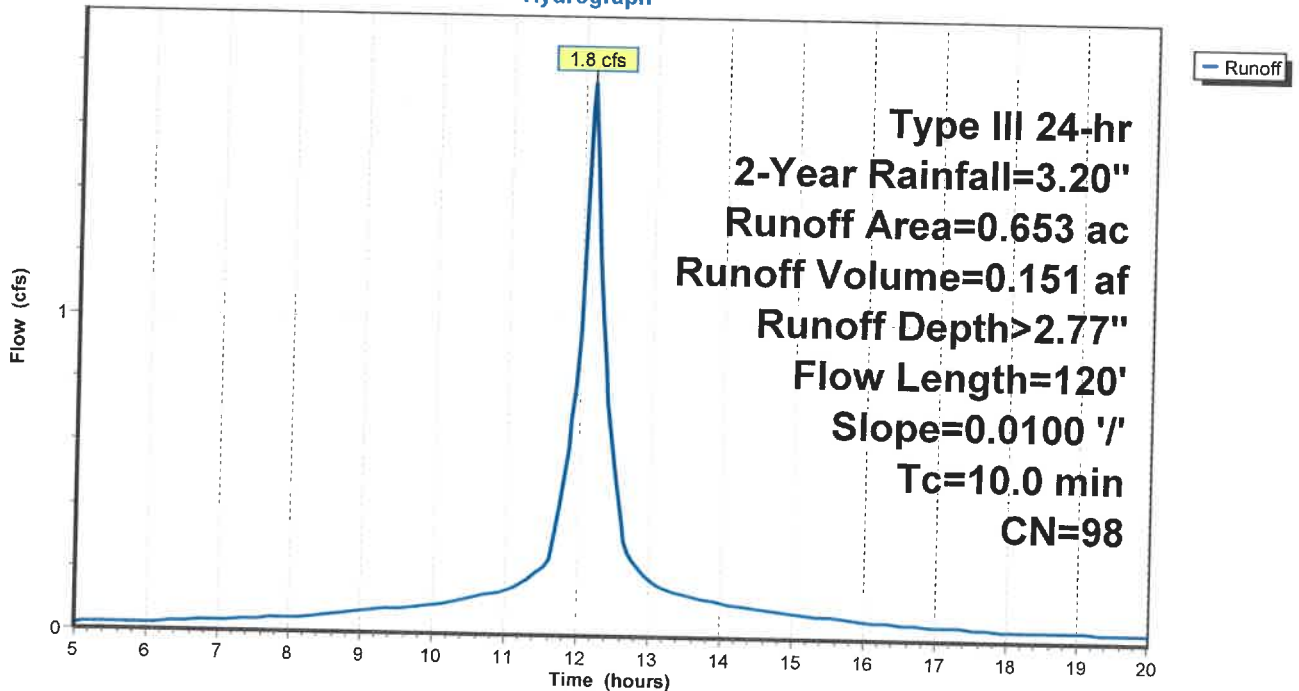

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive
Type III 24-hr 2-Year Rainfall=3.20"

Printed 6/14/2023

Page 31

Summary for Subcatchment 3S: Subarea PC


Runoff = 0.5 cfs @ 12.15 hrs, Volume= 0.038 af, Depth> 1.11"
Routed to Reach 6R : Southern Property Line

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.20"

Area (ac)	CN	Description
0.054	65	Woods/grass comb., Fair, HSG B
0.081	80	>75% Grass cover, Good, HSG D
0.278	79	Woods, Fair, HSG D
0.413	77	Weighted Average
0.413		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	14	0.2000	0.29		Sheet Flow, Grass: Short n= 0.150 P2= 3.20"
1.0	36	0.0600	0.61		Shallow Concentrated Flow, Forest w/Heavy Litter Kv= 2.5 fps
1.8	50	Total, Increased to minimum Tc = 10.0 min			

Subcatchment 3S: Subarea PC

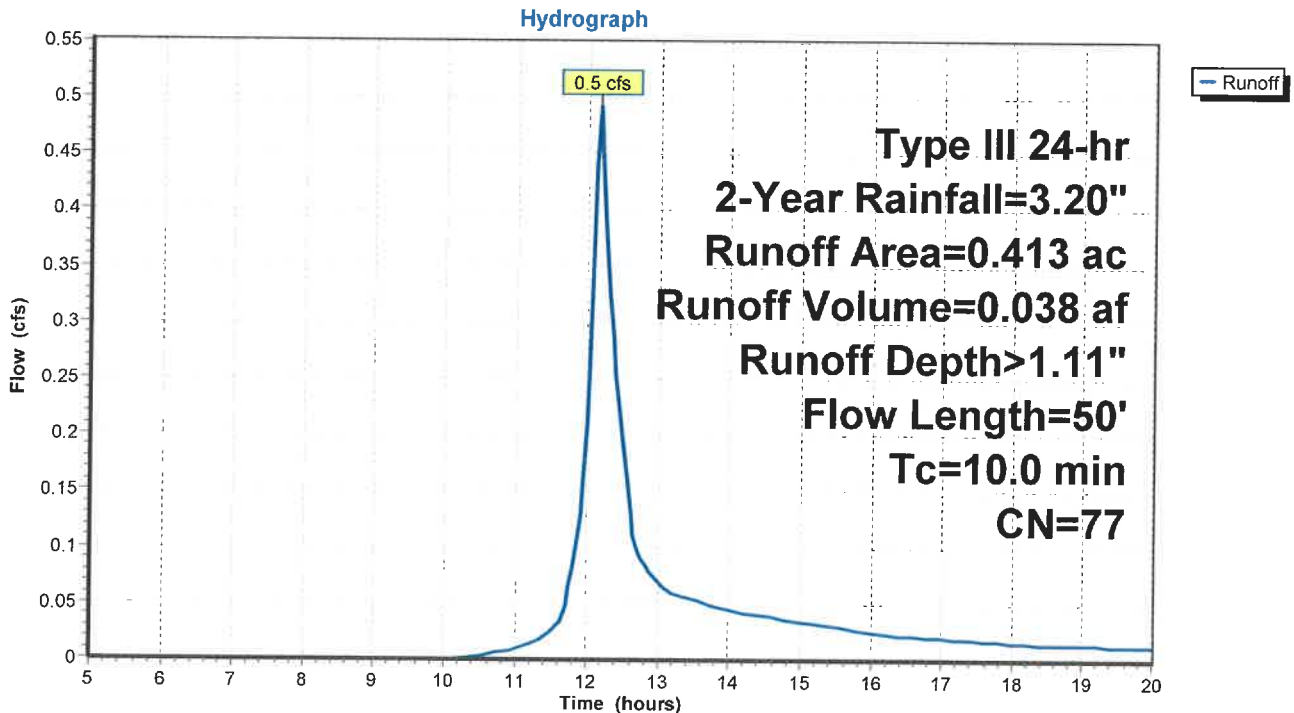

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive
Type III 24-hr 2-Year Rainfall=3.20"

Printed 6/14/2023

Page 32


Summary for Reach 4R: Perry Drive

Inflow Area = 1.167 ac, 84.06% Impervious, Inflow Depth > 2.40" for 2-Year event
Inflow = 2.9 cfs @ 12.14 hrs, Volume= 0.234 af
Outflow = 2.9 cfs @ 12.14 hrs, Volume= 0.234 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Reach 4R: Perry Drive

Hydrograph

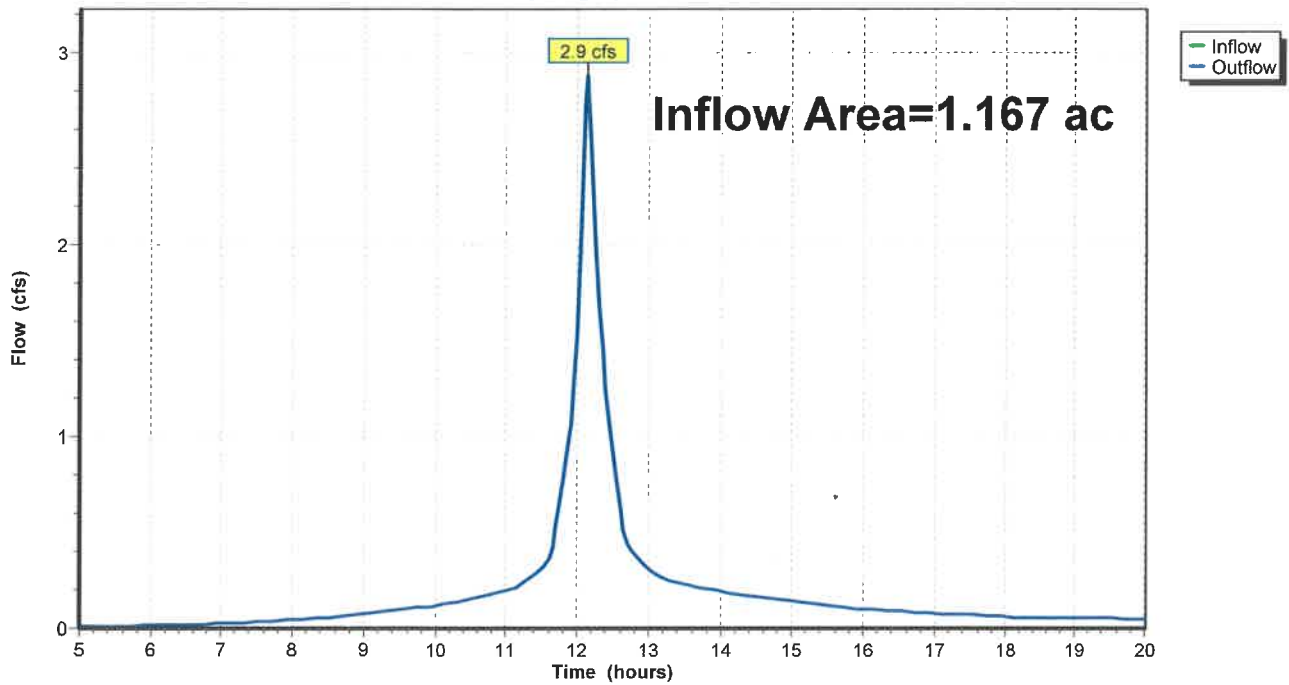

21-0102 Proposed

Prepared by Bay Colony Group


Summary for Reach 6R: Southern Property Line

Inflow Area = 1.066 ac, 61.26% Impervious, Inflow Depth > 0.43" for 2-Year event
Inflow = 0.5 cfs @ 12.15 hrs, Volume= 0.038 af
Outflow = 0.5 cfs @ 12.15 hrs, Volume= 0.038 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Reach 6R: Southern Property Line

Hydrograph

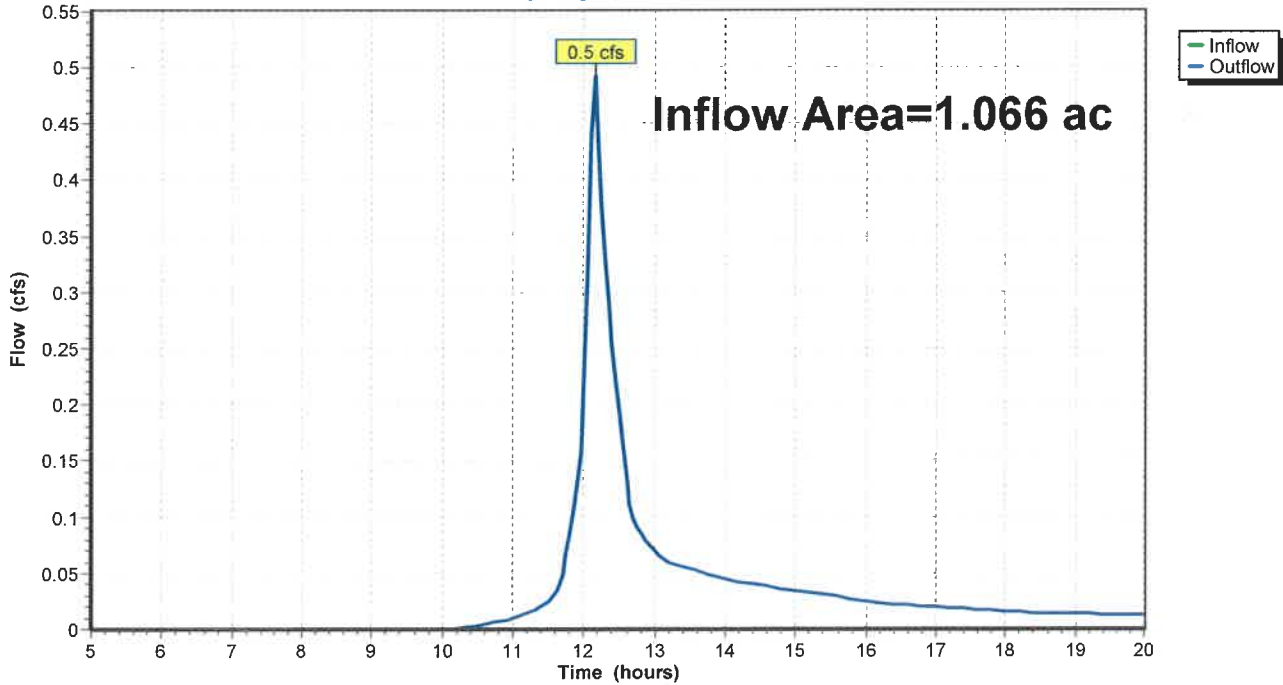

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive
Type III 24-hr 2-Year Rainfall=3.20"

Printed 6/14/2023

Page 34

Summary for Pond 5P: Subsurface basin

Inflow Area = 0.653 ac, 100.00% Impervious, Inflow Depth > 2.77" for 2-Year event
 Inflow = 1.8 cfs @ 12.14 hrs, Volume= 0.151 af
 Outflow = 0.2 cfs @ 12.88 hrs, Volume= 0.151 af, Atten= 88%, Lag= 44.6 min
 Discarded = 0.2 cfs @ 12.88 hrs, Volume= 0.151 af
 Primary = 0.0 cfs @ 5.00 hrs, Volume= 0.000 af
 Routed to Reach 6R : Southern Property Line

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs / 2
 Peak Elev= 261.53' @ 12.88 hrs Surf.Area= 0.148 ac Storage= 0.057 af

Plug-Flow detention time= 97.9 min calculated for 0.150 af (99% of inflow)
 Center-of-Mass det. time= 96.5 min (838.1 - 741.6)

Volume	Invert	Avail.Storage	Storage Description
#1A	260.80'	0.079 af	64.00'W x 100.50'L x 1.71'H Field A 0.252 af Overall - 0.055 af Embedded = 0.197 af x 40.0% Voids
#2A	261.30'	0.055 af	Cultec FD C-4 x 180 Inside #1 Effective Size= 42.0"W x 8.0"H => 1.67 sf x 8.00'L = 13.3 cf Overall Size= 48.0"W x 8.5"H x 8.50'L with 0.50' Overlap Row Length Adjustment= +0.50' x 1.67 sf x 15 rows
#3	262.50'	0.000 af	2.00'D x 0.95'H Vertical Cone/Cylinder
		0.134 af	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	260.80'	1.020 in/hr Exfiltration over Surface area Conductivity to Groundwater Elevation = 258.80'
#2	Primary	262.50'	12.0" Round CMP_Round 12" L= 15.0' CPP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 262.50' / 262.00' S= 0.0333 '/ Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.79 sf

Discarded OutFlow Max=0.2 cfs @ 12.88 hrs HW=261.53' (Free Discharge)
 ↗1=Exfiltration (Controls 0.2 cfs)

Primary OutFlow Max=0.0 cfs @ 5.00 hrs HW=260.80' (Free Discharge)
 ↗2=CMP_Round 12" (Controls 0.0 cfs)

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive
Type III 24-hr 2-Year Rainfall=3.20"

Printed 6/14/2023

Page 35

Pond 5P: Subsurface basin - Chamber Wizard Field A

Chamber Model = Cultec FD C-4 (Cultec Contactor® Field Drain C-4)

Effective Size= 42.0"W x 8.0"H => 1.67 sf x 8.00'L = 13.3 cf

Overall Size= 48.0"W x 8.5"H x 8.50'L with 0.50' Overlap

Row Length Adjustment= +0.50' x 1.67 sf x 15 rows

12 Chambers/Row x 8.00' Long +0.50' Row Adjustment = 96.50' Row Length +24.0" End Stone x 2 = 100.50' Base Length

15 Rows x 48.0" Wide + 24.0" Side Stone x 2 = 64.00' Base Width

6.0" Stone Base + 8.5" Chamber Height + 6.0" Stone Cover = 1.71' Field Height

180 Chambers x 13.3 cf +0.50' Row Adjustment x 1.67 sf x 15 Rows = 2,411.5 cf Chamber Storage

10,988.0 cf Field - 2,411.5 cf Chambers = 8,576.5 cf Stone x 40.0% Voids = 3,430.6 cf Stone Storage

Chamber Storage + Stone Storage = 5,842.1 cf = 0.134 af


Overall Storage Efficiency = 53.2%

Overall System Size = 100.50' x 64.00' x 1.71'

180 Chambers

407.0 cy Field

317.6 cy Stone

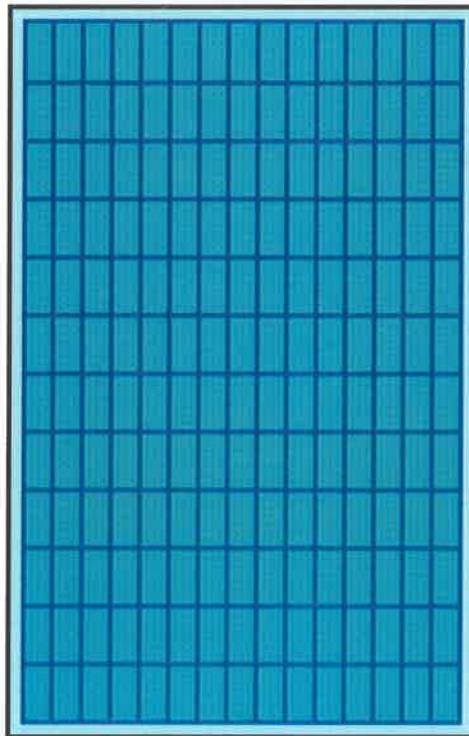

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC


7 Perry Drive
Type III 24-hr 2-Year Rainfall=3.20"

Printed 6/14/2023

Page 36

Pond 5P: Subsurface basin

Hydrograph

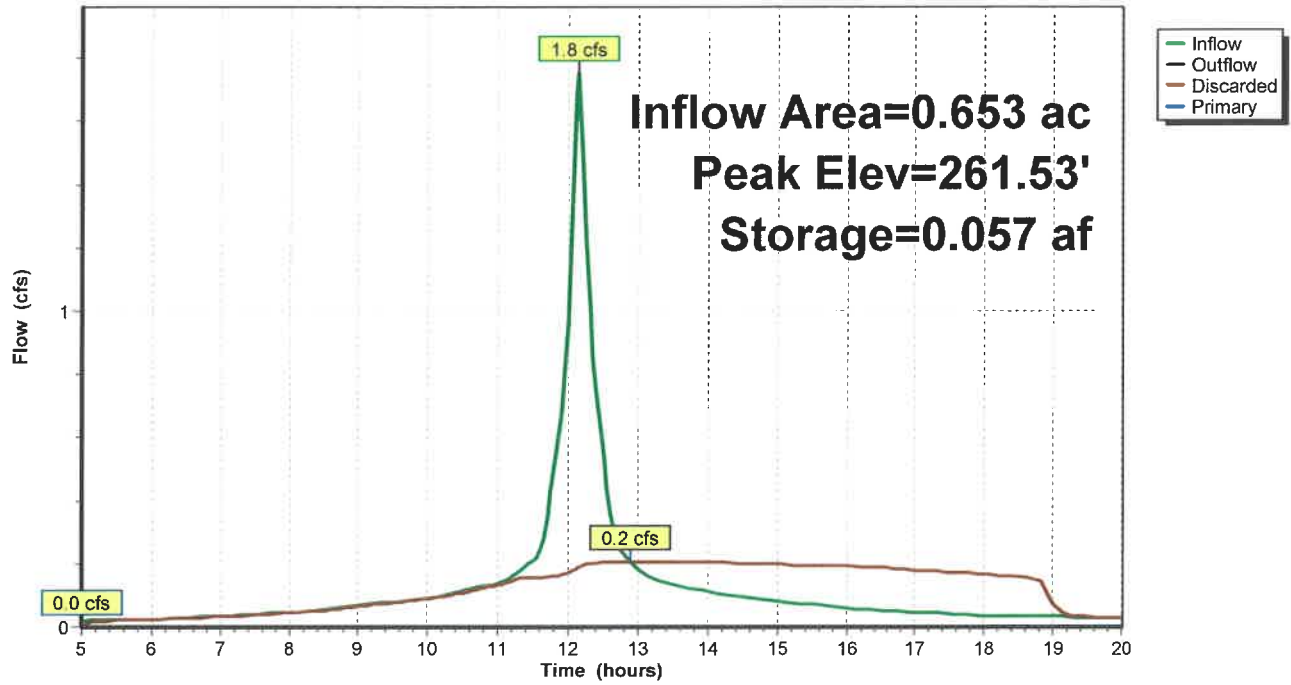

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive
Type III 24-hr 10-Year Rainfall=4.70"

Printed 6/14/2023

Page 37

Time span=5.00-20.00 hrs, dt=0.05 hrs, 301 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: Subarea PA Runoff Area=1.167 ac 84.06% Impervious Runoff Depth>3.78"
Flow Length=318' Tc=10.0 min CN=94 Runoff=4.4 cfs 0.368 af

Subcatchment 2S: Subarea PB Runoff Area=0.653 ac 100.00% Impervious Runoff Depth>4.14"
Flow Length=120' Slope=0.0100 '/' Tc=10.0 min CN=98 Runoff=2.6 cfs 0.226 af

Subcatchment 3S: Subarea PC Runoff Area=0.413 ac 0.00% Impervious Runoff Depth>2.20"
Flow Length=50' Tc=10.0 min CN=77 Runoff=1.0 cfs 0.076 af

Reach 4R: Perry Drive Inflow=4.4 cfs 0.368 af
Outflow=4.4 cfs 0.368 af

Reach 6R: Southern Property Line Inflow=1.0 cfs 0.076 af
Outflow=1.0 cfs 0.076 af

Pond 5P: Subsurface basin Peak Elev=261.90' Storage=0.098 af Inflow=2.6 cfs 0.226 af
Discarded=0.2 cfs 0.197 af Primary=0.0 cfs 0.000 af Outflow=0.2 cfs 0.197 af

Total Runoff Area = 2.233 ac Runoff Volume = 0.669 af Average Runoff Depth = 3.60"
26.82% Pervious = 0.599 ac 73.18% Impervious = 1.634 ac

21-0102 Proposed

Type III 24-hr 10-Year Rainfall=4.70"

Prepared by Bay Colony Group

Printed 6/14/2023

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

Page 38

Summary for Subcatchment 1S: Subarea PA

Runoff = 4.4 cfs @ 12.14 hrs, Volume= 0.368 af, Depth> 3.78"
 Routed to Reach 4R : Perry Drive

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10-Year Rainfall=4.70"

Area (ac)	CN	Description
0.015	73	Woods, Fair, HSG C
0.002	79	Woods, Fair, HSG D
0.025	98	Paved parking, HSG B
0.383	98	Paved parking, HSG C
0.024	98	Paved parking, HSG D
0.064	65	Woods/grass comb., Fair, HSG B
0.100	74	>75% Grass cover, Good, HSG C
0.005	80	>75% Grass cover, Good, HSG D
0.212	98	Unconnected roofs, HSG B
0.337	98	Unconnected roofs, HSG C
1.167	94	Weighted Average
0.186		15.94% Pervious Area
0.981		84.06% Impervious Area
0.549		55.96% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	50	0.0200	1.20		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.20"
1.7	268	0.0160	2.57		Shallow Concentrated Flow, Paved Kv= 20.3 fps
2.4	318	Total, Increased to minimum Tc = 10.0 min			

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC


7 Perry Drive
Type III 24-hr 10-Year Rainfall=4.70"

Printed 6/14/2023

Page 39

Subcatchment 1S: Subarea PA

Hydrograph

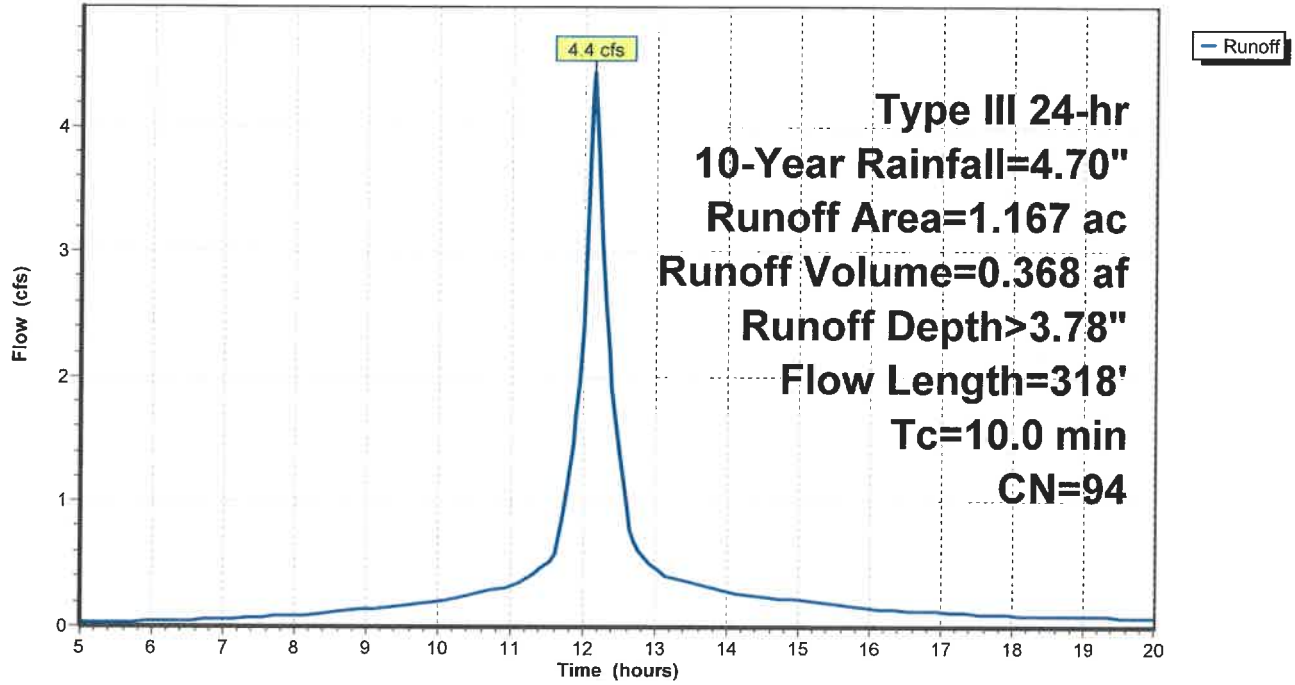

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive
Type III 24-hr 10-Year Rainfall=4.70"

Printed 6/14/2023

Page 40

Summary for Subcatchment 2S: Subarea PB

Runoff = 2.6 cfs @ 12.14 hrs, Volume= 0.226 af, Depth> 4.14"
Routed to Pond 5P : Subsurface basin


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
Type III 24-hr 10-Year Rainfall=4.70"

Area (ac)	CN	Description
0.136	98	Roofs, HSG B
0.005	98	Roofs, HSG C
0.138	98	Roofs, HSG D
0.374	98	Paved parking, HSG D
0.653	98	Weighted Average
0.653		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.9	50	0.0100	0.91		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.20"
0.6	70	0.0100	2.03		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.5	120	Total	Increased to minimum Tc = 10.0 min		

Subcatchment 2S: Subarea PB

Hydrograph

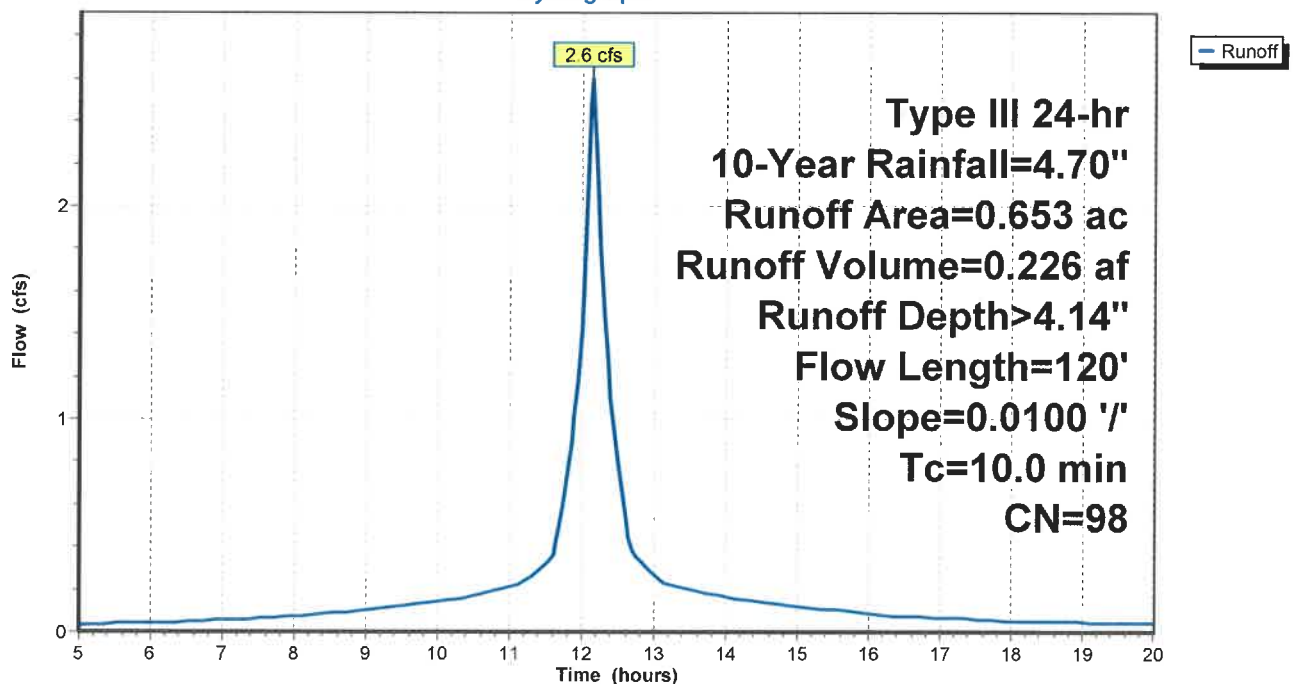

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

Type III 24-hr 10-Year Rainfall=4.70"

Printed 6/14/2023

Page 41

Summary for Subcatchment 3S: Subarea PC


Runoff = 1.0 cfs @ 12.15 hrs, Volume= 0.076 af, Depth> 2.20"
 Routed to Reach 6R : Southern Property Line

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10-Year Rainfall=4.70"

Area (ac)	CN	Description
0.054	65	Woods/grass comb., Fair, HSG B
0.081	80	>75% Grass cover, Good, HSG D
0.278	79	Woods, Fair, HSG D
0.413	77	Weighted Average
0.413		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	14	0.2000	0.29		Sheet Flow, Grass: Short n= 0.150 P2= 3.20"
1.0	36	0.0600	0.61		Shallow Concentrated Flow, Forest w/Heavy Litter Kv= 2.5 fps
1.8	50	Total, Increased to minimum Tc = 10.0 min			

Subcatchment 3S: Subarea PC

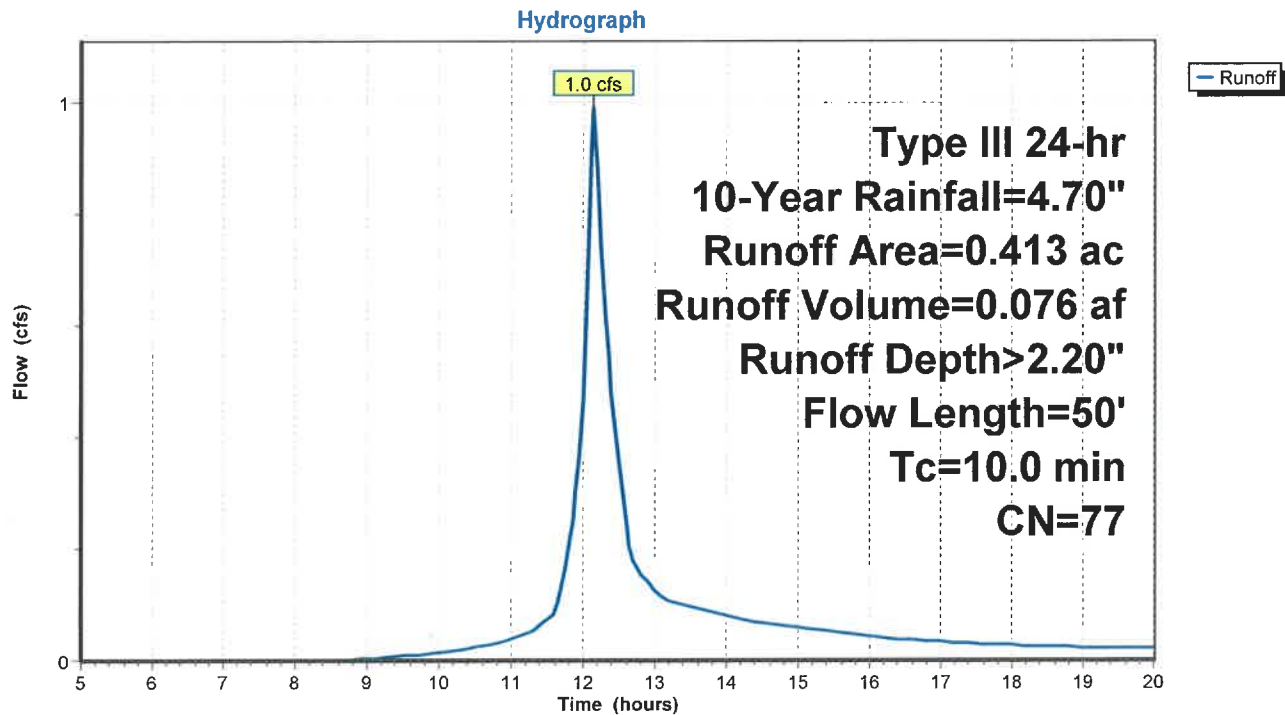

21-0102 Proposed

Prepared by Bay Colony Group

Printed 6/14/2023

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

Page 42


Summary for Reach 4R: Perry Drive

Inflow Area = 1.167 ac, 84.06% Impervious, Inflow Depth > 3.78" for 10-Year event
Inflow = 4.4 cfs @ 12.14 hrs, Volume= 0.368 af
Outflow = 4.4 cfs @ 12.14 hrs, Volume= 0.368 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Reach 4R: Perry Drive

Hydrograph

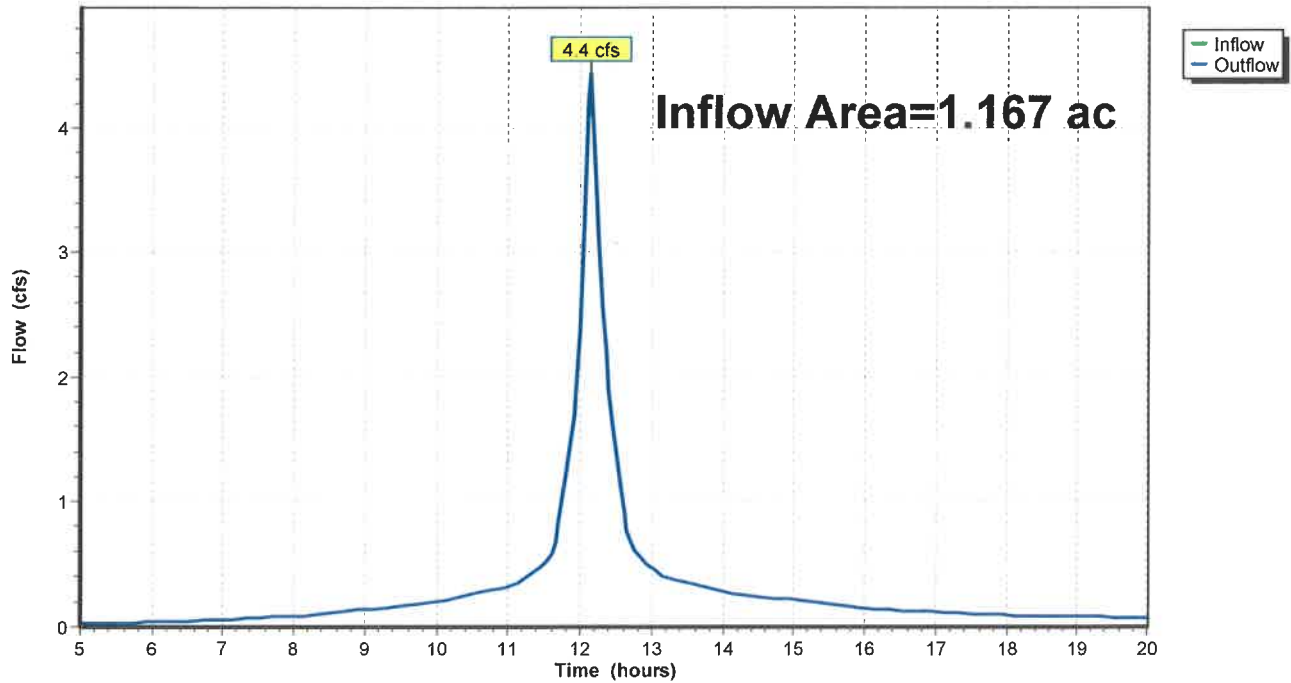

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive
Type III 24-hr 10-Year Rainfall=4.70"

Printed 6/14/2023

Page 43


Summary for Reach 6R: Southern Property Line

Inflow Area = 1.066 ac, 61.26% Impervious, Inflow Depth > 0.85" for 10-Year event
Inflow = 1.0 cfs @ 12.15 hrs, Volume= 0.076 af
Outflow = 1.0 cfs @ 12.15 hrs, Volume= 0.076 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Reach 6R: Southern Property Line

Hydrograph

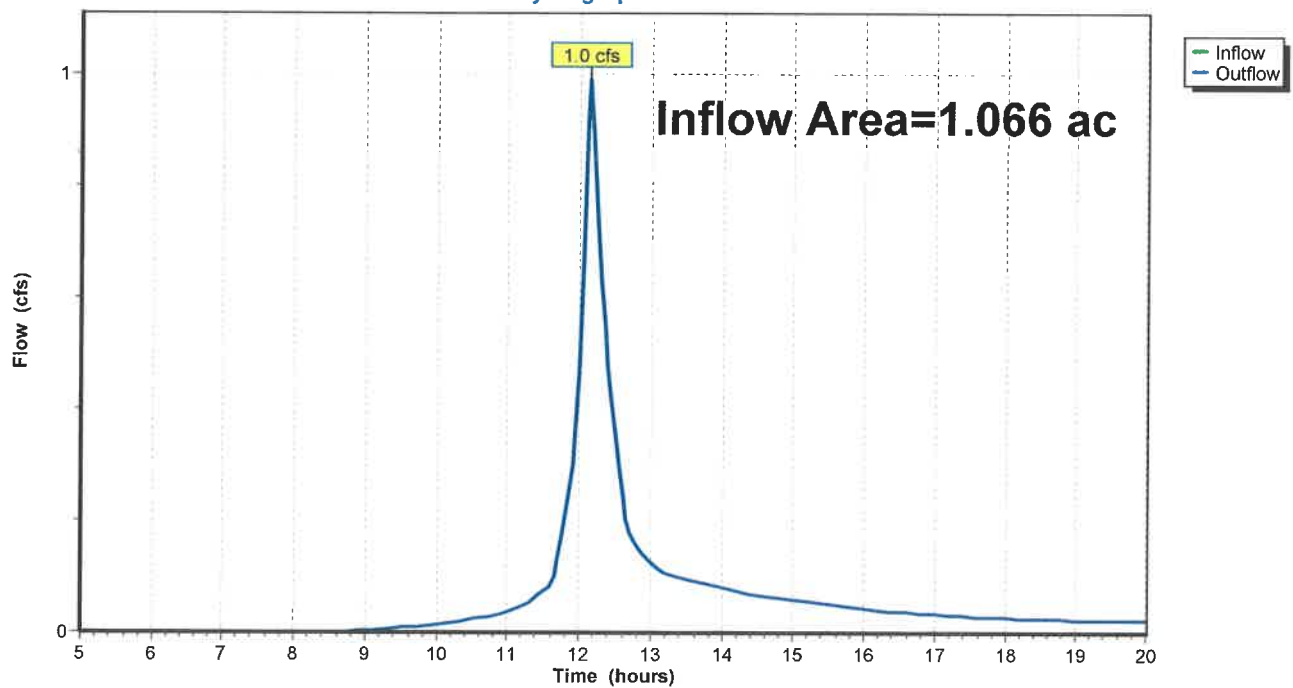

21-0102 Proposed

Prepared by Bay Colony Group

Printed 6/14/2023

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

Page 44

Summary for Pond 5P: Subsurface basin

Inflow Area = 0.653 ac, 100.00% Impervious, Inflow Depth > 4.14" for 10-Year event
 Inflow = 2.6 cfs @ 12.14 hrs, Volume= 0.226 af
 Outflow = 0.2 cfs @ 13.13 hrs, Volume= 0.197 af, Atten= 91%, Lag= 59.8 min
 Discarded = 0.2 cfs @ 13.13 hrs, Volume= 0.197 af
 Primary = 0.0 cfs @ 5.00 hrs, Volume= 0.000 af
 Routed to Reach 6R : Southern Property Line

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs / 2
 Peak Elev= 261.90' @ 13.13 hrs Surf.Area= 0.148 ac Storage= 0.098 af

Plug-Flow detention time= 149.8 min calculated for 0.197 af (87% of inflow)
 Center-of-Mass det. time= 110.2 min (848.6 - 738.4)

Volume	Invert	Avail.Storage	Storage Description
#1A	260.80'	0.079 af	64.00'W x 100.50'L x 1.71'H Field A 0.252 af Overall - 0.055 af Embedded = 0.197 af x 40.0% Voids
#2A	261.30'	0.055 af	Cultec FD C-4 x 180 Inside #1 Effective Size= 42.0"W x 8.0"H => 1.67 sf x 8.00'L = 13.3 cf Overall Size= 48.0"W x 8.5"H x 8.50'L with 0.50' Overlap Row Length Adjustment= +0.50' x 1.67 sf x 15 rows
#3	262.50'	0.000 af	2.00'D x 0.95'H Vertical Cone/Cylinder
		0.134 af	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	260.80'	1.020 in/hr Exfiltration over Surface area Conductivity to Groundwater Elevation = 258.80'
#2	Primary	262.50'	12.0" Round CMP_Round 12" L= 15.0' CPP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 262.50' / 262.00' S= 0.0333 '/' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.79 sf

Discarded OutFlow Max=0.2 cfs @ 13.13 hrs HW=261.90' (Free Discharge)
 ↑1=Exfiltration (Controls 0.2 cfs)

Primary OutFlow Max=0.0 cfs @ 5.00 hrs HW=260.80' (Free Discharge)
 ↑2=CMP_Round 12" (Controls 0.0 cfs)

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

Pond 5P: Subsurface basin - Chamber Wizard Field A

Chamber Model = Cultec FD C-4 (Cultec Contactor® Field Drain C-4)

Effective Size= 42.0"W x 8.0"H => 1.67 sf x 8.00'L = 13.3 cf

Overall Size= 48.0"W x 8.5"H x 8.50'L with 0.50' Overlap

Row Length Adjustment= +0.50' x 1.67 sf x 15 rows

12 Chambers/Row x 8.00' Long +0.50' Row Adjustment = 96.50' Row Length +24.0" End Stone x 2 = 100.50' Base Length

15 Rows x 48.0" Wide + 24.0" Side Stone x 2 = 64.00' Base Width

6.0" Stone Base + 8.5" Chamber Height + 6.0" Stone Cover = 1.71' Field Height

180 Chambers x 13.3 cf +0.50' Row Adjustment x 1.67 sf x 15 Rows = 2,411.5 cf Chamber Storage

10,988.0 cf Field - 2,411.5 cf Chambers = 8,576.5 cf Stone x 40.0% Voids = 3,430.6 cf Stone Storage

Chamber Storage + Stone Storage = 5,842.1 cf = 0.134 af


Overall Storage Efficiency = 53.2%

Overall System Size = 100.50' x 64.00' x 1.71'

180 Chambers

407.0 cy Field

317.6 cy Stone

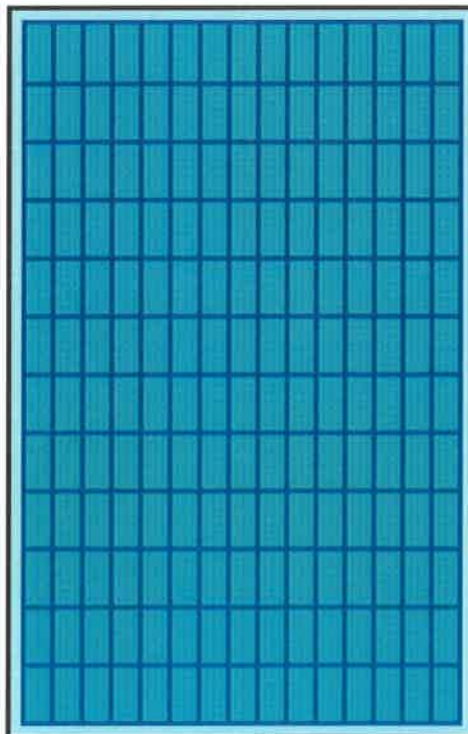

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC


7 Perry Drive
Type III 24-hr 10-Year Rainfall=4.70"

Printed 6/14/2023

Page 46

Pond 5P: Subsurface basin

Hydrograph

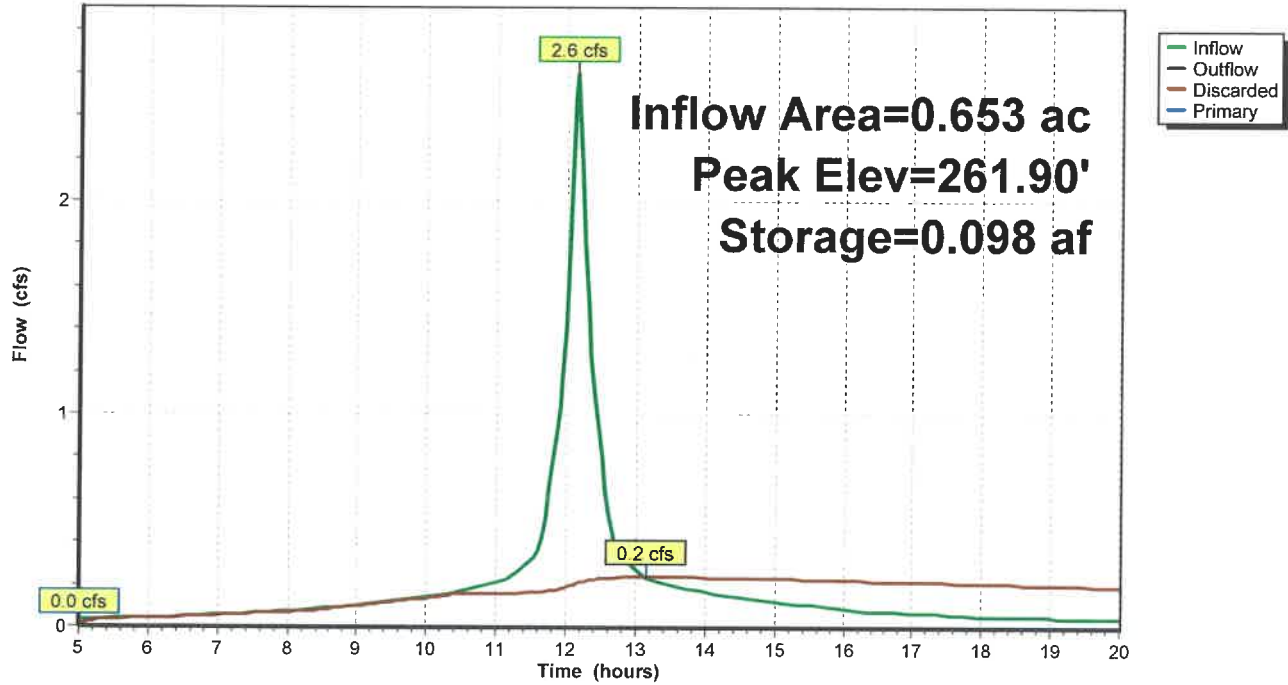

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive
Type III 24-hr 100-Year Rainfall=6.70"

Printed 6/14/2023

Page 47

Time span=5.00-20.00 hrs, dt=0.05 hrs, 301 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: Subarea PA Runoff Area=1.167 ac 84.06% Impervious Runoff Depth>5.63"
Flow Length=318' Tc=10.0 min CN=94 Runoff=6.5 cfs 0.548 af

Subcatchment 2S: Subarea PB Runoff Area=0.653 ac 100.00% Impervious Runoff Depth>5.96"
Flow Length=120' Slope=0.0100 '/' Tc=10.0 min CN=98 Runoff=3.7 cfs 0.325 af

Subcatchment 3S: Subarea PC Runoff Area=0.413 ac 0.00% Impervious Runoff Depth>3.83"
Flow Length=50' Tc=10.0 min CN=77 Runoff=1.7 cfs 0.132 af

Reach 4R: Perry Drive Inflow=6.5 cfs 0.548 af
Outflow=6.5 cfs 0.548 af

Reach 6R: Southern Property Line Inflow=1.7 cfs 0.138 af
Outflow=1.7 cfs 0.138 af

Pond 5P: Subsurface basin Peak Elev=262.93' Storage=0.134 af Inflow=3.7 cfs 0.325 af
Discarded=0.3 cfs 0.237 af Primary=0.6 cfs 0.007 af Outflow=0.9 cfs 0.243 af

Total Runoff Area = 2.233 ac Runoff Volume = 1.004 af Average Runoff Depth = 5.40"
26.82% Pervious = 0.599 ac 73.18% Impervious = 1.634 ac

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive

Type III 24-hr 100-Year Rainfall=6.70"

Printed 6/14/2023

Page 48

Summary for Subcatchment 1S: Subarea PA

Runoff = 6.5 cfs @ 12.14 hrs, Volume= 0.548 af, Depth> 5.63"
 Routed to Reach 4R : Perry Drive

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100-Year Rainfall=6.70"

Area (ac)	CN	Description
0.015	73	Woods, Fair, HSG C
0.002	79	Woods, Fair, HSG D
0.025	98	Paved parking, HSG B
0.383	98	Paved parking, HSG C
0.024	98	Paved parking, HSG D
0.064	65	Woods/grass comb., Fair, HSG B
0.100	74	>75% Grass cover, Good, HSG C
0.005	80	>75% Grass cover, Good, HSG D
0.212	98	Unconnected roofs, HSG B
0.337	98	Unconnected roofs, HSG C
1.167	94	Weighted Average
0.186		15.94% Pervious Area
0.981		84.06% Impervious Area
0.549		55.96% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.7	50	0.0200	1.20		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.20"
1.7	268	0.0160	2.57		Shallow Concentrated Flow, Paved Kv= 20.3 fps
2.4	318	Total, Increased to minimum Tc = 10.0 min			

21-0102 Proposed

Prepared by Bay Colony Group


HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive
Type III 24-hr 100-Year Rainfall=6.70"

Printed 6/14/2023

Page 49

Subcatchment 1S: Subarea PA

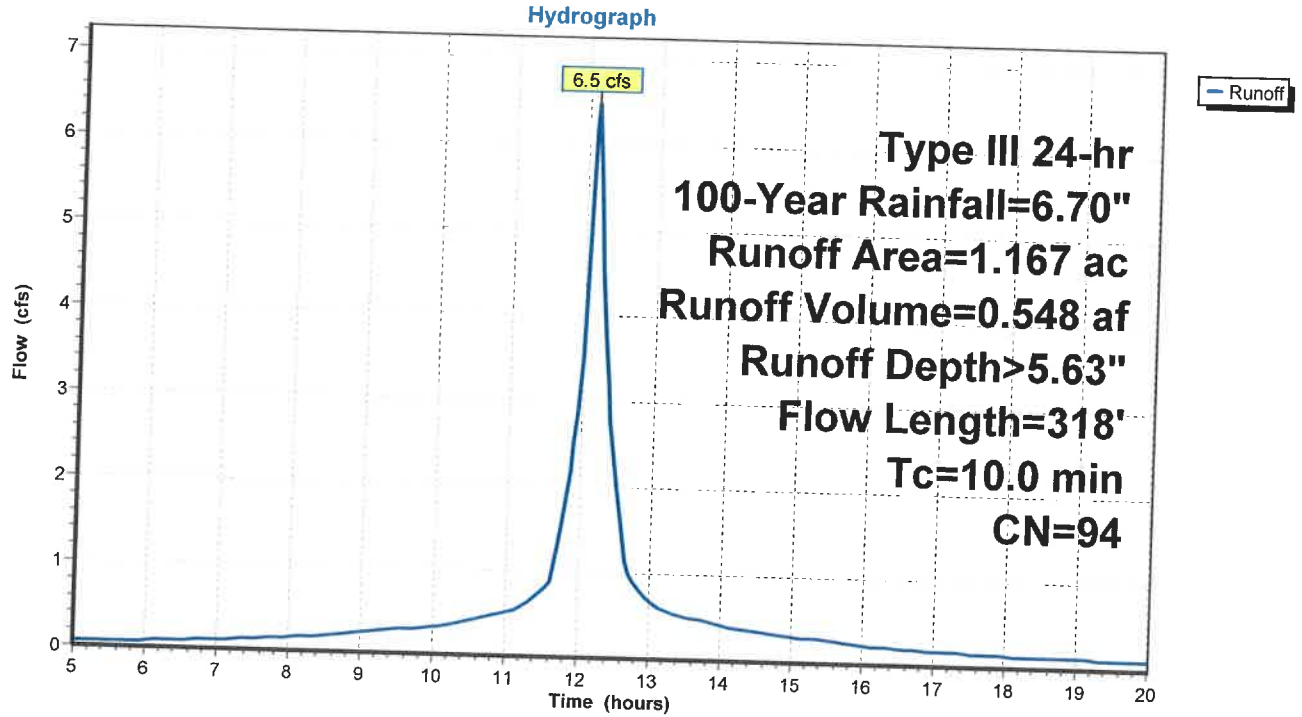

21-0102 Proposed

Prepared by Bay Colony Group

Summary for Subcatchment 2S: Subarea PB


Runoff = 3.7 cfs @ 12.14 hrs, Volume= 0.325 af, Depth> 5.96"
 Routed to Pond 5P : Subsurface basin

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100-Year Rainfall=6.70"

Area (ac)	CN	Description
0.136	98	Roofs, HSG B
0.005	98	Roofs, HSG C
0.138	98	Roofs, HSG D
0.374	98	Paved parking, HSG D
0.653	98	Weighted Average
0.653		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.9	50	0.0100	0.91		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.20"
0.6	70	0.0100	2.03		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.5	120	Total, Increased to minimum Tc = 10.0 min			

Subcatchment 2S: Subarea PB

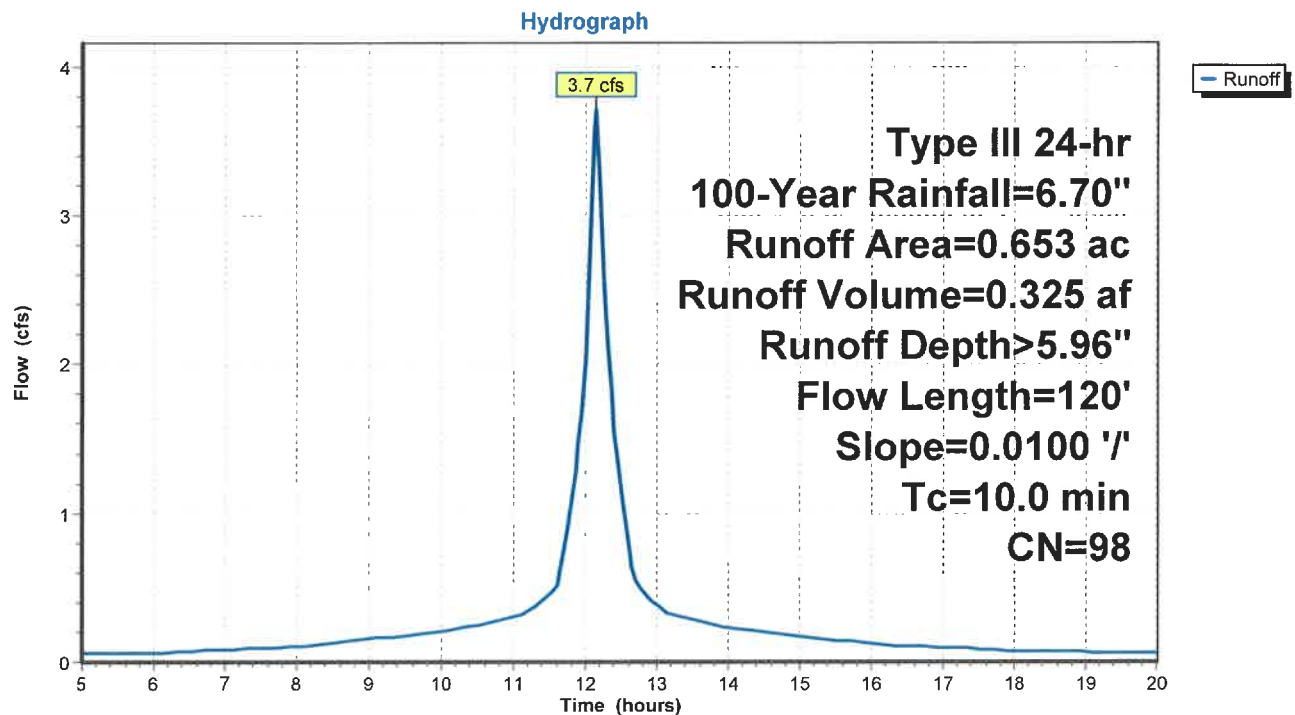

21-0102 Proposed

Type III 24-hr 100-Year Rainfall=6.70"

Prepared by Bay Colony Group

Printed 6/14/2023

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

Page 51

Summary for Subcatchment 3S: Subarea PC

Runoff = 1.7 cfs @ 12.14 hrs, Volume= 0.132 af, Depth> 3.83"
 Routed to Reach 6R : Southern Property Line


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100-Year Rainfall=6.70"

Area (ac)	CN	Description
0.054	65	Woods/grass comb., Fair, HSG B
0.081	80	>75% Grass cover, Good, HSG D
0.278	79	Woods, Fair, HSG D
0.413	77	Weighted Average
0.413		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	14	0.2000	0.29		Sheet Flow, Grass: Short n= 0.150 P2= 3.20"
1.0	36	0.0600	0.61		Shallow Concentrated Flow, Forest w/Heavy Litter Kv= 2.5 fps
1.8	50	Total, Increased to minimum Tc = 10.0 min			

Subcatchment 3S: Subarea PC

Hydrograph

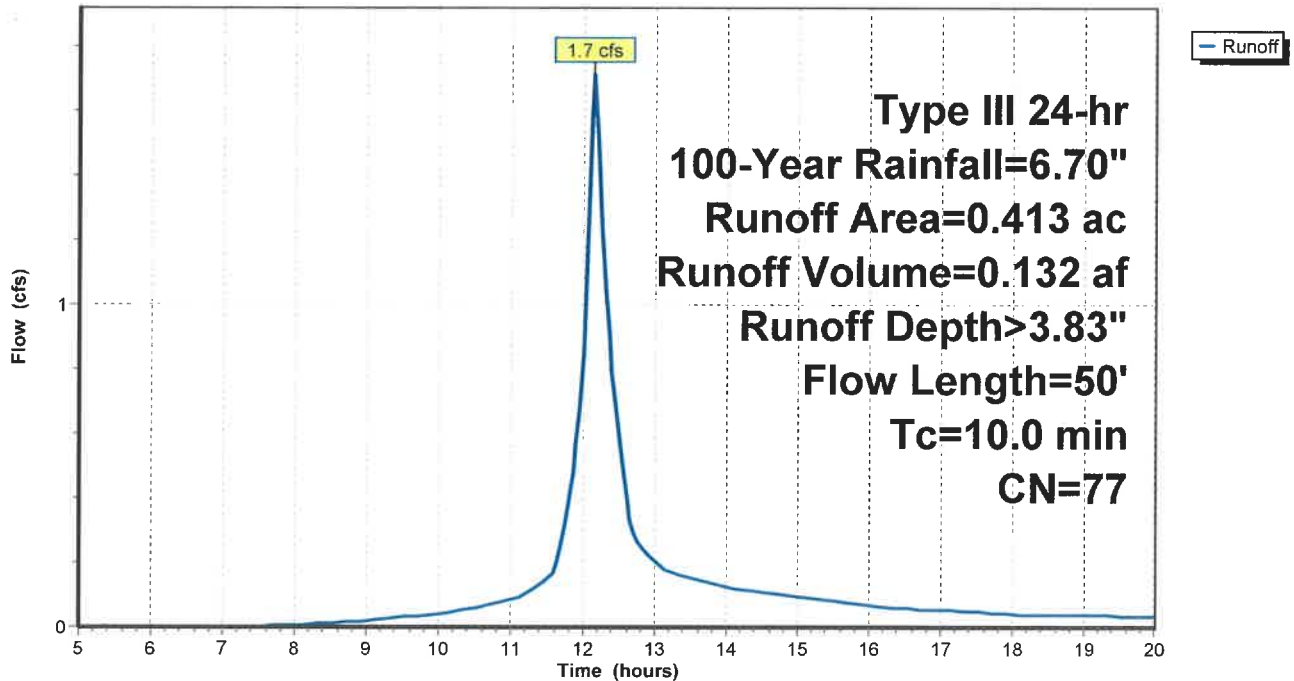

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive
Type III 24-hr 100-Year Rainfall=6.70"

Printed 6/14/2023

Page 52


Summary for Reach 4R: Perry Drive

Inflow Area = 1.167 ac, 84.06% Impervious, Inflow Depth > 5.63" for 100-Year event
Inflow = 6.5 cfs @ 12.14 hrs, Volume= 0.548 af
Outflow = 6.5 cfs @ 12.14 hrs, Volume= 0.548 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Reach 4R: Perry Drive

Hydrograph

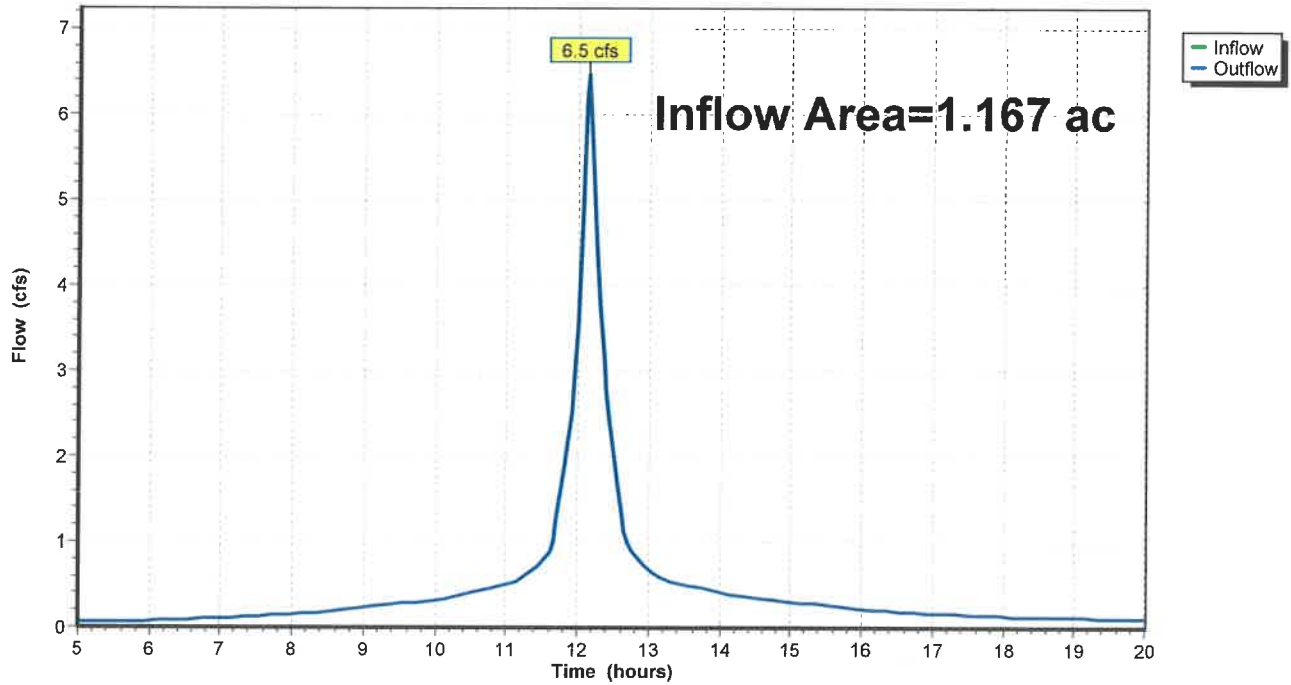

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive
Type III 24-hr 100-Year Rainfall=6.70"

Printed 6/14/2023


Page 53

Summary for Reach 6R: Southern Property Line

Inflow Area = 1.066 ac, 61.26% Impervious, Inflow Depth > 1.56" for 100-Year event
Inflow = 1.7 cfs @ 12.14 hrs, Volume= 0.138 af
Outflow = 1.7 cfs @ 12.14 hrs, Volume= 0.138 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

Reach 6R: Southern Property Line

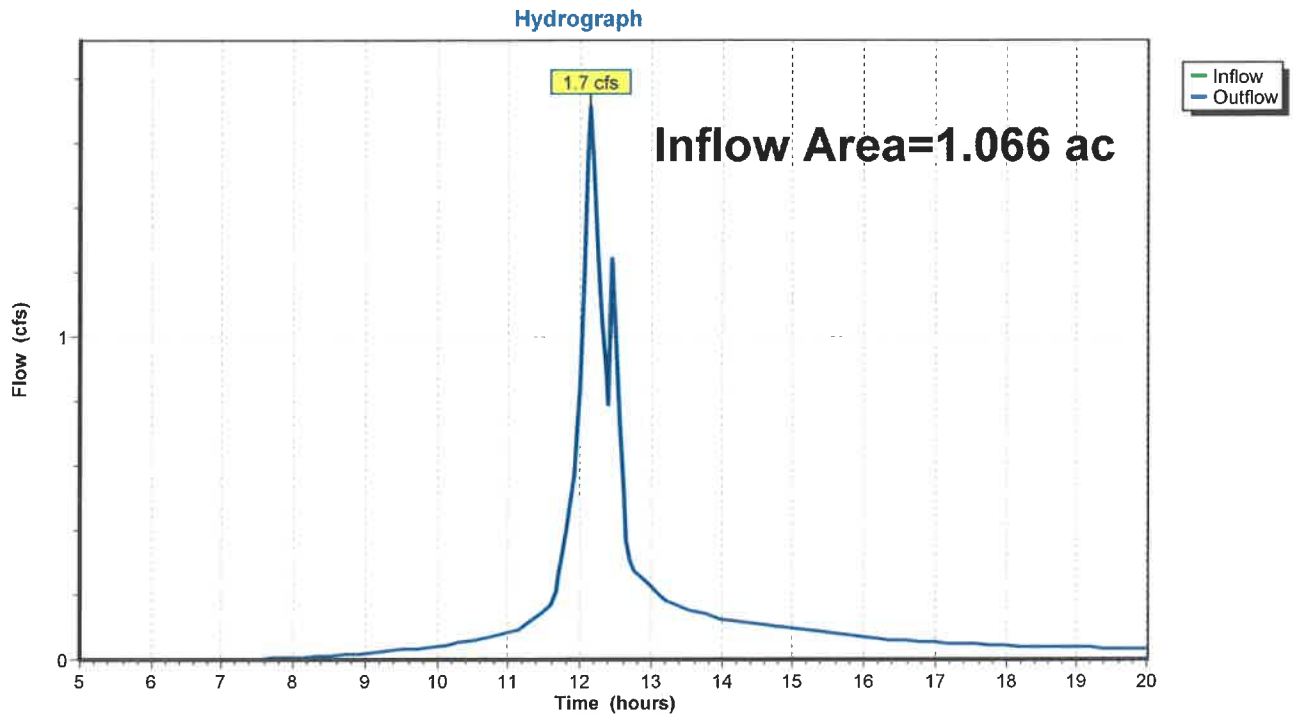

21-0102 Proposed

Prepared by Bay Colony Group

Printed 6/14/2023

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

Page 54

Summary for Pond 5P: Subsurface basin

Inflow Area = 0.653 ac, 100.00% Impervious, Inflow Depth > 5.96" for 100-Year event
 Inflow = 3.7 cfs @ 12.14 hrs, Volume= 0.325 af
 Outflow = 0.9 cfs @ 12.46 hrs, Volume= 0.243 af, Atten= 76%, Lag= 19.7 min
 Discarded = 0.3 cfs @ 12.47 hrs, Volume= 0.237 af
 Primary = 0.6 cfs @ 12.46 hrs, Volume= 0.007 af
 Routed to Reach 6R : Southern Property Line

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs / 2
 Peak Elev= 262.93' @ 12.47 hrs Surf.Area= 0.148 ac Storage= 0.134 af

Plug-Flow detention time= 159.1 min calculated for 0.243 af (75% of inflow)
 Center-of-Mass det. time= 96.9 min (833.5 - 736.6)

Volume	Invert	Avail.Storage	Storage Description
#1A	260.80'	0.079 af	64.00'W x 100.50'L x 1.71'H Field A 0.252 af Overall - 0.055 af Embedded = 0.197 af x 40.0% Voids
#2A	261.30'	0.055 af	Cultec FD C-4 x 180 Inside #1 Effective Size= 42.0"W x 8.0"H => 1.67 sf x 8.00'L = 13.3 cf Overall Size= 48.0"W x 8.5"H x 8.50'L with 0.50' Overlap Row Length Adjustment= +0.50' x 1.67 sf x 15 rows
#3	262.50'	0.000 af	2.00'D x 0.95'H Vertical Cone/Cylinder
		0.134 af	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	260.80'	1.020 in/hr Exfiltration over Surface area Conductivity to Groundwater Elevation = 258.80'
#2	Primary	262.50'	12.0" Round CMP_Round 12" L= 15.0' CPP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 262.50' / 262.00' S= 0.0333 '/' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 0.79 sf

Discarded OutFlow Max=0.3 cfs @ 12.47 hrs HW=262.88' (Free Discharge)
 ↑1=Exfiltration (Controls 0.3 cfs)

Primary OutFlow Max=0.5 cfs @ 12.46 hrs HW=262.88' (Free Discharge)
 ↑2=CMP_Round 12" (Inlet Controls 0.5 cfs @ 1.86 fps)

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC

7 Perry Drive
Type III 24-hr 100-Year Rainfall=6.70"

Printed 6/14/2023

Page 55

Pond 5P: Subsurface basin - Chamber Wizard Field A

Chamber Model = Cultec FD C-4 (Cultec Contactor® Field Drain C-4)

Effective Size= 42.0"W x 8.0"H => 1.67 sf x 8.00'L = 13.3 cf

Overall Size= 48.0"W x 8.5"H x 8.50'L with 0.50' Overlap

Row Length Adjustment= +0.50' x 1.67 sf x 15 rows

12 Chambers/Row x 8.00' Long +0.50' Row Adjustment = 96.50' Row Length +24.0" End Stone x 2 = 100.50' Base Length

15 Rows x 48.0" Wide + 24.0" Side Stone x 2 = 64.00' Base Width

6.0" Stone Base + 8.5" Chamber Height + 6.0" Stone Cover = 1.71' Field Height

180 Chambers x 13.3 cf +0.50' Row Adjustment x 1.67 sf x 15 Rows = 2,411.5 cf Chamber Storage

10,988.0 cf Field - 2,411.5 cf Chambers = 8,576.5 cf Stone x 40.0% Voids = 3,430.6 cf Stone Storage

Chamber Storage + Stone Storage = 5,842.1 cf = 0.134 af


Overall Storage Efficiency = 53.2%

Overall System Size = 100.50' x 64.00' x 1.71'

180 Chambers

407.0 cy Field

317.6 cy Stone

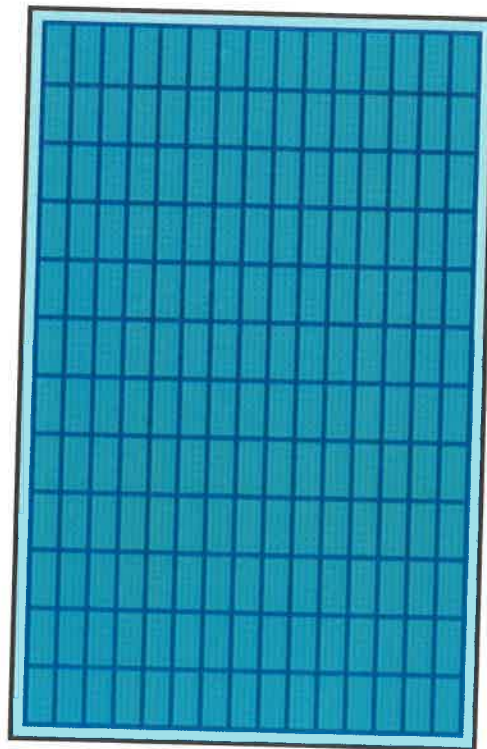

21-0102 Proposed

Prepared by Bay Colony Group

HydroCAD® 10.10-6a s/n 07093 © 2020 HydroCAD Software Solutions LLC


7 Perry Drive
Type III 24-hr 100-Year Rainfall=6.70"

Printed 6/14/2023

Page 56

Pond 5P: Subsurface basin

Hydrograph

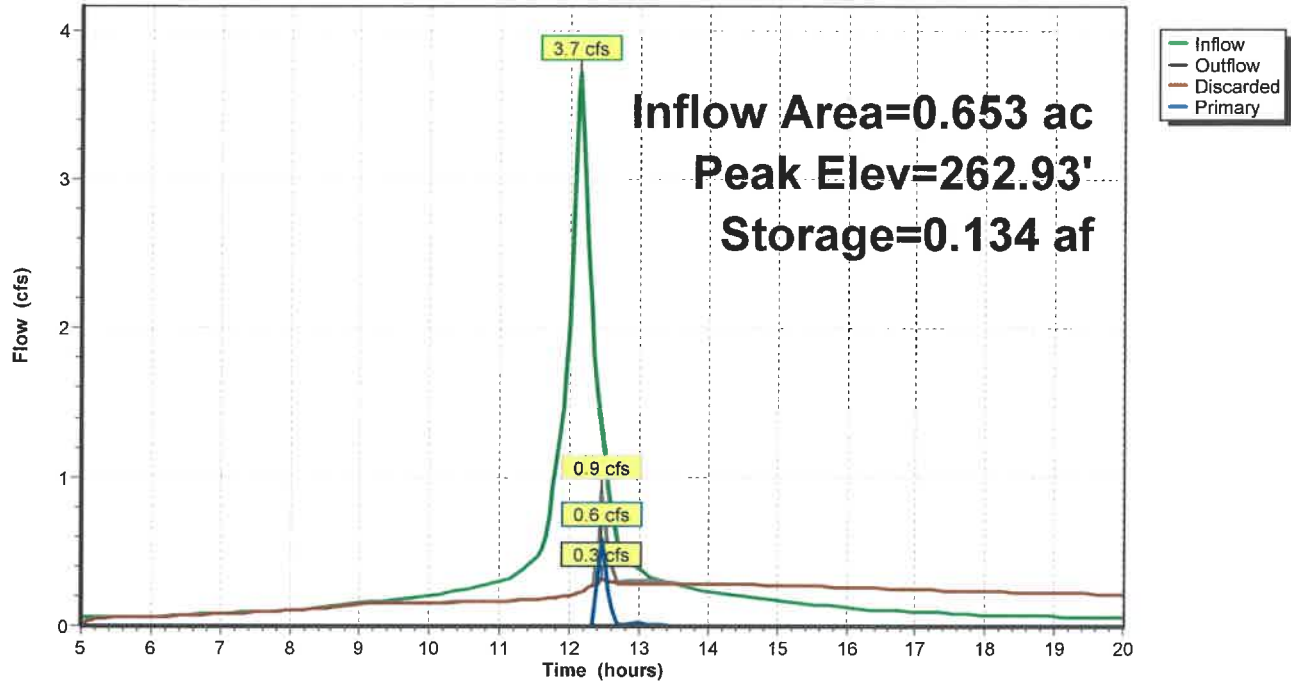

APPENDIX B – STORM WATER WORKSHEETS

Required Recharge Volume and Drawdown Worksheet
TSS Removal Worksheet
Checklist for Stormwater Report
Ground Water Mounding Summary Worksheet

Required Recharge Volume Worksheet

PROJECT LOCATION: 7 Perry Drive Foxborough, MA
DATE: 14-Jun-23
PROJECT NUMBER: 21-0102

Proposed Impervious Area

<i>SCS Soil Type Hydrologic Group</i>	<i>Target Depth Factor (in)</i>	<i>Total Impervious Area (ac)</i>	<i>Required Volume to Recharge (ac-ft)</i>
HSG B - Pavement & Roofs	0.35	0.136	0.0040
HSG C - Pavement & Roofs	0.25	0.093	0.0019
HSG D - Pavement & Roofs	0.10	0.537	0.0045
TOTAL:			0.0104

SITE TOTAL Rv: 0.0104

Capture Area Adjustment

Proposed impervious coverage (ac)	0.766
Site area draining to recharge facilities (ac)	0.653
Ratio of total site area to site area draining	1.173

Adjusted Total Rv: 0.0122

Subsurface Basin

Volume Recharged

Volume of pond between bottom and outlet (el=262.5)	0.134 ac-ft
---	-------------

Drawdown Within 72 hours

Soil Type:	Sandy Loam
RAWLS Rate (in/hr):	1.02
Infiltration Area (sf):	6,432
Drawdown Time (hours):	0.8

TSS Phosphorous Removal Worksheet

PROJECT LOCATION: 7 Perry Drive Foxborough, MA
DATE: 14-Jun-23
PROJECT NUMBER: 21-0102

TSS Removal

Subsurface Basin

Impervious Area =		0.766 acres		
Runoff depth to be treated =		1.00 inches		
Runoff volume to be treated =		0.0638 ac-ft		
<i>BMP</i>	<i>TSS Removal Rate</i>	<i>Starting TSS Load</i>	<i>Amount Removed</i>	<i>Remaining Load</i>
Deep Sump Catch Basin	0.25	1.00	0.25	0.75
Infiltration Basin	0.8	0.75	0.60	0.15
TOTAL TSS REMOVED =				85 %

Phosphorous Removal

BMP	Phosphorous Removal Rate	Starting TSS Load	Amount Removed	Remaining Load
Infiltration Basin	0.6	1.00	0.6	0.40
TOTAL PHOSPHOROUS REMOVED =				60%



Checklist for Stormwater Report

A. Introduction

Important: When filling out forms on the computer, use only the tab key to move your cursor - do not use the return key.



A Stormwater Report must be submitted with the Notice of Intent permit application to document compliance with the Stormwater Management Standards. The following checklist is NOT a substitute for the Stormwater Report (which should provide more substantive and detailed information) but is offered here as a tool to help the applicant organize their Stormwater Management documentation for their Report and for the reviewer to assess this information in a consistent format. As noted in the Checklist, the Stormwater Report must contain the engineering computations and supporting information set forth in Volume 3 of the [Massachusetts Stormwater Handbook](#). The Stormwater Report must be prepared and certified by a Registered Professional Engineer (RPE) licensed in the Commonwealth.

The Stormwater Report must include:

- The Stormwater Checklist completed and stamped by a Registered Professional Engineer (see page 2) that certifies that the Stormwater Report contains all required submittals.¹ This Checklist is to be used as the cover for the completed Stormwater Report.
- Applicant/Project Name
- Project Address
- Name of Firm and Registered Professional Engineer that prepared the Report
- Long-Term Pollution Prevention Plan required by Standards 4-6
- Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan required by Standard 8²
- Operation and Maintenance Plan required by Standard 9

In addition to all plans and supporting information, the Stormwater Report must include a brief narrative describing stormwater management practices, including environmentally sensitive site design and LID techniques, along with a diagram depicting runoff through the proposed BMP treatment train. Plans are required to show existing and proposed conditions, identify all wetland resource areas, NRCS soil types, critical areas, Land Uses with Higher Potential Pollutant Loads (LUHPPL), and any areas on the site where infiltration rate is greater than 2.4 inches per hour. The Plans shall identify the drainage areas for both existing and proposed conditions at a scale that enables verification of supporting calculations.

As noted in the Checklist, the Stormwater Management Report shall document compliance with each of the Stormwater Management Standards as provided in the Massachusetts Stormwater Handbook. The soils evaluation and calculations shall be done using the methodologies set forth in Volume 3 of the Massachusetts Stormwater Handbook.

To ensure that the Stormwater Report is complete, applicants are required to fill in the Stormwater Report Checklist by checking the box to indicate that the specified information has been included in the Stormwater Report. If any of the information specified in the checklist has not been submitted, the applicant must provide an explanation. The completed Stormwater Report Checklist and Certification must be submitted with the Stormwater Report.

¹ The Stormwater Report may also include the Illicit Discharge Compliance Statement required by Standard 10. If not included in the Stormwater Report, the Illicit Discharge Compliance Statement must be submitted prior to the discharge of stormwater runoff to the post-construction best management practices.

² For some complex projects, it may not be possible to include the Construction Period Erosion and Sedimentation Control Plan in the Stormwater Report. In that event, the issuing authority has the discretion to issue an Order of Conditions that approves the project and includes a condition requiring the proponent to submit the Construction Period Erosion and Sedimentation Control Plan before commencing any land disturbance activity on the site.



Checklist for Stormwater Report

B. Stormwater Checklist and Certification

The following checklist is intended to serve as a guide for applicants as to the elements that ordinarily need to be addressed in a complete Stormwater Report. The checklist is also intended to provide conservation commissions and other reviewing authorities with a summary of the components necessary for a comprehensive Stormwater Report that addresses the ten Stormwater Standards.


Note: Because stormwater requirements vary from project to project, it is possible that a complete Stormwater Report may not include information on some of the subjects specified in the Checklist. If it is determined that a specific item does not apply to the project under review, please note that the item is not applicable (N.A.) and provide the reasons for that determination.

A complete checklist must include the Certification set forth below signed by the Registered Professional Engineer who prepared the Stormwater Report.

Registered Professional Engineer's Certification

I have reviewed the Stormwater Report, including the soil evaluation, computations, Long-term Pollution Prevention Plan, the Construction Period Erosion and Sedimentation Control Plan (if included), the Long-term Post-Construction Operation and Maintenance Plan, the Illicit Discharge Compliance Statement (if included) and the plans showing the stormwater management system, and have determined that they have been prepared in accordance with the requirements of the Stormwater Management Standards as further elaborated by the Massachusetts Stormwater Handbook. I have also determined that the information presented in the Stormwater Checklist is accurate and that the information presented in the Stormwater Report accurately reflects conditions at the site as of the date of this permit application.

Registered Professional Engineer Block and Signature

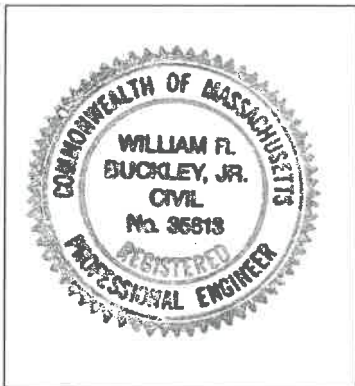

 6/22/23
Signature and Date

Checklist

Project Type: Is the application for new development, redevelopment, or a mix of new and redevelopment?

- New development
- Redevelopment
- Mix of New Development and Redevelopment



Checklist for Stormwater Report

Checklist (continued)

LID Measures: Stormwater Standards require LID measures to be considered. Document what environmentally sensitive design and LID Techniques were considered during the planning and design of the project:

- No disturbance to any Wetland Resource Areas
- Site Design Practices (e.g. clustered development, reduced frontage setbacks)
- Reduced Impervious Area (Redevelopment Only)
- Minimizing disturbance to existing trees and shrubs
- LID Site Design Credit Requested:
 - Credit 1
 - Credit 2
 - Credit 3
- Use of "country drainage" versus curb and gutter conveyance and pipe
- Bioretention Cells (includes Rain Gardens)
- Constructed Stormwater Wetlands (includes Gravel Wetlands designs)
- Treebox Filter
- Water Quality Swale
- Grass Channel
- Green Roof
- Other (describe): _____

Standard 1: No New Untreated Discharges

- No new untreated discharges
- Outlets have been designed so there is no erosion or scour to wetlands and waters of the Commonwealth
- Supporting calculations specified in Volume 3 of the Massachusetts Stormwater Handbook included.



Checklist for Stormwater Report

Checklist (continued)

Standard 2: Peak Rate Attenuation

- Standard 2 waiver requested because the project is located in land subject to coastal storm flowage and stormwater discharge is to a wetland subject to coastal flooding.
- Evaluation provided to determine whether off-site flooding increases during the 100-year 24-hour storm.
- Calculations provided to show that post-development peak discharge rates do not exceed pre-development rates for the 2-year and 10-year 24-hour storms. If evaluation shows that off-site flooding increases during the 100-year 24-hour storm, calculations are also provided to show that post-development peak discharge rates do not exceed pre-development rates for the 100-year 24-hour storm.

Standard 3: Recharge

- Soil Analysis provided.
- Required Recharge Volume calculation provided.
- Required Recharge volume reduced through use of the LID site Design Credits.
- Sizing the infiltration, BMPs is based on the following method: Check the method used.
 - Static
 - Simple Dynamic
 - Dynamic Field¹
- Runoff from all impervious areas at the site discharging to the infiltration BMP.
- Runoff from all impervious areas at the site is *not* discharging to the infiltration BMP and calculations are provided showing that the drainage area contributing runoff to the infiltration BMPs is sufficient to generate the required recharge volume.
- Recharge BMPs have been sized to infiltrate the Required Recharge Volume.
- Recharge BMPs have been sized to infiltrate the Required Recharge Volume *only* to the maximum extent practicable for the following reason:
 - Site is comprised solely of C and D soils and/or bedrock at the land surface
 - M.G.L. c. 21E sites pursuant to 310 CMR 40.0000
 - Solid Waste Landfill pursuant to 310 CMR 19.000
 - Project is otherwise subject to Stormwater Management Standards only to the maximum extent practicable.
- Calculations showing that the infiltration BMPs will drain in 72 hours are provided.
- Property includes a M.G.L. c. 21E site or a solid waste landfill and a mounding analysis is included.

¹ 80% TSS removal is required prior to discharge to infiltration BMP if Dynamic Field method is used.



Checklist for Stormwater Report

Checklist (continued)

Standard 3: Recharge (continued)

- The infiltration BMP is used to attenuate peak flows during storms greater than or equal to the 10-year 24-hour storm and separation to seasonal high groundwater is less than 4 feet and a mounding analysis is provided.
- Documentation is provided showing that infiltration BMPs do not adversely impact nearby wetland resource areas.

Standard 4: Water Quality

The Long-Term Pollution Prevention Plan typically includes the following:

- Good housekeeping practices;
 - Provisions for storing materials and waste products inside or under cover;
 - Vehicle washing controls;
 - Requirements for routine inspections and maintenance of stormwater BMPs;
 - Spill prevention and response plans;
 - Provisions for maintenance of lawns, gardens, and other landscaped areas;
 - Requirements for storage and use of fertilizers, herbicides, and pesticides;
 - Pet waste management provisions;
 - Provisions for operation and management of septic systems;
 - Provisions for solid waste management;
 - Snow disposal and plowing plans relative to Wetland Resource Areas;
 - Winter Road Salt and/or Sand Use and Storage restrictions;
 - Street sweeping schedules;
 - Provisions for prevention of illicit discharges to the stormwater management system;
 - Documentation that Stormwater BMPs are designed to provide for shutdown and containment in the event of a spill or discharges to or near critical areas or from LUHPPL;
 - Training for staff or personnel involved with implementing Long-Term Pollution Prevention Plan;
 - List of Emergency contacts for implementing Long-Term Pollution Prevention Plan.
- A Long-Term Pollution Prevention Plan is attached to Stormwater Report and is included as an attachment to the Wetlands Notice of Intent.
 - Treatment BMPs subject to the 44% TSS removal pretreatment requirement and the one inch rule for calculating the water quality volume are included, and discharge:
 - is within the Zone II or Interim Wellhead Protection Area
 - is near or to other critical areas
 - is within soils with a rapid infiltration rate (greater than 2.4 inches per hour)
 - involves runoff from land uses with higher potential pollutant loads.
 - The Required Water Quality Volume is reduced through use of the LID site Design Credits.
 - Calculations documenting that the treatment train meets the 80% TSS removal requirement and, if applicable, the 44% TSS removal pretreatment requirement, are provided.



Checklist for Stormwater Report

Checklist (continued)

Standard 4: Water Quality (continued)

- The BMP is sized (and calculations provided) based on:
 - The ½" or 1" Water Quality Volume or
 - The equivalent flow rate associated with the Water Quality Volume and documentation is provided showing that the BMP treats the required water quality volume.
- The applicant proposes to use proprietary BMPs, and documentation supporting use of proprietary BMP and proposed TSS removal rate is provided. This documentation may be in the form of the propriety BMP checklist found in Volume 2, Chapter 4 of the Massachusetts Stormwater Handbook and submitting copies of the TARP Report, STEP Report, and/or other third party studies verifying performance of the proprietary BMPs.
- A TMDL exists that indicates a need to reduce pollutants other than TSS and documentation showing that the BMPs selected are consistent with the TMDL is provided.

Standard 5: Land Uses With Higher Potential Pollutant Loads (LUHPPLs)

- The NPDES Multi-Sector General Permit covers the land use and the Stormwater Pollution Prevention Plan (SWPPP) has been included with the Stormwater Report.
- The NPDES Multi-Sector General Permit covers the land use and the SWPPP will be submitted **prior to** the discharge of stormwater to the post-construction stormwater BMPs.
- The NPDES Multi-Sector General Permit does **not** cover the land use.
- LUHPPLs are located at the site and industry specific source control and pollution prevention measures have been proposed to reduce or eliminate the exposure of LUHPPLs to rain, snow, snow melt and runoff, and been included in the long term Pollution Prevention Plan.
- All exposure has been eliminated.
- All exposure has **not** been eliminated and all BMPs selected are on MassDEP LUHPPL list.
- The LUHPPL has the potential to generate runoff with moderate to higher concentrations of oil and grease (e.g. all parking lots with >1000 vehicle trips per day) and the treatment train includes an oil grit separator, a filtering bioretention area, a sand filter or equivalent.

Standard 6: Critical Areas

- The discharge is near or to a critical area and the treatment train includes only BMPs that MassDEP has approved for stormwater discharges to or near that particular class of critical area.
- Critical areas and BMPs are identified in the Stormwater Report.



Checklist for Stormwater Report

Checklist (continued)

Standard 7: Redevelopments and Other Projects Subject to the Standards only to the maximum extent practicable

- The project is subject to the Stormwater Management Standards only to the maximum Extent Practicable as a:
 - Limited Project
 - Small Residential Projects: 5-9 single family houses or 5-9 units in a multi-family development provided there is no discharge that may potentially affect a critical area.
 - Small Residential Projects: 2-4 single family houses or 2-4 units in a multi-family development with a discharge to a critical area
 - Marina and/or boatyard provided the hull painting, service and maintenance areas are protected from exposure to rain, snow, snow melt and runoff
 - Bike Path and/or Foot Path
 - Redevelopment Project
 - Redevelopment portion of mix of new and redevelopment.
- Certain standards are not fully met (Standard No. 1, 8, 9, and 10 must always be fully met) and an explanation of why these standards are not met is contained in the Stormwater Report.
- The project involves redevelopment and a description of all measures that have been taken to improve existing conditions is provided in the Stormwater Report. The redevelopment checklist found in Volume 2 Chapter 3 of the Massachusetts Stormwater Handbook may be used to document that the proposed stormwater management system (a) complies with Standards 2, 3 and the pretreatment and structural BMP requirements of Standards 4-6 to the maximum extent practicable and (b) improves existing conditions.

Standard 8: Construction Period Pollution Prevention and Erosion and Sedimentation Control

A Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan must include the following information:

- Narrative;
 - Construction Period Operation and Maintenance Plan;
 - Names of Persons or Entity Responsible for Plan Compliance;
 - Construction Period Pollution Prevention Measures;
 - Erosion and Sedimentation Control Plan Drawings;
 - Detail drawings and specifications for erosion control BMPs, including sizing calculations;
 - Vegetation Planning;
 - Site Development Plan;
 - Construction Sequencing Plan;
 - Sequencing of Erosion and Sedimentation Controls;
 - Operation and Maintenance of Erosion and Sedimentation Controls;
 - Inspection Schedule;
 - Maintenance Schedule;
 - Inspection and Maintenance Log Form.
- A Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan containing the information set forth above has been included in the Stormwater Report.



Checklist for Stormwater Report

Checklist (continued)

Standard 8: Construction Period Pollution Prevention and Erosion and Sedimentation Control (continued)

- The project is highly complex and information is included in the Stormwater Report that explains why it is not possible to submit the Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan with the application. A Construction Period Pollution Prevention and Erosion and Sedimentation Control has **not** been included in the Stormwater Report but will be submitted **before** land disturbance begins.
- The project is **not** covered by a NPDES Construction General Permit.
- The project is covered by a NPDES Construction General Permit and a copy of the SWPPP is in the Stormwater Report.
- The project is covered by a NPDES Construction General Permit but no SWPPP been submitted. The SWPPP will be submitted BEFORE land disturbance begins.

Standard 9: Operation and Maintenance Plan

- The Post Construction Operation and Maintenance Plan is included in the Stormwater Report and includes the following information:
 - Name of the stormwater management system owners;
 - Party responsible for operation and maintenance;
 - Schedule for implementation of routine and non-routine maintenance tasks;
 - Plan showing the location of all stormwater BMPs maintenance access areas;
 - Description and delineation of public safety features;
 - Estimated operation and maintenance budget; and
 - Operation and Maintenance Log Form.
- The responsible party is **not** the owner of the parcel where the BMP is located and the Stormwater Report includes the following submissions:
 - A copy of the legal instrument (deed, homeowner's association, utility trust or other legal entity) that establishes the terms of and legal responsibility for the operation and maintenance of the project site stormwater BMPs;
 - A plan and easement deed that allows site access for the legal entity to operate and maintain BMP functions.

Standard 10: Prohibition of Illicit Discharges

- The Long-Term Pollution Prevention Plan includes measures to prevent illicit discharges;
- An Illicit Discharge Compliance Statement is attached;
- NO Illicit Discharge Compliance Statement is attached but will be submitted **prior to** the discharge of any stormwater to post-construction BMPs.

Transient Water-Table Rise Beneath a Rectangular Recharge Area
Groundwater Mounding Solution by Hantush (1967)

Aquifer Properties:

Hydraulic conductivity, $K = 1.02$ ft/day
Specific yield, $S_y = 0.23$
Initial saturated thickness, $h(0) = 28$ ft

Recharge Area Properties:

Recharge rate, $w = 1$ ft/day
Simulation time, $t = 1$ day
Time when recharge stops, $t(0) = 0.0833$ day
X coordinate at center of recharge area, $X = 0$ ft
Y coordinate at center of recharge area, $Y = 0$ ft
Length in x direction, $l = 100.5$ ft
Length in y direction, $a = 64$ ft

Water-Table Rise at Center of Recharge Area:

t (day) h (ft)

t (day)	h (ft)
0.1	0.362174
0.2	0.362173
0.3	0.362143
0.4	0.361897
0.5	0.361141
0.6	0.3597
0.7	0.357557
0.8	0.354785
0.9	0.351484
1	0.347758

Note: recovery begins after 0.0833 day.

PROJECT LOCATION: 7 Perry Drive
 DATE: 26-May-23
 PROJECT NUMBER: 21-0102

Infiltration Basin

Aquifer Properties:

Hydraulic Conductivity (K-ft/day):	1.02	RAWLS rate for SAND
Specific Yield (Sy):	0.23	Medium Gravel (USGS Water Supply Paper 1662- Town of Foxborough Ground Water Protection Study- April 1989)
Initial Saturated Thickness (ft):	28	

Recharge Area Properties:

Required Recharge Volume (Rv-ft3):	510	See Required Recharge Volume Worksheet
Elevation of Estimated High Groundwater (ft):	258.80	
Bottom of Recharge System (ft):	260.80	Bottom basin el-260.8'
Bottom Area (ft2):	6,030	Bottom basin el-260.8'

Application Rate Calculation:

$$\frac{Rv \text{ (ft3)}}{\text{Bottom Area (ft2)}} * \frac{24 \text{ hrs/day}}{2 \text{ (DEP stan)}} =$$

$$\frac{510}{6,030} * \frac{24}{2} = 1.0 \text{ ft/day}$$

Length of Time to Generate Rv (days):	0.0833	assume Rv generated during a 2 hour period - see DEP Stormwater Handbook, Vol.3, Ch.1, p.20
---------------------------------------	--------	--

Groundwater Mounding Solution by Hantush (1967)

Maximum Water Table Rise in Center of Recharge Area (ft)	0.36	See output run using AQTESOLV V4.50.002
--	------	---

Depth From Top of Mound to Bottom of Recharge Area (ft):	1.64
--	------

Mound does not breach bottom of system

**APPENDIX C - OPERATION AND MAINTENANCE PLAN
FOR STORM WATER BMPS**

Construction Period O & M Plan
Post-Construction O & M Plan
Draft SWPPP

**CONSTRUCTION PERIOD MAINTENANCE PLAN
FOR STORMWATER BMPs
7 Perry Drive Foxborough, MA**

References:

- Site Development Plan of “7 Perry Drive” Foxborough, MA dated June 14, 2023
- Storm Water Report “7 Perry Drive” Foxborough, MA dated June, 2023

Operation and Maintenance

- Item 1: During construction, **weekly** inspection of the crushed stone construction entrance pad and erosion control silt socks shall be conducted by a qualified staff member of the responsible party or an independent sediment and erosion control expert hired by the responsible party. Any displaced barriers shall be restored or repaired immediately.
- Item 2: The catch basins in the **parking area** shall be inspected **before and after** rain storms, if they are filled with sediment to half of their depth, they shall be cleaned out with an orange peel bucket or some other means. Silt sacks shall be installed inside the catch basins. The infiltration system and catch basins shall be inspected three times a year: once after leaf fall, once before the arrival of hurricane season, the third in the early or mid-spring after the snow melt and road sweeping. Any debris should be cleaned out. The parking lot shall be swept as necessary, but no less than twice a year: once before hurricane season, the once in the spring after snow melt.
- Item 3: During construction every effort will be made to ensure that silt does not enter the stormwater basin. Additional silt socks shall be used as necessary. If silt does enter the basin, then the contractor shall be responsible for its removal through the inspection ports.
- Item 4: During construction, the stone pad at the entrance to the project shall be inspected **weekly** and replenished if siltation is impeding the cleaning of truck tires. Any materials tracked into the roadway shall be swept up within a day.

**Appendix C: LONG TERM OPERATION AND MAINTENANCE PLAN
FOR STORMWATER BMPs
7 Perry Drive Foxborough, MA**

<i>BMP Owner:</i>	During Construction Owner	Post-construction Owner
<i>Party of Plan Responsibility:</i>	Owner	Owner

References:

- Site Development Plan of “7 Perry Drive” Foxborough, MA dated June 14, 2023
- Storm Water Report “7 Perry Drive” Foxborough, MA dated June, 2023

Operation and Maintenance

Catch Basins: The catch basins shall be inspected three times a year: once after leaf fall, once before the arrival of hurricane season, the third in the early or mid-spring after the snow melt and road sweeping. Any debris in catch basins shall be cleaned out. If there is less than 2’ of space below the outlet and the top of the silt then the structure shall be cleaned out.

Parking Area: The parking area will be swept twice a year: once before hurricane season, the other in the spring after snow melt.

Infiltration Basin: Once the infiltration system is in use, the infiltration chambers shall be inspected by opening inspection ports after every major storm (3.2 inches in 24 hours) for the first few months to ensure it is functioning properly and if necessary, take corrective action. Note how long water remains standing in the basin after a storm; standing water within the basin 48 to 72 hours after a storm indicates that there is an issue. Remedial action shall be taken in accordance with the issue. Thereafter, inspect the infiltration basin at least twice per year to ensure that it is dry. See latest edition of Cultec Contractor & Recharge Operation and Maintenance Guidelines ([CULG008-operations-and-maintenance-guidelines.pdf](https://www.cultec.com/CULG008-operations-and-maintenance-guidelines.pdf) ([cultec.com](https://www.cultec.com))).

Estimated Operations and Maintenance Budget

The following is an estimate of the O&M Budget, post construction.

Inspections (3 times per year): \$200

Cleaning catch basins (yearly): \$200

Stormwater Pollution Prevention Plan (SWPPP)

For Construction Activities At:

7 Perry Drive
Foxborough, MA
Telephone: TBD

SWPPP Prepared For:

Technimetals
7 Perry Drive
Foxborough, MA 02035
508.698.2444

SWPPP Prepared By:

Bay Colony Group, Inc.
4 School Street
Foxborough, MA 02035
508.543.3939
508.543.8866 fax

SWPPP Preparation Date:

June, 2023

Estimated Project Dates:

Project Start Date: Fall, 2023
Project Completion Date: Spring, 2024

Contents

SECTION 1: CONTACT INFORMATION/RESPONSIBLE PARTIES 1

1.1 Operator(s) / Subcontractor(s) 1

1.2 Stormwater Team 1

SECTION 2: SITE EVALUATION, ASSESSMENT, AND PLANNING 3

2.1 Project/Site Information 3

2.2 Discharge Information 4

2.3 Nature of the Construction Activity..... 5

2.4 Sequence and Estimated Dates of Construction Activities 5

2.5 Allowable Non-Stormwater Discharges 6

2.6 Site Maps 7

SECTION 3: DOCUMENTATION OF COMPLIANCE WITH OTHER FEDERAL REQUIREMENTS 8

3.1 Endangered Species Protection..... 8

3.2 Historic Preservation 10

3.3 Safe Drinking Water Act Underground Injection Control Requirements 11

SECTION 4: EROSION AND SEDIMENT CONTROLS 12

4.1 Natural Buffers or Equivalent Sediment Controls 12

4.2 Perimeter Controls 14

4.3 Sediment Track-Out..... 15

4.4 Stockpiled Sediment or Soil 15

4.5 Minimize Dust..... 16

4.6 Minimize the Disturbance of Steep Slopes 16

4.7 Topsoil..... 16

4.8 Soil Compaction 17

4.9 Storm Drain Inlets 17

4.10 Constructed Stormwater Conveyance Channels 18

4.11 Sediment Basins 19

4.12 Chemical Treatment 19

4.13 Dewatering Practices 20

4.14 Other Stormwater Controls..... 20

4.15 Site Stabilization 21

SECTION 5: POLLUTION PREVENTION STANDARDS 24

5.1 Potential Sources of Pollution 24

5.2 Spill Prevention and Response 25

5.3 Fueling and Maintenance of Equipment or Vehicles 25

5.4 Washing of Equipment and Vehicles..... 25

5.5 Storage, Handling, and Disposal of Construction Products, Materials, and Wastes..... 26

5.6 Washing of Applicators and Containers used for Paint, Concrete or Other Materials ... 28

5.7 Fertilizers 29

5.8 Other Pollution Prevention Practices..... 29

SECTION 6: INSPECTION AND CORRECTIVE ACTION 30

6.1 Inspection Personnel and Procedures 30

6.2 Corrective Action 31

6.3 Delegation of Authority 31

SECTION 7: TRAINING 32

SECTION 8: CERTIFICATION AND NOTIFICATION 33

SWPPP APPENDICES 34

DRAFT

SECTION 1: CONTACT INFORMATION/RESPONSIBLE PARTIES

1.1 Operator(s) / Subcontractor(s)

Operator(s):

A. Technimetals
7 Perry Drive
Foxborough, MA 02035
508.698.2444

General Contractor

Subcontractor(s):

Insert Company or Organization Name:
Insert Name:
Insert Address:
Insert City, State, Zip Code:
Insert Telephone Number:
Insert Fax/Email:
Insert area of control (if more than one operator at site):

[Repeat as necessary.]

Emergency 24-Hour Contact:

A. Insert name address, telephone number

1.2 Stormwater Team

Insert Role or Responsibility: **Project Manager**
Insert Position: **Project Manager**
Insert Name: **Name**
Insert Telephone Number: **number**
Insert Email: **email**

Insert Role or Responsibility:
Insert Position:
Insert Name:
Insert Telephone Number:

Insert Email:

Insert Role or Responsibility:

Insert Position:

Insert Name:

Insert Telephone Number:

Insert Email:

[Repeat as necessary.]

DRAFT

SECTION 2: SITE EVALUATION, ASSESSMENT, AND PLANNING**2.1 Project/Site Information****Project Name and Address**Project/Site Name: **7 Perry Drive**Project Street/Location: **7 Perry Drive**City: **Foxborough**State: **MA**ZIP Code: **02035**County or Similar Subdivision: **Norfolk****Project Latitude/Longitude**(Use **one** of three possible formats, and specify method)

Latitude:

1. **42 ° 06 ' 17" N** (degrees, minutes, seconds)

2. ___ ° ___ . ___ ' N (degrees, minutes, decimal)

3. ___ . ___ ° N (decimal)

Longitude:

1. **71 ° 14 ' 56" W** (degrees, minutes, seconds)

2. ___ ° ___ . ___ ' W (degrees, minutes, decimal)

3. ___ . ___ ° W (decimal)

Method for determining latitude/longitude:

 USGS topographic map (specify scale: _____) EPA Web site GPS Other (please specify): _____

Horizontal Reference Datum:

 NAD 27 NAD 83 or WGS 84 Unknown

If you used a U.S.G.S topographic map, what was the scale? _____

Additional Project InformationIs the project/site located on Indian country lands, or located on a property of religious or cultural significance to an Indian tribe? Yes NoIf yes, provide the name of the Indian tribe associated with the area of Indian country (including the name of Indian reservation if applicable), or if not in Indian country, provide the name of the Indian tribe associated with the property: **N/A**If you are conducting earth-disturbing activities in response to a public emergency, document the cause of the public emergency (e.g., *natural disaster, extreme flooding conditions*), information substantiating its occurrence (e.g., *state disaster declaration*), and a description of the construction necessary to reestablish effective public services: **N/A**Are you applying for permit coverage as a "federal operator" as defined in Appendix A of the 2012 CGP? Yes No

2.2 Discharge Information

Does your project/site discharge stormwater into a Municipal Separate Storm Sewer System (MS4)? Yes No

Are there any surface waters that are located within 50 feet of your construction disturbances?

Yes No

DRAFT

Table 1 – Names of Receiving Waters

Name(s) of the first surface water that receives stormwater directly from your site and/or from the MS4 (note: multiple rows provided where your site has more than one point of discharge that flows to different surface waters)
1. Ganawatte Farm Pond
2.
3.
4.
5.
6.

Table 2 – Impaired Waters / TMDLs (Answer the following for each surface water listed in Table 1 above)

	Is this surface water listed as "impaired"?	If you answered yes, then answer the following:			
		What pollutant(s) are causing the impairment?	Has a TMDL been completed?	Title of the TMDL document	Pollutant(s) for which there is a TMDL
1.	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	Aquatic plants, dissolved oxygen and clarity	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO		
2.	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO		
3.	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO		
4.	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO		
5.	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO		
6.	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO		

[Include additional rows as necessary.]

Describe the method(s) you used to determine whether or not your project/site discharges to an impaired water: [Review of the MassDEP 2018 Integrated List of Waters](#). [Spring Brook is not listed](#)

Table 3 – Tier 2, 2.5, or 3 Waters (Answer the following for each surface water listed in Table 1 above)

	Is this surface water designated as a Tier 2, Tier 2.5, or Tier 3 water? (see Appendix F)	If you answered yes, specify which Tier (2, 2.5, or 3) the surface water is designated as?
1.	<input type="checkbox"/> YES <input type="checkbox"/> NO	INSERT "Tier 2", "Tier 2.5", or "Tier 3"
2.	<input type="checkbox"/> YES <input type="checkbox"/> NO	INSERT "Tier 2", "Tier 2.5", or "Tier 3"
3.	<input type="checkbox"/> YES <input type="checkbox"/> NO	INSERT "Tier 2", "Tier 2.5", or "Tier 3"
4.	<input type="checkbox"/> YES <input type="checkbox"/> NO	INSERT "Tier 2", "Tier 2.5", or "Tier 3"

5.	<input type="checkbox"/> YES <input type="checkbox"/> NO	INSERT "Tier 2", "Tier 2.5", or "Tier 3"
----	--	--

DRAFT

2.3 Nature of the Construction Activity

General Description of Project

Provide a general description of the construction project:

Construction of a 12,000 addition with associated parking and storm water systems.

Size of Construction Project

What is the size of the property (in acres), the total area expected to be disturbed by the construction activities (in acres), and the maximum area expected to be disturbed at any one time?

INSERT SIZE OF PROPERTY – 2.23+/- acres

INSERT TOTAL AREA OF CONSTRUCTION DISTURBANCES – 1.00+/- acres

INSERT MAXIMUM AREA TO BE DISTURBED AT ANY ONE TIME – 1.00+/- acres

[Repeat as necessary for individual project phases.]

Construction Support Activities (only provide if applicable)

Describe any construction support activities for the project (e.g., concrete or asphalt batch plants, equipment staging yards, material storage areas, excavated material disposal areas, borrow areas)

INSERT DESCRIPTION OF CONSTRUCTION SUPPORT ACTIVITY

INSERT CONTACT INFORMATION FOR CONSTRUCTION SUPPORT ACTIVITY (Name, Telephone No., Email Address)

INSERT LOCATION INFORMATION FOR CONSTRUCTION SUPPORT ACTIVITY (Address and/or Latitude/Longitude)

[Repeat as necessary.]

2.4 Sequence and Estimated Dates of Construction Activities

Phase I

Clearing of building site and storm water basins, installation of erosion controls, and grubbing of wooded areas, and storm water basins.

- **INSERT ESTIMATED START AND END DATES OF CONSTRUCTION DISTURBANCES ASSOCIATED WITH THIS PHASE**
- **FOR EACH STORMWATER CONTROL, INSERT ESTIMATED DATE(S) OF INSTALLATION OF EACH STORMWATER CONTROL**
- **FOR AREAS OF THE SITE REQUIRED TO BE STABILIZED, INSERT ESTIMATED DATE(S) OF APPLICATION OF STABILIZATION MEASURES**
- **INSERT ESTIMATED DATE(S) WHEN STORMWATER CONTROLS WILL BE REMOVED**

Phase II

Import and placement of material to bring building and parking to subbase elevation. Construction of storm water basins. Installation of drainage and water mains within site.

- **INSERT ESTIMATED START AND END DATES OF CONSTRUCTION DISTURBANCES ASSOCIATED WITH THIS PHASE**

- FOR EACH STORMWATER CONTROL, INSERT ESTIMATED DATE(S) OF INSTALLATION OF EACH STORMWATER CONTROL
- FOR AREAS OF THE SITE REQUIRED TO BE STABILIZED, INSERT ESTIMATED DATE(S) OF APPLICATION OF STABILIZATION MEASURES
- INSERT ESTIMATED DATE(S) WHEN STORMWATER CONTROLS WILL BE REMOVED

Phase III

Installation of base course of parking and construction of building.

- INSERT ESTIMATED START AND END DATES OF CONSTRUCTION DISTURBANCES ASSOCIATED WITH THIS PHASE
- FOR EACH STORMWATER CONTROL, INSERT ESTIMATED DATE(S) OF INSTALLATION OF EACH STORMWATER CONTROL
- FOR AREAS OF THE SITE REQUIRED TO BE STABILIZED, INSERT ESTIMATED DATE(S) OF APPLICATION OF STABILIZATION MEASURES
- INSERT ESTIMATED DATE(S) WHEN STORMWATER CONTROLS WILL BE REMOVED

Phase IV

Construct landscaping, finish building, place finished course of pavement. Remove storm water erosion controls.

- INSERT ESTIMATED START AND END DATES OF CONSTRUCTION DISTURBANCES ASSOCIATED WITH THIS PHASE
- FOR EACH STORMWATER CONTROL, INSERT ESTIMATED DATE(S) OF INSTALLATION OF EACH STORMWATER CONTROL
- FOR AREAS OF THE SITE REQUIRED TO BE STABILIZED, INSERT ESTIMATED DATE(S) OF APPLICATION OF STABILIZATION MEASURES
- INSERT ESTIMATED DATE(S) WHEN STORMWATER CONTROLS WILL BE REMOVED
-

[Repeat as needed.]

2.5 Allowable Non-Stormwater Discharges

List of Allowable Non-Stormwater Discharges Present at the Site

Type of Allowable Non-Stormwater Discharge	Likely to be Present at Your Site?
Discharges from emergency fire-fighting activities	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO
Fire hydrant flushings	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO
Landscape irrigation	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
Waters used to wash vehicles and equipment	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO
Water used to control dust	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
Potable water including uncontaminated water line flushings	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO
Routine external building wash down	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO
Pavement wash waters	<input type="checkbox"/> YES <input checked="" type="checkbox"/> NO
Uncontaminated air conditioning or compressor condensate	<input checked="" type="checkbox"/> YES <input type="checkbox"/> NO

Uncontaminated, non-turbid discharges of ground water or spring water	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO
Foundation or footing drains	<input type="checkbox"/> YES	<input checked="" type="checkbox"/> NO
Construction dewatering water	<input checked="" type="checkbox"/> YES	<input type="checkbox"/> NO

(Note: You are reminded of the requirement to identify the likely locations of these allowable non-stormwater discharges on your site map. See Section 2.6, below, of the SWPPP Template.)

2.6 Site Maps

See Site Development Plan of #7 Perry Drive by Bay Colony Group, Inc.

DRAFT

SECTION 3: DOCUMENTATION OF COMPLIANCE WITH OTHER FEDERAL REQUIREMENTS**3.1 Endangered Species Protection****Eligibility Criterion**

Under which criterion listed in Appendix D are you eligible for coverage under this permit?

A **B** **C** **D** **E** **F**

For reference purposes, the eligibility criteria listed in Appendix D are as follows:

- Criterion A.** No federally-listed threatened or endangered species or their designated critical habitat(s) are likely to occur in your site's "action area" as defined in Appendix A of this permit.
- Criterion B.** The construction site's discharges and discharge-related activities were already addressed in another operator's valid certification of eligibility for your action area under eligibility Criterion A, C, D, E, or F and there is no reason to believe that federally-listed species or federally-designated critical habitat not considered in the prior certification may be present or located in the "action area". To certify your eligibility under this Criterion, there must be no lapse of NPDES permit coverage in the other operator's certification. By certifying eligibility under this Criterion, you agree to comply with any effluent limitations or conditions upon which the other operator's certification was based. You must include in your NOI the tracking number from the other operator's notification of authorization under this permit. If your certification is based on another operator's certification under Criterion C, you must provide EPA with the relevant supporting information required of existing dischargers in Criterion C in your NOI form.
- Criterion C.** Federally-listed threatened or endangered species or their designated critical habitat(s) are likely to occur in or near your site's "action area," and your site's discharges and discharge-related activities are not likely to adversely affect listed threatened or endangered species or critical habitat. This determination may include consideration of any stormwater controls and/or management practices you will adopt to ensure that your discharges and discharge-related activities are not likely to adversely affect listed species and critical habitat. To make this certification, you must include the following in your NOI: 1) any federally listed species and/or designated habitat located in your "action area"; and 2) the distance between your site and the listed species or designated critical habitat (in miles). You must also include a copy of your site map with your NOI.
- Criterion D.** Coordination between you and the Services has been concluded. The coordination must have addressed the effects of your site's discharges and discharge-related activities on federally-listed threatened or endangered species and federally-designated critical habitat, and must have resulted in a written concurrence from the relevant Service(s) that your site's discharges and discharge-related activities are not likely to adversely affect listed species or critical habitat. You must include copies of the correspondence between yourself and the Services in your SWPPP and your NOI.
- Criterion E.** Consultation between a Federal Agency and the U.S. Fish and Wildlife Service and/or the National Marine Fisheries Service under section 7 of the ESA has been concluded. The consultation must have addressed the effects of the construction site's discharges and discharge-related activities on federally-listed threatened or endangered species and federally-designated critical habitat. The result of this consultation must be either:

- i. a biological opinion that concludes that the action in question (taking into account the effects of your site's discharges and discharge-related activities) is not likely to jeopardize the continued existence of listed species, nor the destruction or adverse modification of critical habitat; or
- ii. written concurrence from the applicable Service(s) with a finding that the site's discharges and discharge-related activities are not likely to adversely affect federally-listed species or federally-designated habitat.

You must include copies of the correspondence between yourself and the Services in your SWPPP and your NOI.

Criterion F. Your construction activities are authorized through the issuance of a permit under section 10 of the ESA, and this authorization addresses the effects of the site's discharges and discharge-related activities on federally-listed species and federally-designated critical habitat. You must include copies of the correspondence between yourself and the Services in your SWPPP and your NOI.

Supporting Documentation

Provide documentation for the applicable eligibility criterion you select in Appendix D, as follows:

For criterion A, indicate the basis for your determination that no federally-listed threatened or endangered species or their designated critical habitat(s) are likely to occur in your site's action area (as defined in Appendix A of the permit). Check the applicable source of information you relied upon:

- Specific communication with staff of the U.S. Fish & Wildlife Service or National Marine Fisheries Service. [INSERT DATE OF COMMUNICATION AND WHO YOU SPOKE WITH](#)
- Publicly available species list. [MASSMAPPER Website – NHESP Tabs](#)
- Other source: [INSERT SPECIFIC SOURCE](#)

For criterion B, provide the Tracking Number from the other operator's notification of permit authorization: [INSERT AUTHORIZATION TRACKING NUMBER FROM OTHER OPERATOR'S NOTIFICATION LETTER/EMAIL](#)

Provide a brief summary of the basis used by the other operator for selecting criterion A, B, C, D, E, or F: [INSERT TEXT HERE](#)

For criterion C, provide the following information:

- [INSERT LIST OF FEDERALLY-LISTED SPECIES OR FEDERALLY-DESIGNATED CRITICAL HABITAT LOCATED IN YOUR ACTION AREA](#)
- [INSERT DISTANCE BETWEEN YOUR SITE AND THE LISTED SPECIES OR CRITICAL HABITAT \(in miles\)](#)

Also, provide a brief summary of the basis used for determining that your site's discharges and discharge-related activities are not likely to adversely affect listed species or critical habitat: [INSERT TEXT HERE](#)

For criterion D, E, or F, attach copies of any letters or other communication between you and the U.S. Fish & Wildlife Service or National Marine Fisheries Service concluding consultation or coordination activities. [INSERT COPIES OF LETTERS OR OTHER COMMUNICATIONS HERE](#)

3.2 Historic Preservation

Appendix E, Step 1

Do you plan on installing any of the following stormwater controls at your site? Check all that apply below, and proceed to Appendix E, Step 2.

- Dike
- Berm
- Catch Basin
- Pond
- Stormwater Conveyance Channel (e.g., ditch, trench, perimeter drain, swale, etc.)
- Culvert
- Other type of ground-disturbing stormwater control: [1,500 gallon pump chamber](#)

(Note: If you will not be installing any ground-disturbing stormwater controls, no further documentation is required for Section 3.2 of the Template.)

Appendix E, Step 2

If you answered yes in Step 1, have prior surveys or evaluations conducted on the site already determined that historic properties do not exist, or that prior disturbances at the site have precluded the existence of historic properties? YES NO

- If yes, no further documentation is required for Section 3.2 of the Template.
- If no, proceed to Appendix E, Step 3.

Appendix E, Step 3

If you answered no in Step 2, have you determined that your installation of subsurface earth-disturbing stormwater controls will have no effect on historic properties? YES NO

If yes, provide documentation of the basis for your determination. [Reference to the Massachusetts Cultural Resources Information System shows no historical areas, buildings, burial grounds, objects or structures on or near the site.](#)

If no, proceed to Appendix E, Step 4.

Appendix E, Step 4

If you answered no in Step 3, did the State Historic Preservation Officer (SHPO), Tribal Historic Preservation Office (THPO), or other tribal representative (whichever applies) respond to you within 15 calendar days to indicate whether the subsurface earth disturbances caused by the installation of stormwater controls affect historic properties? YES NO

If no, no further documentation is required for Section 3.2 of the Template.

If yes, describe the nature of their response:

- Written indication that adverse effects to historic properties from the installation of stormwater controls can be mitigated by agreed upon actions. **INSERT COPIES OF LETTERS, EMAILS, OR OTHER COMMUNICATION BETWEEN YOU AND THE APPLICABLE SHPO, THPO, OR OTHER TRIBAL REPRESENTATIVE**
- No agreement has been reached regarding measures to mitigate effects to historic properties from the installation of stormwater controls. **INSERT COPIES OF LETTERS, EMAILS, OR OTHER COMMUNICATION BETWEEN YOU AND THE APPLICABLE SHPO, THPO, OR OTHER TRIBAL REPRESENTATIVE**
- Other: **INSERT COPIES OF LETTERS, EMAILS, OR OTHER COMMUNICATION BETWEEN YOU AND THE APPLICABLE SHPO, THPO, OR OTHER TRIBAL REPRESENTATIVE**

3.3 **Safe Drinking Water Act Underground Injection Control Requirements**

Do you plan to install any of the following controls? Check all that apply below.

- Infiltration trenches (if stormwater is directed to any bored, drilled, driven shaft or dug hole that is deeper than its widest surface dimension, or has a subsurface fluid distribution system)
- Commercially manufactured pre-cast or pre-built proprietary subsurface detention vaults, chambers, or other devices designed to capture and infiltrate stormwater flow
- Drywells, seepage pits, or improved sinkholes (if stormwater is directed to any bored, drilled, driven shaft or dug hole that is deeper than its widest surface dimension, or has a subsurface fluid distribution system)

If yes, **INSERT COPIES OF LETTERS, EMAILS, OR OTHER COMMUNICATION BETWEEN YOU AND THE STATE AGENCY OR EPA REGIONAL OFFICE - no correspondence undertaken. Project is permitted under the MassDEP Stormwater Regulations which are enforced by the local Planning Board. A Notice of Intent will be filed and an Order of Conditions issued before the project can proceed.**

SECTION 4: EROSION AND SEDIMENT CONTROLS**4.1 Natural Buffers or Equivalent Sediment Controls****Buffer Compliance Alternatives**

Are there any surface waters within 50 feet of your project's earth disturbances? YES NO

(Note: If no, no further documentation is required for the SWPPP Template.)

Check the compliance alternative that you have chosen:

- I will provide and maintain a 50-foot undisturbed natural buffer.
 (Note (1): You must show the 50-foot boundary line of the natural buffer on your site map.)
 (Note (2): You must show on your site map how all discharges from your construction disturbances through the natural buffer area will first be treated by the site's erosion and sediment controls. Also, show on the site map any velocity dissipation devices used to prevent erosion within the natural buffer area.)
- I will provide and maintain an undisturbed natural buffer that is less than 50 feet and is supplemented by additional erosion and sediment controls, which in combination achieves the sediment load reduction equivalent to a 50-foot undisturbed natural buffer.
 (Note (1): You must show the boundary line of the natural buffer on your site map.)
 (Note (2): You must show on your site map how all discharges from your construction disturbances through the natural buffer area will first be treated by the site's erosion and sediment controls. Also, show on the site map any velocity dissipation devices used to prevent erosion within the natural buffer area.)
- INSERT WIDTH OF NATURAL BUFFER TO BE RETAINED
 - INSERT EITHER ONE OF THE FOLLOWING:
 - (1) THE ESTIMATED SEDIMENT REMOVAL FROM A 50-FOOT BUFFER USING APPLICABLE TABLES IN APP. G, ATTACHMENT 1. INCLUDE INFORMATION ABOUT THE BUFFER VEGETATION AND SOIL TYPE THAT PREDOMINATE AT YOUR SITE
 - OR
 - (2) IF YOU CONDUCTED A SITE-SPECIFIC CALCULATION FOR THE ESTIMATED SEDIMENT REMOVAL OF A 50-FOOT BUFFER, PROVIDE THE SPECIFIC REMOVAL EFFICIENCY, AND INFORMATION YOU RELIED UPON TO MAKE YOUR SITE-SPECIFIC CALCULATION.
 - INSERT DESCRIPTION OF ADDITIONAL EROSION AND SEDIMENT CONTROLS TO BE USED IN COMBINATION WITH NATURAL BUFFER AREA
 - INSERT THE FOLLOWING INFORMATION:
 - (1) SPECIFY THE MODEL OR OTHER TOOL USED TO ESTIMATE SEDIMENT LOAD REDUCTIONS FROM THE COMBINATION OF THE BUFFER AREA AND ADDITIONAL EROSION AND SEDIMENT CONTROLS INSTALLED AT YOUR SITE, AND
 - (2) INCLUDE THE RESULTS OF CALCULATIONS SHOWING THAT THE COMBINATION OF YOUR BUFFER AREA AND THE ADDITIONAL EROSION AND SEDIMENT CONTROLS INSTALLED AT YOUR SITE WILL MEET OR EXCEED THE SEDIMENT REMOVAL EFFICIENCY OF A 50-FOOT BUFFER

It is infeasible to provide and maintain an undisturbed natural buffer of any size, therefore I will implement erosion and sediment controls that achieve the sediment load reduction equivalent to a 50-foot undisturbed natural buffer.

- DESCRIPTION OF WHY IT IS NOT FEASIBLE
- INSERT EITHER ONE OF THE FOLLOWING:
(1) THE ESTIMATED SEDIMENT REMOVAL FROM A 50-FOOT BUFFER USING APPLICABLE TABLES IN APP. G, ATTACHMENT 1. INCLUDE INFORMATION ABOUT THE BUFFER VEGETATION AND SOIL TYPE THAT PREDOMINATE AT YOUR SITE
OR
(2) IF YOU CONDUCTED A SITE-SPECIFIC CALCULATION FOR THE ESTIMATED SEDIMENT REMOVAL OF A 50-FOOT BUFFER, PROVIDE THE SPECIFIC REMOVAL EFFICIENCY, AND INFORMATION YOU RELIED UPON TO MAKE YOUR SITE-SPECIFIC CALCULATION.
- INSERT DESCRIPTION OF ADDITIONAL EROSION AND SEDIMENT CONTROLS TO BE USED IN COMBINATION WITH NATURAL BUFFER AREA
- INSERT THE FOLLOWING INFORMATION:
 - (1) SPECIFY THE MODEL OR OTHER TOOL USED TO ESTIMATE SEDIMENT LOAD REDUCTIONS FROM THE EROSION AND SEDIMENT CONTROLS INSTALLED AT YOUR SITE, AND
 - (2) INCLUDE THE RESULTS OF CALCULATIONS SHOWING THAT THE ADDITIONAL EROSION AND SEDIMENT CONTROLS INSTALLED AT YOUR SITE WILL MEET OR EXCEED THE SEDIMENT REMOVAL EFFICIENCY OF A 50-FOOT BUFFER

I qualify for one of the exceptions in Part 2.1.2.1.e. (If you have checked this box, provide information on the applicable buffer exception that applies, below.)

Buffer Exceptions

Which of the following exceptions to the buffer requirements applies to your site?

- There is no discharge of stormwater to the surface water that is located 50 feet from my construction disturbances.
(Note: If this exception applies, no further documentation is required for Section 4.1 of the Template.)
- No natural buffer exists due to preexisting development disturbances that occurred prior to the initiation of planning for this project.
(Note (1): If this exception applies, no further documentation is required for Section 4.1 of the Template.)
(Note (2): Where some natural buffer exists but portions of the area within 50 feet of the surface water are occupied by preexisting development disturbances, you must still comply with the one of the CGP Part 2.1.2.1.a compliance alternatives.)
- For a "linear project" (defined in Appendix A), site constraints (e.g., limited right-of-way) make it infeasible for me to meet any of the CGP Part 2.1.2.1.a compliance alternatives. INCLUDE DOCUMENTATION HERE OF THE FOLLOWING: (1) WHY IT IS INFEASIBLE FOR YOU TO MEET ONE OF THE BUFFER COMPLIANCE ALTERNATIVES, AND (2) BUFFER WIDTH RETAINED AND/OR SUPPLEMENTAL EROSION AND SEDIMENT CONTROLS TO TREAT DISCHARGES TO THE SURFACE WATER

The project qualifies as “small residential lot” construction (defined in Part 2.1.2.1.e.iv and in Appendix A).

For Alternative 1 (see Appendix G, Part G.2.3.2.a):

- INSERT WIDTH OF NATURAL BUFFER TO BE RETAINED
- INSERT APPLICABLE REQUIREMENTS BASED ON TABLE G-1
- INSERT DESCRIPTION OF HOW YOU WILL COMPLY WITH THESE REQUIREMENTS

For Alternative 2 (see Appendix G, Part G.2.3.2.b):

- INSERT (1) THE ASSIGNED RISK LEVEL BASED ON APPLICABLE TABLE IN APP. G, PART G.2.3.2.b, AND (2) THE PREDOMINANT SOIL TYPE AND AVERAGE SLOPE AT YOUR SITE
- INSERT APPLICABLE REQUIREMENTS BASED ON APP. G, TABLE G-7
- INSERT DESCRIPTION OF HOW YOU WILL COMPLY WITH THESE REQUIREMENTS

Buffer disturbances are authorized under a CWA Section 404 permit. INSERT DESCRIPTION OF ANY EARTH DISTURBANCES THAT WILL OCCUR WITHIN THE BUFFER AREA

(Note (1): If this exception applies, no further documentation is required for Section 4.1 of the Template.)

(Note (2): This exception only applies to the limits of disturbance authorized under the Section 404 permit, and does not apply to any upland portion of the construction project.)

Buffer disturbances will occur for the construction of a water-dependent structure or water access area (e.g., pier, boat ramp, and trail). INSERT DESCRIPTION OF ANY EARTH DISTURBANCES THAT WILL OCCUR WITHIN THE BUFFER AREA

(Note (1): If this exception applies, no further documentation is required for Section 4.1 of the Template.)

4.2 Perimeter Controls

General

- The perimeter of the site where sediment could be expected to migrate off site will contain a silt sock barrier that will to capture siltation and runoff.

Specific Perimeter Controls

Perimeter Control # 1

Perimeter Control Description

- Silt sock barrier
- See SWPP Plan – Site Plan

Installation

- INSERT APPROXIMATE DATE OF INSTALLATION

Maintenance Requirements

- Weekly inspection and removal of sediment once it reaches at least ½ way up the barrier.

[Repeat as needed for individual perimeter controls.]

4.3 Sediment Track-Out

General

- **Rip rap stabilized construction entrance.**

Specific Track-Out Controls

Track-Out Control # 1

Track-Out Control Description

- **Rip rap stabilized construction entrances at points where they meet existing driveway pavement off of Perry Driveway**
- **See SWPP Plan – Site Plan**

Installation

- **INSERT APPROXIMATE DATE OF INSTALLATION**

Maintenance Requirements

- **Monitor and maintain the Stabilized Construction Entrance shown on the SWPPP Plan to ensure that it is cleaned and functioning correctly to prevent tracking of sediment by construction that exit the Site.**
- **Where sediment has been tracked-out from the site onto the surface of off-site streets, other paved areas, and sidewalks, you must remove the deposited sediment by the end of the same work day in which the track-out occurs or by the end of the next work day if track-out occurs on a non-work day. You must remove the track-out by sweeping, shoveling, or vacuuming these surfaces, or by using other similarly effective means of sediment removal. Hosing or sweeping tracked-out sediment into any stormwater conveyance (unless it is connected to a sediment basin, sediment trap, or similarly effective control), storm drain inlet, or surface water.”) is prohibited.**

[Repeat as needed for individual track-out controls.]

4.4 Stockpiled Sediment or Soil

General

- **Stockpiled Material will be encircled with a silt sock barrier**

Specific Stockpile Controls

Stockpile Control # 1

Stockpiled Sediment/Soil Control Description

- **Silt sock will be placed around the perimeter of the stockpiled material.**
- **See SWPP Plan – Site Plan**

Installation

- **INSERT APPROXIMATE DATE OF INSTALLATION**

Maintenance Requirements

- **Inspect barriers weekly or after a rain storm and remove sediment if it has reached ½ way up the barrier.**

[Repeat as needed for individual stockpile controls.]

4.5 Minimize Dust

General

- A water truck will be used for dust control.

Specific Dust Controls

Dust Control # 1

Dust Control Description

- A water truck will be used for dust control.

Installation

- n/a

Maintenance Requirements

- n/a

[Repeat as needed for individual dust controls.]

4.6 Minimize the Disturbance of Steep Slopes

General

- Erosion control will be used to minimize siltation from slopes to be disturbed.

Specific Steep Slope Controls

Steep Slope Control # 1

Steep Slope Control Description

- INSERT DESCRIPTION OF STEEP SLOPE CONTROL TO BE INSTALLED
- INCLUDE COPIES OF DESIGN SPECIFICATIONS HERE

Installation

- INSERT APPROXIMATE DATE OF INSTALLATION

Maintenance Requirements

- INSERT MAINTENANCE REQUIREMENTS FOR THE STEEP SLOPE CONTROL

[Repeat as needed for individual steep slope controls.]

4.7 Topsoil

General

- The existing topsoil will be stripped and stockpiled on the site and reused in areas of the site where it is appropriate: lawns, parking & driveway side slopes, etc. The remainder will be removed from the site to locations TBD.

Specific Topsoil Controls

Topsoil Control # 1

Topsoil Control Description

- **Topsoil will be stripped and stockpiled on the site and handled in accordance with the specifications of other stockpiles**
- **See Section 4.4**
- **See SWPP Plan – Appendix A**

Installation

- **INSERT APPROXIMATE DATE OF INSTALLATION**

Maintenance Requirements

- **Same as Section 4.4**

[Repeat as needed for individual topsoil controls.]

4.8 Soil Compaction

General

- **Areas of landscaping will be handled in accordance with local landscaping practice. Storm water basin construction will be handled in accordance with the guidance in the MA DEP Stormwater standards.**

Specific Soil Compaction Controls

Soil Compaction Control # 1

Soil Compaction Control Description

- **Storm water basin construction will be in accordance with MA DEP Stormwater standards.**
- **See definitive plans – Appendix A**

Installation

- **INSERT APPROXIMATE DATE OF INSTALLATION**

Maintenance Requirements

- **Storm water basins will be cleaned on an annual basis, or more if necessary.**
-

[Repeat as needed for individual soil compaction controls.]

4.9 Storm Drain Inlets

General

- **Storm drain inlets will be protected through the use of silt socks within drainage swales. Catch basins will be protected by silt socks around the grates or with silt bags inserted in the structure.**

Specific Storm Drain Inlet Controls

Storm Drain Inlet Control # 1

Storm Drain Inlet Control Description

- **Silt socks**
- **See SWPP Plan – Appendix A**

Installation

- **INSERT APPROXIMATE DATE OF INSTALLATION**

Maintenance Requirements

- **Clean, or remove and replace, the protection measures as sediment accumulates, the filter becomes clogged, and/or performance is compromised. Where there is evidence of sediment accumulation adjacent to the inlet protection measure, you must remove the deposited sediment by the end of the same work day in which it is found or by the end of the following work day if removal by the same work day is not feasible.**

Storm Drain Inlet Control # 2

Storm Drain Inlet Control Description

- **Silt socks around grates or silt sacks in catch basins**
- **See SWPP Plan – Appendix A**

Installation

- **INSERT APPROXIMATE DATE OF INSTALLATION**

Maintenance Requirements

- **Clean, or remove and replace, the protection measures as sediment accumulates, the filter becomes clogged, and/or performance is compromised. Where there is evidence of sediment accumulation adjacent to the inlet protection measure, you must remove the deposited sediment by the end of the same work day in which it is found or by the end of the following work day if removal by the same work day is not feasible.**

[Repeat as needed for individual storm drain inlet controls.]

4.10 Constructed Stormwater Conveyance Channels

General

- **Rip rap devices will be used at all outlets.**

Specific Conveyance Channel Controls

Stormwater Conveyance Channel Control # 1

Stormwater Conveyance Channel Control Description

- **Rip rap outlet to drain outlet pipes**
- **See Site Plan**

Installation

- **INSERT APPROXIMATE DATE OF INSTALLATION**

Maintenance Requirements

- **Rip rap shall be inspected weekly and after every rainstorm. If erosion is taking place the stone shall be replenished.**

[Repeat as needed for individual stormwater conveyance channel controls.]

4.11 Sediment Basins

General

- **The storm water basin will not be used as sediment basin during construction. Sediment basins will be constructed as necessary to control sediment close to the source and to prevent it from exiting site or going into the storm water basin.**

Specific Sediment Basin Controls

Sediment Basin Control # 1

Sediment Basin Control Description

Installation

- **INSERT APPROXIMATE DATE OF INSTALLATION**

Maintenance Requirements

- **Sediment basins will be inspected weekly and after every rain event greater than 0.5". Once the sediment in the forebay reaches 1/2 of depth the sediment will be removed.**
- **Once construction has stopped and the site is fully stabilized the basin will be revegetated as necessary to bring it into compliance with the definitive plans.**

(Note: At a minimum, you must comply with following requirement in CGP Part 2.1.3.2.b: "Keep in effective operating condition and remove accumulated sediment to maintain at least 1/2 of the design capacity of the sediment basin at all times.")

[Repeat as needed for individual sediment basin controls.]

4.12 Chemical Treatment

Soil Types

List all the soil types (including soil types expected to be found in fill material) that are expected to be exposed during construction and that will be discharged to locations where chemicals will be applied:

None anticipated

Treatment Chemicals

List all treatment chemicals that will be used at the site and explain why these chemicals are suited to the soil characteristics: **INSERT TEXT HERE**

Describe the dosage of all treatment chemicals you will use at the site or the methodology you will use to determine dosage: **INSERT TEXT HERE**

Provide information from any applicable Material Safety Data Sheets (MSDS): **INSERT TEXT HERE**

Describe how each of the chemicals will stored: **INSERT TEXT HERE**

Include references to applicable state or local requirements affecting the use of treatment chemicals, and copies of applicable manufacturer's specifications regarding the use of your specific treatment chemicals and/or chemical treatment systems: [INSERT TEXT HERE](#)

Special Controls for Cationic Treatment Chemicals (if applicable)

If you have been authorized by your applicable Regional Office to use cationic treatment chemicals, include the official EPA authorization letter or other communication, and identify the specific controls and implementation procedures you are required to implement to ensure that your use of cationic treatment chemicals will not lead to a violation of water quality standards: [INSERT \(1\) ANY LETTERS OR OTHER DOCUMENTS SENT FROM THE EPA REGIONAL OFFICE CONCERNING YOUR USE OF CATIONIC TREATMENT CHEMICALS, AND \(2\) DESCRIPTION OF ANY SPECIFIC CONTROLS YOU ARE REQUIRED TO IMPLEMENT](#)

Schematic Drawings of Stormwater Controls/Chemical Treatment Systems

Provide schematic drawings of any chemically-enhanced stormwater controls or chemical treatment systems to be used for application of treatment chemicals: [INSERT TEXT HERE](#)

Training

Describe the training that personnel who handle and apply chemicals have received prior to permit coverage, or will receive prior to the use of treatment chemicals: [INSERT TEXT HERE](#)

4.13 Dewatering Practices

General

- [Dewatering is not expected to be necessary](#)

Specific Dewatering Practices

Dewatering Practice # 1

Dewatering Practice Description

- [Installation of a sump pipe with trash pump in the area of the excavation](#)
- [Discharge will take place in a sediment basin, which will allow the water to infiltrate into the ground away from the property lines.](#)

Installation

- [INSERT APPROXIMATE DATE OF INSTALLATION](#)

Maintenance Requirements

- [Create a stone sump if necessary to ameliorate velocity and to encourage infiltration. If necessary, use silt socks or hay bales to contain.](#)

[Repeat as needed for individual dewatering practices.]

4.14 Other Stormwater Controls

General

- [INSERT GENERAL DESCRIPTION OF THE PROBLEM THIS CONTROL IS DESIGNED TO ADDRESS](#)

Specific Stormwater Control Practices

Stormwater Control Practice # 1

Description

- INSERT DESCRIPTION OF PRACTICE TO BE INSTALLED
- IF APPLICABLE INCLUDE COPIES OF DESIGN SPECIFICATIONS HERE

Installation

- INSERT APPROXIMATE DATE OF INSTALLATION

Maintenance Requirements

- INSERT MAINTENANCE REQUIREMENTS FOR THE STORMWATER CONTROL PRACTICE

[Repeat as needed.]

4.15 Site Stabilization

DRAFT

Site Stabilization Practice (only use this if you are not located in an arid, semi-arid, or drought-stricken area)

- Vegetative Non-Vegetative
 Temporary Permanent

Description of Practice

- **Temporary stabilization of disturbed areas.**
- **No later than 14 days after initiation of soil stabilization measures the portion of the site in question will be planted with temporary cover using either standard seeding or hydroseeding.**
- **Seed mixture shall be based on the Massachusetts Conservation Guide Vol. II – Vegetated Practices in Site Development Table 1 – Seedings for Temporary Cover and is dependent on the time of year and the weather conditions.**

Installation

- INSERT APPROXIMATE DATE OF INSTALLATION
- INSERT APPROXIMATE COMPLETION DATE CONSISTENT WITH CGP PART 2.2.1.2

Maintenance Requirements

Seeded areas should be refertilized with ½ of the establishment amount in the second growing season and subsequently as needed.

[Repeat as needed for additional stabilization practices.]

Site Stabilization Practice (only use this if you are located in an arid, semi-arid, or drought-stricken area)

- Vegetative Non-Vegetative
 Temporary Permanent

Description of Practice

- **Permanent stabilization of disturbed areas.**
- **Final stabilization in areas to be vegetated will be done in accordance Section 2.2.2 of the general permit.**
- **Seed mixture shall be based on the Massachusetts Conservation Guide Vol. II – Vegetated Practices in Site Development Table 2 – Seed Mixtures for Permanent Cover and is dependent on the time of year and the weather conditions.**
-

Installation

- FOR VEGETATIVE STABILIZATION IN ARID OR SEMI-ARID AREAS, INDICATE THE BEGINNING AND ENDING DATES OF THE SEASONALLY DRY PERIOD AND DESCRIBE YOUR SITE CONDITIONS
- INSERT APPROXIMATE DATE OF INSTALLATION
- INSERT APPROXIMATE COMPLETION DATE CONSISTENT WITH CGP PART 2.2.1.3

Maintenance Requirements

Seeded areas should be refertilized with ½ of the establishment amount in the second growing season and subsequently as needed.

[Repeat as needed for additional stabilization practices.]

Site Stabilization Practice (only use this if uncontrollable circumstances have delayed the initiation or completion of stabilization)

(Note: You will not be able to include this information in your initial SWPPP. If you are affected by circumstances such as those described in CGP Part 2.2.1.3.b, you will need to modify your SWPPP to include this information.)

- Vegetative Non-Vegetative
 Temporary Permanent

Justification

- INSERT DESCRIPTION OF CIRCUMSTANCES THAT PREVENT YOU FROM MEETING THE DEADLINES REQUIRED IN CGP PARTS 2.2.1.1 AND/OR 2.2.1.2 AND THE SCHEDULE YOU WILL FOLLOW FOR INITIATING AND COMPLETING STABILIZATION

Description of Practice

- INSERT DESCRIPTION OF STABILIZATION PRACTICE TO BE INSTALLED
- NOTE HOW DESIGN WILL MEET REQUIREMENTS OF PART 2.2.2.1 OR 2.2.2.2, WHICHEVER APPLIES
- INCLUDE COPIES OF DESIGN SPECIFICATIONS HERE


Installation

- INSERT DATES OF INITIATION AND COMPLETION OF NON-VEGETATIVE STABILIZATION CONTROLS (must be completed within 14 days of the cessation of construction)

Maintenance Requirements

INSERT MAINTENANCE REQUIREMENTS FOR THE STABILIZATION PRACTICE

[Repeat as needed for additional stabilization practices.]

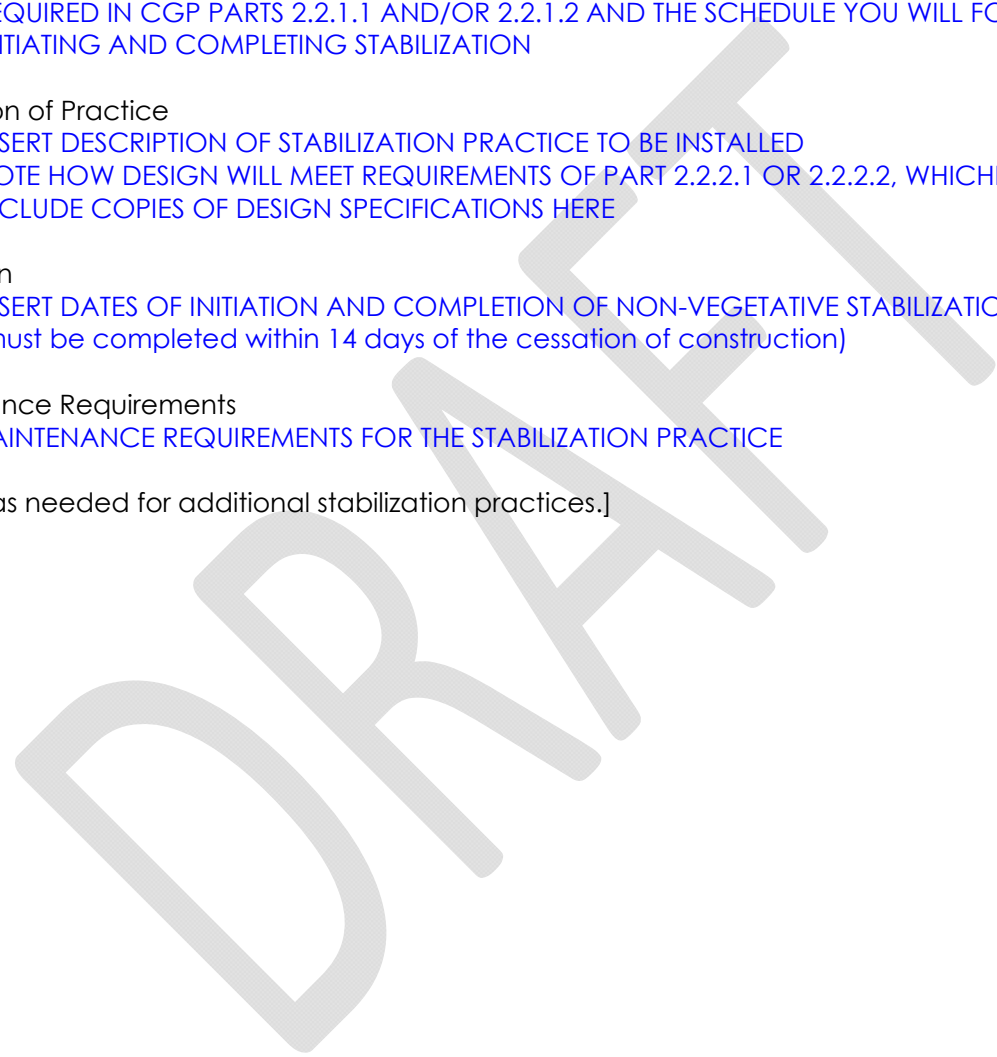

SECTION 5: POLLUTION PREVENTION STANDARDS

5.1 Potential Sources of Pollution

Construction Site Pollutants

Pollutant-Generating Activity	Pollutants or Pollutant Constituents (that could be discharged if exposed to stormwater)	Location on Site (or reference SWPPP site map where this is shown)
Fueling of vehicles	Gasoline or diesel	Only on paved surfaces, to include existing Perry Drive

[Include additional rows as necessary.]

5.2 Spill Prevention and Response

Any spills of petroleum products will be cleaned using available sorbent material, to include sand, gravel, earth, or other dry clean up measures. If the spill is so large that it enters a catch basin then ensure that the basin is properly emptied so that the materials do not exit the structure. If necessary, contact the Foxboro Fire Department at 911 and direct them to the project site.

5.3 Fueling and Maintenance of Equipment or Vehicles

General

- Fueling will only take place on pavement where spills can be readily cleaned-up. Ensure that adequate absorbent, spill clean-up materials are available on the site. If necessary, drip pans will be used under vehicles that leak. Those vehicles shall be removed from the site and repaired before being allowed to return. No storage of fuels or lubricants will take place on site. No maintenance will take place on site.

Specific Pollution Prevention Practices

Pollution Prevention Practice # 1

Description

- Fueling will only take place on pavement and adequate absorbent, spill clean-up materials will be available on site.

Installation

- INSERT APPROXIMATE DATE OF INSTALLATION

Maintenance Requirements

- Ensure that adequate materials are maintained on site.

[Repeat as needed.]

5.4 Washing of Equipment and Vehicles

General

- No washing of equipment or vehicles will be done on site.

Specific Pollution Prevention Practices

Pollution Prevention Practice # 1

Description

- INSERT DESCRIPTION OF PRACTICE TO BE INSTALLED
- IF APPLICABLE INCLUDE COPIES OF DESIGN SPECIFICATIONS HERE

Installation

- INSERT APPROXIMATE DATE OF INSTALLATION

Maintenance Requirements

- INSERT MAINTENANCE REQUIREMENTS FOR THE POLLUTION PREVENTION PRACTICE

[Repeat as needed.]

5.5 Storage, Handling, and Disposal of Construction Products, Materials, and Wastes

5.5.1 Building Products

(Note: Examples include asphalt sealants, copper flashing, roofing materials, adhesives, concrete admixtures.)

General

- **Building products not designed to come in contact with rain will be stored under cover.**

Specific Pollution Prevention Practices

Pollution Prevention Practice # 1

Description

- **Building products not designed to come in contact with rain will be stored under cover.**

Installation

- INSERT APPROXIMATE DATE OF INSTALLATION

Maintenance Requirements

- INSERT MAINTENANCE REQUIREMENTS FOR THE POLLUTION PREVENTION PRACTICE

[Repeat as needed.]

5.5.2 Pesticides, Herbicides, Insecticides, Fertilizers, and Landscape Materials

General

- **Shall not be stored on site. Application shall be done at a rate and in amounts consistent with the manufacturer's specifications.**

Specific Pollution Prevention Practices

Pollution Prevention Practice # 1

Description

- **Application shall be done at a rate and in amounts consistent with the manufacturer's specifications.**
- **See manufacturer's specifications**

Installation

- INSERT APPROXIMATE DATE OF INSTALLATION

Maintenance Requirements

- INSERT MAINTENANCE REQUIREMENTS FOR THE POLLUTION PREVENTION PRACTICE

[Repeat as needed.]

5.5.3 Diesel Fuel, Oil, Hydraulic Fluids, Other Petroleum Products, and Other Chemicals

General

- **No fuels or petroleum products will be stored on site.**

Specific Pollution Prevention Practices

Pollution Prevention Practice # 1

Description

- INSERT DESCRIPTION OF PRACTICE TO BE INSTALLED
- IF APPLICABLE INCLUDE COPIES OF DESIGN SPECIFICATIONS HERE

Installation

- INSERT APPROXIMATE DATE OF INSTALLATION

Maintenance Requirements

- INSERT MAINTENANCE REQUIREMENTS FOR THE POLLUTION PREVENTION PRACTICE

[Repeat as needed.]

5.5.4 Hazardous or Toxic Waste

(Note: Examples include paints, solvents, petroleum-based products, wood preservatives, additives, curing compounds, acids.)

General

- INSERT GENERAL DESCRIPTION OF HOW YOU WILL COMPLY WITH CGP PART 2.3.3.3.d

Specific Pollution Prevention Practices

Pollution Prevention Practice # 1

Description

- INSERT DESCRIPTION OF PRACTICE TO BE INSTALLED
- IF APPLICABLE INCLUDE COPIES OF DESIGN SPECIFICATIONS HERE

Installation

- INSERT APPROXIMATE DATE OF INSTALLATION

Maintenance Requirements

- INSERT MAINTENANCE REQUIREMENTS FOR THE POLLUTION PREVENTION PRACTICE

[Repeat as needed.]

5.5.5 Construction and Domestic Waste

(Note: Examples include packaging materials, scrap construction materials, masonry products, timber, pipe and electrical cuttings, plastics, styrofoam, concrete, and other trash or building materials.)

General

- **Dumpsters will be used for waste from the commercial building construction.**

Specific Pollution Prevention Practices

Pollution Prevention Practice # 1

Description

- **Dumpsters will be used for materials waste for building construction. The location of the dumpsters will be determined on a case by case basis as the building is built.**
-

Installation

- INSERT APPROXIMATE DATE OF INSTALLATION

Maintenance Requirements

- **Remove from site when full.**

[Repeat as needed.]

5.5.6 Sanitary Waste

General

- **Porta-johns will be used on the site for human waste.**

Specific Pollution Prevention Practices

Pollution Prevention Practice # 1

Description

- **Porta-johns will be used on the site as necessary. The number of porta-johns will be based on the worker population. Typically, one will be sufficient.**

Installation

- **They will be used on the site from the start to the end of construction.**

Maintenance Requirements

- **Typical maintenance will involve pumping and cleaning once per week depending on the population size.**

[Repeat as needed.]

5.6 Washing of Applicators and Containers used for Paint, Concrete or Other Materials

General

- **Direct all washwater into leak proof containers designed so that no overflows can occur. Do not dump liquid wastes in storm sewers. Remove and dispose of hardened concrete in accordance with other solid wastes generated on site.**

Specific Pollution Prevention Practices

Pollution Prevention Practice # 1

Description

- INSERT DESCRIPTION OF PRACTICE TO BE INSTALLED
- IF APPLICABLE INCLUDE COPIES OF DESIGN SPECIFICATIONS HERE

Installation

- INSERT APPROXIMATE DATE OF INSTALLATION

Maintenance Requirements

- INSERT MAINTENANCE REQUIREMENTS FOR THE POLLUTION PREVENTION PRACTICE

[Repeat as needed.]

5.7 Fertilizers

General

- **Shall not be stored on site. Application shall be done at a rate and in amounts consistent with the manufacturer's specifications.**

Specific Pollution Prevention Practices

Pollution Prevention Practice # 1

Description

- **Application shall be done at a rate and in amounts consistent with the manufacturer's specifications.**

Installation

- INSERT APPROXIMATE DATE OF INSTALLATION

Maintenance Requirements

- INSERT MAINTENANCE REQUIREMENTS FOR THE POLLUTION PREVENTION PRACTICE

[Repeat as needed for individual fertilizer practices.]

5.8 Other Pollution Prevention Practices

General

- INSERT GENERAL DESCRIPTION OF THE PROBLEM THIS CONTROL IS DESIGNED TO ADDRESS

Specific Pollution Prevention Practices

Pollution Prevention Practice # 1

Description

- INSERT DESCRIPTION OF PRACTICE TO BE INSTALLED
- IF APPLICABLE INCLUDE COPIES OF DESIGN SPECIFICATIONS HERE

Installation

- INSERT APPROXIMATE DATE OF INSTALLATION

Maintenance Requirements

- INSERT MAINTENANCE REQUIREMENTS FOR THE POLLUTION PREVENTION PRACTICE

[Repeat as needed.]

SECTION 6: INSPECTION AND CORRECTIVE ACTION

6.1 Inspection Personnel and Procedures

Personnel Responsible for Inspections

INSERT NAMES OF PERSONNEL OR TYPES OF PERSONNEL WHO WILL BE CONDUCTING SITE INSPECTIONS HERE

Note: All personnel conducting inspections must be considered a "qualified person." CGP Part 4.1.1 clarifies that a "qualified person" is a person knowledgeable in the principles and practices of erosion and sediment controls and pollution prevention, who possesses the skills to assess conditions at the construction site that could impact stormwater quality, and the skills to assess the effectiveness of any stormwater controls selected and installed to meet the requirements of this permit.

Inspection Schedule

Specific Inspection Frequency

Inspections will take place once every 7 days or more often if a rain event greater than 0.25" has occurred.

Rain Gauge Location (if applicable)

SPECIFY LOCATION(S) OF RAIN GAUGE TO BE USED FOR DETERMINING WHETHER A RAIN EVENT OF 0.25 INCHES OR GREATER HAS OCCURRED (only applies to inspections conducted for Part 4.1.2.2, 4.1.3, or 4.1.4.2)

Reductions in Inspection Frequency (if applicable)

- For the reduction in inspections resulting from stabilization: SPECIFY (1) LOCATIONS WHERE STABILIZATION STEPS HAVE BEEN COMPLETED AND (2) DATE THAT THEY WERE COMPLETED (Note: It is likely that you will not be able to include this in your initial SWPPP. If you qualify for this reduction (see CGP Part 4.1.4.1), you will need to modify your SWPPP to include this information.)
- For the reduction in inspections in arid, semi-arid, or drought-stricken areas: INSERT BEGINNING AND ENDING DATES OF THE SEASONALLY-DEFINED ARID PERIOD FOR YOUR AREA OR THE VALID PERIOD OF DROUGHT
- For reduction in inspections due to frozen conditions: INSERT BEGINNING AND ENDING DATES OF FROZEN CONDITIONS ON YOUR SITE

Inspection Report Forms

See Appendix D

6.2 Corrective Action

Personnel Responsible for Corrective Actions

INSERT NAMES OF PERSONNEL OR TYPES OF PERSONNEL RESPONSIBLE FOR CORRECTIVE ACTIONS

Corrective Action Forms

See Appendix E

6.3 Delegation of Authority

Duly Authorized Representative(s) or Position(s):

Insert Company or Organization Name:

Insert Name:

Insert Position:

Insert Address:

Insert City, State, Zip Code:

Insert Telephone Number:

Insert Fax/Email:

DRAFT

SECTION 7: TRAINING

Table 7-1: Documentation for Completion of Training

Name	Date Training Completed
INSERT NAME OF PERSONNEL HERE	INSERT COMPLETION DATE HERE
INSERT NAME OF PERSONNEL HERE	INSERT COMPLETION DATE HERE
INSERT NAME OF PERSONNEL HERE	INSERT COMPLETION DATE HERE
INSERT NAME OF PERSONNEL HERE	INSERT COMPLETION DATE HERE
INSERT NAME OF PERSONNEL HERE	INSERT COMPLETION DATE HERE
INSERT NAME OF PERSONNEL HERE	INSERT COMPLETION DATE HERE
INSERT NAME OF PERSONNEL HERE	INSERT COMPLETION DATE HERE
INSERT NAME OF PERSONNEL HERE	INSERT COMPLETION DATE HERE
INSERT NAME OF PERSONNEL HERE	INSERT COMPLETION DATE HERE
INSERT NAME OF PERSONNEL HERE	INSERT COMPLETION DATE HERE
INSERT NAME OF PERSONNEL HERE	INSERT COMPLETION DATE HERE
INSERT NAME OF PERSONNEL HERE	INSERT COMPLETION DATE HERE
INSERT NAME OF PERSONNEL HERE	INSERT COMPLETION DATE HERE
INSERT NAME OF PERSONNEL HERE	INSERT COMPLETION DATE HERE
INSERT NAME OF PERSONNEL HERE	INSERT COMPLETION DATE HERE

DRAFT

SECTION 8: CERTIFICATION AND NOTIFICATION

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Name: _____ Title: _____

Signature: _____ Date: _____

[Repeat as needed for multiple construction operators at the site.]

DRAFT

SWPPP APPENDICES

Attach the following documentation to the SWPPP:

Appendix A – Site Maps

Appendix B – Copy of 2017 CGP

Appendix C – NOI and EPA Authorization Email

Appendix D – Inspection Forms

Stormwater Construction Site Inspection Report

Checklist for Catch Basin

Checklist for Tree Box Filter

Checklist for Infiltration Basin

Appendix E – Corrective Action Form

Appendix F – SWPPP Amendment Log

Appendix G – Subcontractor Certifications/Agreements

Appendix H – Grading and Stabilization Activities Log

Appendix I – Training Log

Appendix J – Delegation of Authority

Appendix K – Endangered Species Documentation

Appendix L – Historic Preservation Documentation

Appendix A – Site Maps

INSERT SITE MAPS CONSISTENT WITH TEMPLATE SECTION 2.6

DRAFT

Appendix B – Copy of 2017 CGP

INSERT COPY OF 2017 CGP

DRAFT

Appendix C – Copy of NOI and EPA Authorization email

INSERT COPY OF NOI AND EPA'S AUTHORIZATION EMAIL PROVIDING COVERAGE UNDER THE CGP

DRAFT

Appendix D – Copy of Inspection Form

INSERT COPY OF ANY INSPECTION FORMS YOU WILL USE TO PREPARE INSPECTION REPORTS

DRAFT

Appendix E – Copy of Corrective Action Form

INSERT COPY OF CORRECTIVE ACTION FORMS YOU WILL USE

DRAFT

Appendix F –SWPPP Amendment Log

No.	Description of the Amendment	Date of Amendment	Amendment Prepared by [Name(s) and Title]

DRAFT

Appendix G – *Sample* Subcontractor Certifications/Agreements

SUBCONTRACTOR CERTIFICATION
STORMWATER POLLUTION PREVENTION PLAN

Project Number: _____

Project Title: _____

Operator(s): _____

As a subcontractor, you are required to comply with the Stormwater Pollution Prevention Plan (SWPPP) for any work that you perform on-site. Any person or group who violates any condition of the SWPPP may be subject to substantial penalties or loss of contract. You are encouraged to advise each of your employees working on this project of the requirements of the SWPPP. A copy of the SWPPP is available for your review at the office trailer.

Each subcontractor engaged in activities at the construction site that could impact stormwater must be identified and sign the following certification statement:

I certify under the penalty of law that I have read and understand the terms and conditions of the SWPPP for the above designated project and agree to follow the practices described in the SWPPP.

This certification is hereby signed in reference to the above-named project:

Company: _____

Address: _____

Telephone Number: _____

Type of construction service to be provided: _____

Signature: _____

Title: _____

Date: _____

Appendix H –Grading and Stabilization Activities Log

Date Grading Activity Initiated	Description of Grading Activity	Description of Stabilization Measure and Location	Date Grading Activity Ceased (Indicate Temporary or Permanent)	Date When Stabilization Measures Initiated

Appendix I –SWPPP Training Log

Stormwater Pollution Prevention Training Log

Project Name:

Project Location:

Instructor's Name(s):

Instructor's Title(s):

Course Location: _____ Date: _____

Course Length (hours): _____

Stormwater Training Topic: *(check as appropriate)*

- Sediment and Erosion Controls**
- Stabilization Controls**
- Pollution Prevention Measures**
- Emergency Procedures**
- Inspections/Corrective Actions**

Specific Training Objective: _____

Attendee Roster: *(attach additional pages as necessary)*

No.	Name of Attendee	Company
1		
2		
3		
4		
5		
6		
7		
8		

Appendix J –Delegation of Authority Form

Delegation of Authority

I, _____ (name), hereby designate the person or specifically described position below to be a duly authorized representative for the purpose of overseeing compliance with environmental requirements, including the Construction General Permit, at the _____ construction site. The designee is authorized to sign any reports, stormwater pollution prevention plans and all other documents required by the permit.

_____ (name of person or position)
_____ (company)
_____ (address)
_____ (city, state, zip)
_____ (phone)

By signing this authorization, I confirm that I meet the requirements to make such a designation as set forth in Appendix I of EPA's Construction General Permit (CGP), and that the designee above meets the definition of a "duly authorized representative" as set forth in Appendix I.

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Name: _____

Company: _____

Title: _____

Signature: _____

Date: _____

Appendix K – Endangered Species Documentation

INSERT DOCUMENTATION CONSISTENT WITH SWPPP TEMPLATE SECTION 3.1

DRAFT

Appendix L – Historic Properties Documentation

INSERT DOCUMENTATION CONSISTENT WITH SWPPP TEMPLATE SECTION 3.2

DRAFT

APPENDIX D – SOIL DATA

Soil Evaluation Forms
Grain Size Analysis & USDA Soil Textural Classification
NRCS Soil Resource Report

No. 21-0102

Date: March 22, 2023

Commonwealth of Massachusetts
Foxborough, Massachusetts

Soil Suitability Assessment for On-Site Sewage Disposal

Performed By: Cameron Gray Date: March 22, 2023

Witnessed By: _____

Location Address or Lot #: 7 Perry Drive Foxborough, Ma 02035 New Construction: <input checked="" type="checkbox"/> Repair <input type="checkbox"/>	Owner's Name, Address, and Telephone #: Technimetals 7 Perry Drive Foxborough, MA 02035 508.698.2444
--	---

Office Review

Published Soil Survey Available: No Yes
 Year Published 1989 Publication Scale 1:25,000 Soil Map Unit Ridgebury FSL
 Drainage Class D Soil Limitations Bedrock
 Surficial Geology Report Available: No Yes
 Year Published 1992 Publication Scale 1:250,000
 Geologic Material (Map Unit) Coarse Deposits
 Landform Glacial Outwash Plain

Flood Insurance Rate Map:

Above 500 year flood boundary No Yes
 Within 500 year flood boundary No Yes
 Within 100 year flood boundary No Yes

Wetland Area:

National Wetland Inventory Map (map unit) _____

Wetlands Conservancy Program Map (map unit) _____

Current Water Resource Conditions (USGS): Month March, 2023

Range: Above Normal Normal Below Normal

Other References Reviewed: _____

Location Address or Lot No. 7 Perry Drive

On-site Review

Deep Hole Number: 1 Date: 3/22/2023 Time: 1100 Weather: 54°/Sunny

Location (identify on site plan) See site plan

Land Use Vacant Slope (%) 2% Surface Stones Some

Vegetation Wooded

Landform Glacial Outwash Plain

Position on landscape (sketch on back) See site plan

Distances from:

Open Water Body	<u>>200'</u>	Drainageway	<u>>100'</u>
Possible Wet Area	<u>>100'</u>	Property Line	<u>25'+/-</u>
Drinking Water Well	<u>>100'</u>	Other	<u> </u>

DEEP OBSERVATION HOLE LOG*					
Depth from Surface (inches)	Soil Horizon	Soil Texture (USDA)	Soil Color (Munsell)	Soil Mottling	Other (Structure, Stones, Boulders, Consistency, % Gravel)
0" - 9"	A	Sandy Loam	10YR3/2		Gravelly, Cobbly, Coarse
9" - 30"	B	Sandy Loam	10YR5/6		
30" - 72"	C	Loamy Sand	2.5Y6/6		

*MINIMUM OF TWO HOLES REQUIRED AT EVERY DISPOSAL AREA

Parent Material (geologic) Glacial outwash Depth to Bedrock:

Depth to Groundwater Standing Water in Hole: Weeping from Pit Face: 30"

Estimated Seasonal High Groundwater:

Location Address or Lot No. 7 Perry Drive

On-site Review

Deep Hole Number: 2 Date: 3/22/2023 Time: 1130 Weather: 54°/Sunny

Location (identify on site plan) See site plan

Land Use Vacant Slope (%) 2% Surface Stones Some

Vegetation Wooded

Landform Glacial Outwash Plain

Position on landscape (sketch on back) See site plan

Distances from:

Open Water Body	<u>>200'</u>	Drainageway	<u>>100'</u>
Possible Wet Area	<u>>100'</u>	Property Line	<u>25'+/-</u>
Drinking Water Well	<u>>100'</u>	Other	<u> </u>

DEEP OBSERVATION HOLE LOG*					
Depth from Surface (inches)	Soil Horizon	Soil Texture (USDA)	Soil Color (Munsell)	Soil Mottling	Other (Structure, Stones, Boulders, Consistency, % Gravel)
0" - 9"	A	Sandy Loam	10YR3/2		Gravelly, Cobbly
9" - 28"	B	Sandy Loam	10YR5/6		
28" - 72"	C	Sandy Loam	2.5Y6/6		

*MINIMUM OF TWO HOLES REQUIRED AT EVERY DISPOSAL AREA

Parent Material (geologic) Glacial outwash Depth to Bedrock:

Depth to Groundwater Standing Water in Hole: Weeping from Pit Face: 28"

Estimated Seasonal High Groundwater:

Location Address or Lot No. 7 Perry Drive

Commonwealth of Massachusetts

Foxborough , Massachusetts

Percolation Test*		
Date: March 22, 2023		Time:
Observation Hole #		
Depth of Perc		
Start Pre-soak		
End Pre-soak		
Time at 12"		
Time at 9"		
Time at 6"		
Time (9" – 6")		
Rate Min./Inch		

* Minimum of 1 percolation test must be performed in both the primary area AND reserve area.

Site Passed Site Failed

Performed By: _____

Witnessed By: _____

Comments: _____

Location Address or Lot No. 7 Perry Drive**Determination for Seasonal High Water Table****Method Used:**

- Depth observed standing in observation hole _____ inches
 Depth weeping from side of observation hole 28" inches
 Depth to soil mottles _____ inches
 Ground water adjustment _____ feet

Index Well Number _____ Reading Date _____ Index well level _____

Adjustment factor _____ Adjusted groundwater level _____

Depth of Naturally Occurring Pervious Material

Does at least four feet of naturally occurring pervious material exist in all areas observed throughout the area proposed for the soil absorption system? Yes

If not, what is the depth of naturally occurring pervious material? _____

Certification

I certify that on April, 1997 (date) I have passed the soil evaluator examination approved by the Department of Environmental Protection and that the above analysis was performed by me consistent with the required training expertise and experience described in 310 CMR 15.017.

Signature _____ Date _____

These test results apply only to the specific locations and materials noted and may not represent any other locations or elevations. This report may not be reproduced, except in full, without written permission by Professional Service Industries, Inc. If a non-compliance appears on this report, to the extent that the reported non-compliance impacts the project, the resolution is outside the PSI scope of engagement.

Approved Signatory: Yannick Lastennet (Department Manager)
Date of Issue: 4/7/2023

Daily Field Report

Client: BAY COLONY GROUP
4 SCHOOL ST.
P.O. BOX 9136
FOXBORO, MA 02035


CC:

Project: BAY COLONY GROUP - LAB TESTIN
CANTON, MA

Date: 4/5/2023

PSI Representative:

Soil Texture Triangle

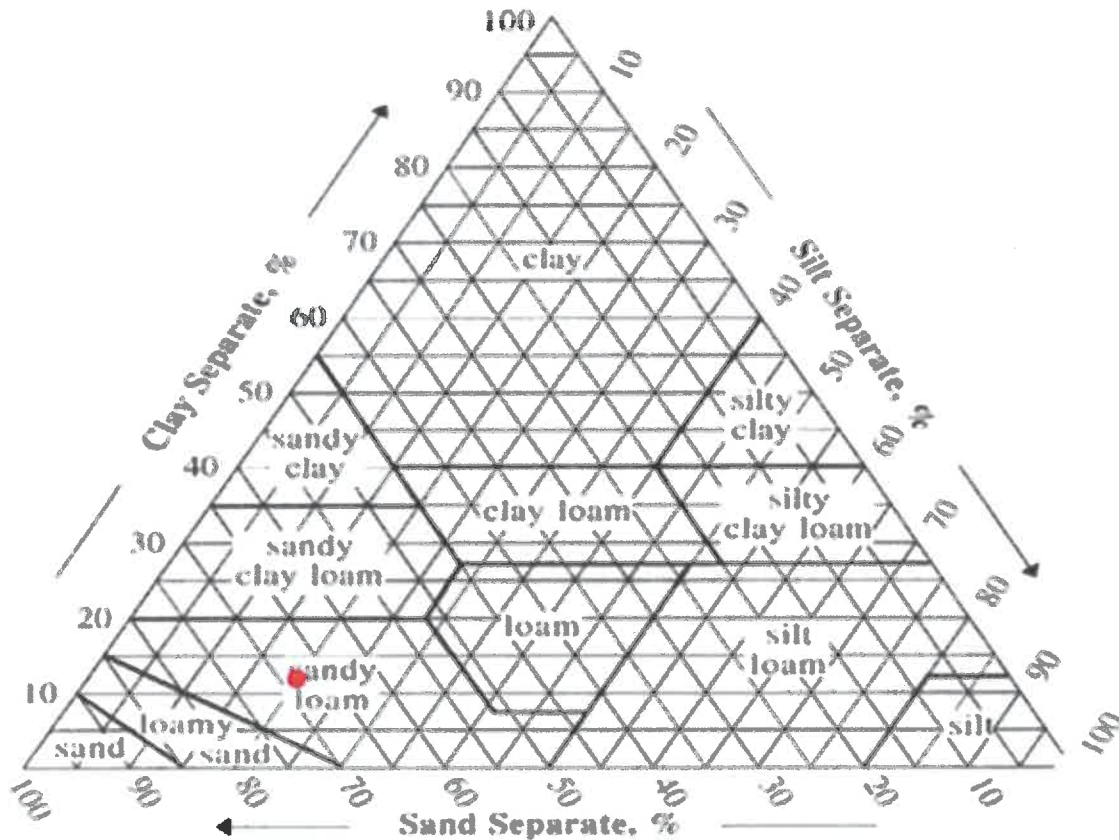

SOIL DATA					
Source	Sample No.	Percentages From Material Passing a #10 Sieve			Classification
		Sand	Silt	Clay	
● 7 Perry Dr. - Foxboro, MA (TP #2 @ 70")	S3	68.18	20.15	11.67	Sandy Loam



Professional Service Industries, Inc.
480 Neponset Street, Suite 9C
Canton, MA 02021

Phone: (781) 821-2355
Fax: (781) 821-6276

Report No: MAT:0446516-77-S3

Issue No: 1

These test results apply only to the specific locations and materials noted and may not represent any other locations or elevations. This report may not be reproduced, except in full, without written permission by Professional Service Industries, Inc. If a non-compliance appears on this report, to the extent that the reported non-compliance impacts the project, the resolution is outside the PSI scope of engagement.

Approved Signatory: Yannick Lastennet (Department Manager)
Date of Issue: 4/7/2023

Material Test Report

Client: BAY COLONY GROUP
4 SCHOOL ST., P.O. BOX 9136
FOXBORO, MA 02035

CC:


Project: BAY COLONY GROUP - LAB TESTING
CANTON, MA

Sample Details

Sample ID: 0446516-77-S3
Client Sample ID:
Date Sampled:
Sampled By: Others
Specification: Title V Hydrometer
Supplier:
Source:
Material:
Sampling Method:
General Location: 7 Perry Dr. - Foxboro, MA
Location: TP #2 @ 70"
Lift:

Sample Description:

Particle Size Distribution

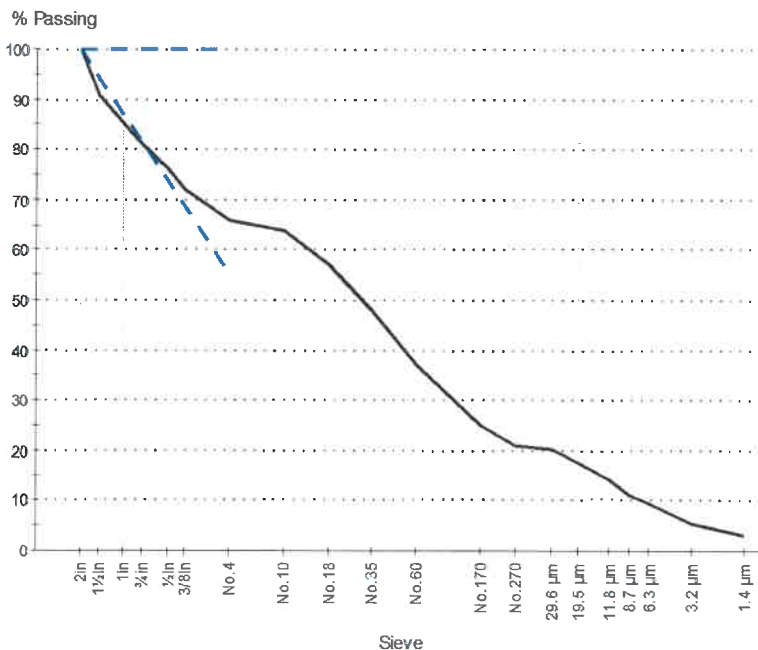

Grading: ASTM D 422

Date Tested: 4/3/2023
Tested By: Gary Brooks

Sieve Size	% Passing	Limits
2in (50.0mm)	100	100
1½in (37.5mm)	91	
1in (25.0mm)	85	
¾in (19.0mm)	81	
½in (12.5mm)	76	
3/8in (9.5mm)	72	
No. 4 (4.75mm)	66	55 to 100
No. 10 (2.0mm)	64	
No. 18 (1.0mm)	57	
No. 35 (500µm)	48	
No. 60 (250µm)	37	
No. 170 (90µm)	25	
No. 270 (53µm)	21	
29.6 µm	20.2	
19.5 µm	17.5	
11.8 µm	14.3	
8.7 µm	11.1	
6.3 µm	9.5	
3.2 µm	5.3	
1.4 µm	3.2	

COBBLES	GRAVEL		SAND			FINES	
	Coarse (19.2%)	Fine (14.9%)	Coarse (1.9%)	Medium (19.4%)	Fine (20.8%)	Silt (16.1%)	Clay (7.7%)
(0.0%)							

D85: 25.0000 **D60:** 1.3459 **D50:** 0.5833
D30: 0.1378 **D15:** 0.0132 **D10:** 0.0070
Cu: 193.14 **Cc:** 2.02



Professional Service Industries, Inc.
480 Neponset Street, Suite 9C
Canton, MA 02021

Phone: (781) 821-2355
Fax: (781) 821-6276

Report No: MAT:0446516-77-S3

Issue No: 1

These test results apply only to the specific locations and materials noted and may not represent any other locations or elevations. This report may not be reproduced, except in full, without written permission by Professional Service Industries, Inc. If a non-compliance appears on this report, to the extent that the reported non-compliance impacts the project, the resolution is outside the PSI scope of engagement.

Approved Signatory: Yannick Lastennet (Department Manager)
Date of Issue: 4/7/2023

Material Test Report

Client: BAY COLONY GROUP
4 SCHOOL ST., P.O. BOX 9136
FOXBORO, MA 02035

CC:

Project: BAY COLONY GROUP - LAB TESTING
CANTON, MA

Sample Details

Sample ID: 0446516-77-S3
Client Sample ID:
Date Sampled:
Sampled By: Others
Specification: Title V Hydrometer
Supplier:
Source:
Material:
Sampling Method:
General Location: 7 Perry Dr. - Foxboro, MA
Location: TP #2 @ 70"
Lift:

Other Test Results

Description	Method	Result	Limits
Dispersion device	ASTM D 422		
Dispersion time (min)			
Shape			
Hardness			

Comments

N/A



United States
Department of
Agriculture

NRCS

Natural
Resources
Conservation
Service

A product of the National
Cooperative Soil Survey,
a joint effort of the United
States Department of
Agriculture and other
Federal agencies, State
agencies including the
Agricultural Experiment
Stations, and local
participants

Custom Soil Resource Report for Norfolk and Suffolk Counties, Massachusetts



Preface

Soil surveys contain information that affects land use planning in survey areas. They highlight soil limitations that affect various land uses and provide information about the properties of the soils in the survey areas. Soil surveys are designed for many different users, including farmers, ranchers, foresters, agronomists, urban planners, community officials, engineers, developers, builders, and home buyers. Also, conservationists, teachers, students, and specialists in recreation, waste disposal, and pollution control can use the surveys to help them understand, protect, or enhance the environment.

Various land use regulations of Federal, State, and local governments may impose special restrictions on land use or land treatment. Soil surveys identify soil properties that are used in making various land use or land treatment decisions. The information is intended to help the land users identify and reduce the effects of soil limitations on various land uses. The landowner or user is responsible for identifying and complying with existing laws and regulations.

Although soil survey information can be used for general farm, local, and wider area planning, onsite investigation is needed to supplement this information in some cases. Examples include soil quality assessments (<http://www.nrcs.usda.gov/wps/portal/nrcs/main/soils/health/>) and certain conservation and engineering applications. For more detailed information, contact your local USDA Service Center (<https://offices.sc.egov.usda.gov/locator/app?agency=nrcs>) or your NRCS State Soil Scientist (http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/?cid=nrcs142p2_053951).

Great differences in soil properties can occur within short distances. Some soils are seasonally wet or subject to flooding. Some are too unstable to be used as a foundation for buildings or roads. Clayey or wet soils are poorly suited to use as septic tank absorption fields. A high water table makes a soil poorly suited to basements or underground installations.

The National Cooperative Soil Survey is a joint effort of the United States Department of Agriculture and other Federal agencies, State agencies including the Agricultural Experiment Stations, and local agencies. The Natural Resources Conservation Service (NRCS) has leadership for the Federal part of the National Cooperative Soil Survey.

Information about soils is updated periodically. Updated information is available through the NRCS Web Soil Survey, the site for official soil survey information.

The U.S. Department of Agriculture (USDA) prohibits discrimination in all its programs and activities on the basis of race, color, national origin, age, disability, and where applicable, sex, marital status, familial status, parental status, religion, sexual orientation, genetic information, political beliefs, reprisal, or because all or a part of an individual's income is derived from any public assistance program. (Not all prohibited bases apply to all programs.) Persons with disabilities who require

alternative means for communication of program information (Braille, large print, audiotape, etc.) should contact USDA's TARGET Center at (202) 720-2600 (voice and TDD). To file a complaint of discrimination, write to USDA, Director, Office of Civil Rights, 1400 Independence Avenue, S.W., Washington, D.C. 20250-9410 or call (800) 795-3272 (voice) or (202) 720-6382 (TDD). USDA is an equal opportunity provider and employer.

Contents

Preface	2
How Soil Surveys Are Made	5
Soil Map	8
Soil Map.....	9
Legend.....	10
Map Unit Legend.....	11
Map Unit Descriptions.....	11
Norfolk and Suffolk Counties, Massachusetts.....	13
71B—Ridgebury fine sandy loam, 3 to 8 percent slopes, extremely stony.....	13
260B—Sudbury fine sandy loam, 2 to 8 percent slopes.....	14
307B—Paxton fine sandy loam, 0 to 8 percent slopes, extremely stony....	15
602—Urban land, 0 to 15 percent slopes.....	17
References	19

How Soil Surveys Are Made

Soil surveys are made to provide information about the soils and miscellaneous areas in a specific area. They include a description of the soils and miscellaneous areas and their location on the landscape and tables that show soil properties and limitations affecting various uses. Soil scientists observed the steepness, length, and shape of the slopes; the general pattern of drainage; the kinds of crops and native plants; and the kinds of bedrock. They observed and described many soil profiles. A soil profile is the sequence of natural layers, or horizons, in a soil. The profile extends from the surface down into the unconsolidated material in which the soil formed or from the surface down to bedrock. The unconsolidated material is devoid of roots and other living organisms and has not been changed by other biological activity.

Currently, soils are mapped according to the boundaries of major land resource areas (MLRAs). MLRAs are geographically associated land resource units that share common characteristics related to physiography, geology, climate, water resources, soils, biological resources, and land uses (USDA, 2006). Soil survey areas typically consist of parts of one or more MLRA.

The soils and miscellaneous areas in a survey area occur in an orderly pattern that is related to the geology, landforms, relief, climate, and natural vegetation of the area. Each kind of soil and miscellaneous area is associated with a particular kind of landform or with a segment of the landform. By observing the soils and miscellaneous areas in the survey area and relating their position to specific segments of the landform, a soil scientist develops a concept, or model, of how they were formed. Thus, during mapping, this model enables the soil scientist to predict with a considerable degree of accuracy the kind of soil or miscellaneous area at a specific location on the landscape.

Commonly, individual soils on the landscape merge into one another as their characteristics gradually change. To construct an accurate soil map, however, soil scientists must determine the boundaries between the soils. They can observe only a limited number of soil profiles. Nevertheless, these observations, supplemented by an understanding of the soil-vegetation-landscape relationship, are sufficient to verify predictions of the kinds of soil in an area and to determine the boundaries.

Soil scientists recorded the characteristics of the soil profiles that they studied. They noted soil color, texture, size and shape of soil aggregates, kind and amount of rock fragments, distribution of plant roots, reaction, and other features that enable them to identify soils. After describing the soils in the survey area and determining their properties, the soil scientists assigned the soils to taxonomic classes (units). Taxonomic classes are concepts. Each taxonomic class has a set of soil characteristics with precisely defined limits. The classes are used as a basis for comparison to classify soils systematically. Soil taxonomy, the system of taxonomic classification used in the United States, is based mainly on the kind and character of soil properties and the arrangement of horizons within the profile. After the soil

Custom Soil Resource Report

scientists classified and named the soils in the survey area, they compared the individual soils with similar soils in the same taxonomic class in other areas so that they could confirm data and assemble additional data based on experience and research.

The objective of soil mapping is not to delineate pure map unit components; the objective is to separate the landscape into landforms or landform segments that have similar use and management requirements. Each map unit is defined by a unique combination of soil components and/or miscellaneous areas in predictable proportions. Some components may be highly contrasting to the other components of the map unit. The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The delineation of such landforms and landform segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, onsite investigation is needed to define and locate the soils and miscellaneous areas.

Soil scientists make many field observations in the process of producing a soil map. The frequency of observation is dependent upon several factors, including scale of mapping, intensity of mapping, design of map units, complexity of the landscape, and experience of the soil scientist. Observations are made to test and refine the soil-landscape model and predictions and to verify the classification of the soils at specific locations. Once the soil-landscape model is refined, a significantly smaller number of measurements of individual soil properties are made and recorded. These measurements may include field measurements, such as those for color, depth to bedrock, and texture, and laboratory measurements, such as those for content of sand, silt, clay, salt, and other components. Properties of each soil typically vary from one point to another across the landscape.

Observations for map unit components are aggregated to develop ranges of characteristics for the components. The aggregated values are presented. Direct measurements do not exist for every property presented for every map unit component. Values for some properties are estimated from combinations of other properties.

While a soil survey is in progress, samples of some of the soils in the area generally are collected for laboratory analyses and for engineering tests. Soil scientists interpret the data from these analyses and tests as well as the field-observed characteristics and the soil properties to determine the expected behavior of the soils under different uses. Interpretations for all of the soils are field tested through observation of the soils in different uses and under different levels of management. Some interpretations are modified to fit local conditions, and some new interpretations are developed to meet local needs. Data are assembled from other sources, such as research information, production records, and field experience of specialists. For example, data on crop yields under defined levels of management are assembled from farm records and from field or plot experiments on the same kinds of soil.

Predictions about soil behavior are based not only on soil properties but also on such variables as climate and biological activity. Soil conditions are predictable over long periods of time, but they are not predictable from year to year. For example, soil scientists can predict with a fairly high degree of accuracy that a given soil will have a high water table within certain depths in most years, but they cannot predict that a high water table will always be at a specific level in the soil on a specific date.

After soil scientists located and identified the significant natural bodies of soil in the survey area, they drew the boundaries of these bodies on aerial photographs and

Custom Soil Resource Report

identified each as a specific map unit. Aerial photographs show trees, buildings, fields, roads, and rivers, all of which help in locating boundaries accurately.


Soil Map

The soil map section includes the soil map for the defined area of interest, a list of soil map units on the map and extent of each map unit, and cartographic symbols displayed on the map. Also presented are various metadata about data used to produce the map, and a description of each soil map unit.

Custom Soil Resource Report Soil Map



Map Scale: 1:866 if printed on A portrait (8.5" x 11") sheet.




Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 19N WGS84



MAP LEGEND

Area of Interest (AOI)

 Area of Interest (AOI)




















Soils







 Soil Map Unit Polygons

 Soil Map Unit Lines


 Soil Map Unit Points

Special Point Features






-  Blowout
-  Borrow Pit
-  Clay Spot
-  Closed Depression
-  Gravel Pit
-  Gravelly Spot
-  Landfill
-  Lava Flow
-  Marsh or swamp
-  Mine or Quarry
-  Miscellaneous Water
-  Perennial Water
-  Rock Outcrop
-  Saline Spot
-  Sandy Spot
-  Severely Eroded Spot
-  Sinkhole
-  Slide or Slip
-  Sodic Spot

-  Spoil Area
-  Stony Spot
-  Very Stony Spot
-  Wet Spot
-  Other
-  Special Line Features


Water Features

 Streams and Canals

Transportation

-  Rails
-  Interstate Highways
-  US Routes
-  Major Roads
-  Local Roads

Background

 Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:25,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
 Web Soil Survey URL:
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Norfolk and Suffolk Counties, Massachusetts
 Survey Area Data: Version 18, Sep 9, 2022

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: May 22, 2022—Jun 5, 2022

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
71B	Ridgebury fine sandy loam, 3 to 8 percent slopes, extremely stony	1.1	43.0%
260B	Sudbury fine sandy loam, 2 to 8 percent slopes	0.5	20.5%
307B	Paxton fine sandy loam, 0 to 8 percent slopes, extremely stony	0.3	10.2%
602	Urban land, 0 to 15 percent slopes	0.7	26.4%
Totals for Area of Interest		2.6	100.0%

Map Unit Descriptions

The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions, along with the maps, can be used to determine the composition and properties of a unit.

A map unit delineation on a soil map represents an area dominated by one or more major kinds of soil or miscellaneous areas. A map unit is identified and named according to the taxonomic classification of the dominant soils. Within a taxonomic class there are precisely defined limits for the properties of the soils. On the landscape, however, the soils are natural phenomena, and they have the characteristic variability of all natural phenomena. Thus, the range of some observed properties may extend beyond the limits defined for a taxonomic class. Areas of soils of a single taxonomic class rarely, if ever, can be mapped without including areas of other taxonomic classes. Consequently, every map unit is made up of the soils or miscellaneous areas for which it is named and some minor components that belong to taxonomic classes other than those of the major soils.

Most minor soils have properties similar to those of the dominant soil or soils in the map unit, and thus they do not affect use and management. These are called noncontrasting, or similar, components. They may or may not be mentioned in a particular map unit description. Other minor components, however, have properties and behavioral characteristics divergent enough to affect use or to require different management. These are called contrasting, or dissimilar, components. They generally are in small areas and could not be mapped separately because of the scale used. Some small areas of strongly contrasting soils or miscellaneous areas are identified by a special symbol on the maps. If included in the database for a given area, the contrasting minor components are identified in the map unit descriptions along with some characteristics of each. A few areas of minor components may not have been observed, and consequently they are not mentioned in the descriptions, especially where the pattern was so complex that it was impractical to make enough observations to identify all the soils and miscellaneous areas on the landscape.

Custom Soil Resource Report

The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The objective of mapping is not to delineate pure taxonomic classes but rather to separate the landscape into landforms or landform segments that have similar use and management requirements. The delineation of such segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, however, onsite investigation is needed to define and locate the soils and miscellaneous areas.

An identifying symbol precedes the map unit name in the map unit descriptions. Each description includes general facts about the unit and gives important soil properties and qualities.

Soils that have profiles that are almost alike make up a *soil series*. Except for differences in texture of the surface layer, all the soils of a series have major horizons that are similar in composition, thickness, and arrangement.

Soils of one series can differ in texture of the surface layer, slope, stoniness, salinity, degree of erosion, and other characteristics that affect their use. On the basis of such differences, a soil series is divided into *soil phases*. Most of the areas shown on the detailed soil maps are phases of soil series. The name of a soil phase commonly indicates a feature that affects use or management. For example, Alpha silt loam, 0 to 2 percent slopes, is a phase of the Alpha series.

Some map units are made up of two or more major soils or miscellaneous areas. These map units are complexes, associations, or undifferentiated groups.

A *complex* consists of two or more soils or miscellaneous areas in such an intricate pattern or in such small areas that they cannot be shown separately on the maps. The pattern and proportion of the soils or miscellaneous areas are somewhat similar in all areas. Alpha-Beta complex, 0 to 6 percent slopes, is an example.

An *association* is made up of two or more geographically associated soils or miscellaneous areas that are shown as one unit on the maps. Because of present or anticipated uses of the map units in the survey area, it was not considered practical or necessary to map the soils or miscellaneous areas separately. The pattern and relative proportion of the soils or miscellaneous areas are somewhat similar. Alpha-Beta association, 0 to 2 percent slopes, is an example.

An *undifferentiated group* is made up of two or more soils or miscellaneous areas that could be mapped individually but are mapped as one unit because similar interpretations can be made for use and management. The pattern and proportion of the soils or miscellaneous areas in a mapped area are not uniform. An area can be made up of only one of the major soils or miscellaneous areas, or it can be made up of all of them. Alpha and Beta soils, 0 to 2 percent slopes, is an example.

Some surveys include *miscellaneous areas*. Such areas have little or no soil material and support little or no vegetation. Rock outcrop is an example.

Norfolk and Suffolk Counties, Massachusetts

71B—Ridgebury fine sandy loam, 3 to 8 percent slopes, extremely stony

Map Unit Setting

National map unit symbol: 2w69c
Elevation: 0 to 1,290 feet
Mean annual precipitation: 36 to 71 inches
Mean annual air temperature: 39 to 55 degrees F
Frost-free period: 140 to 240 days
Farmland classification: Not prime farmland

Map Unit Composition

Ridgebury, extremely stony, and similar soils: 80 percent
Minor components: 20 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Ridgebury, Extremely Stony

Setting

Landform: Drumlins, depressions, ground moraines, hills, drainageways
Landform position (two-dimensional): Footslope, toeslope
Landform position (three-dimensional): Head slope, base slope
Down-slope shape: Concave
Across-slope shape: Concave
Parent material: Coarse-loamy lodgment till derived from gneiss, granite, and/or schist

Typical profile

Oe - 0 to 1 inches: moderately decomposed plant material
A - 1 to 6 inches: fine sandy loam
Bw - 6 to 10 inches: sandy loam
Bg - 10 to 19 inches: gravelly sandy loam
Cd - 19 to 66 inches: gravelly sandy loam

Properties and qualities

Slope: 3 to 8 percent
Surface area covered with cobbles, stones or boulders: 9.0 percent
Depth to restrictive feature: 15 to 35 inches to densic material
Drainage class: Poorly drained
Runoff class: Very high
Capacity of the most limiting layer to transmit water (Ksat): Very low to moderately low (0.00 to 0.14 in/hr)
Depth to water table: About 0 to 6 inches
Frequency of flooding: None
Frequency of ponding: None
Maximum salinity: Nonsaline (0.0 to 1.9 mmhos/cm)
Available water supply, 0 to 60 inches: Low (about 3.0 inches)

Interpretive groups

Land capability classification (irrigated): None specified
Land capability classification (nonirrigated): 7s
Hydrologic Soil Group: D
Ecological site: F144AY009CT - Wet Till Depressions
Hydric soil rating: Yes

Minor Components

Woodbridge, extremely stony

Percent of map unit: 10 percent

Landform: Ground moraines, hills, drumlins

Landform position (two-dimensional): Summit, backslope, footslope

Landform position (three-dimensional): Side slope, crest

Down-slope shape: Convex

Across-slope shape: Linear

Hydric soil rating: No

Whitman, extremely stony

Percent of map unit: 8 percent

Landform: Depressions

Down-slope shape: Concave

Across-slope shape: Concave

Hydric soil rating: Yes

Paxton, extremely stony

Percent of map unit: 2 percent

Landform: Ground moraines, hills, drumlins

Landform position (two-dimensional): Summit, shoulder, backslope

Landform position (three-dimensional): Side slope, crest

Down-slope shape: Convex, linear

Across-slope shape: Linear, convex

Hydric soil rating: No

260B—Sudbury fine sandy loam, 2 to 8 percent slopes

Map Unit Setting

National map unit symbol: vky4

Elevation: 0 to 2,100 feet

Mean annual precipitation: 45 to 54 inches

Mean annual air temperature: 43 to 54 degrees F

Frost-free period: 145 to 240 days

Farmland classification: All areas are prime farmland

Map Unit Composition

Sudbury and similar soils: 85 percent

Minor components: 15 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Sudbury

Setting

Landform: Outwash plains

Landform position (two-dimensional): Footslope

Landform position (three-dimensional): Riser

Down-slope shape: Linear

Across-slope shape: Concave

Custom Soil Resource Report

Parent material: Friable coarse-loamy eolian deposits over loose sandy glaciofluvial deposits

Typical profile

H1 - 0 to 11 inches: sandy loam

H2 - 11 to 22 inches: sandy loam

H3 - 22 to 60 inches: gravelly coarse sand

Properties and qualities

Slope: 2 to 8 percent

Depth to restrictive feature: 18 to 36 inches to strongly contrasting textural stratification

Drainage class: Moderately well drained

Runoff class: Low

Capacity of the most limiting layer to transmit water (Ksat): High (2.00 to 6.00 in/hr)

Depth to water table: About 18 to 36 inches

Frequency of flooding: None

Frequency of ponding: None

Available water supply, 0 to 60 inches: Low (about 4.0 inches)

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 2e

Hydrologic Soil Group: B

Ecological site: F144AY027MA - Moist Sandy Outwash

Hydric soil rating: No

Minor Components

Walpole

Percent of map unit: 5 percent

Landform: Terraces

Hydric soil rating: Yes

Merrimac

Percent of map unit: 5 percent

Hydric soil rating: No

Deerfield

Percent of map unit: 5 percent

Landform: Outwash plains

Landform position (two-dimensional): Footslope

Landform position (three-dimensional): Tread

Down-slope shape: Concave

Across-slope shape: Concave

Hydric soil rating: No

307B—Paxton fine sandy loam, 0 to 8 percent slopes, extremely stony

Map Unit Setting

National map unit symbol: 2w675

Custom Soil Resource Report

Elevation: 0 to 1,580 feet
Mean annual precipitation: 36 to 71 inches
Mean annual air temperature: 39 to 55 degrees F
Frost-free period: 140 to 240 days
Farmland classification: Not prime farmland

Map Unit Composition

Paxton, extremely stony, and similar soils: 80 percent
Minor components: 20 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Paxton, Extremely Stony

Setting

Landform: Ground moraines, hills, drumlins
Landform position (two-dimensional): Summit, shoulder, backslope
Landform position (three-dimensional): Side slope, crest
Down-slope shape: Convex, linear
Across-slope shape: Linear, convex
Parent material: Coarse-loamy lodgment till derived from gneiss, granite, and/or schist

Typical profile

Oe - 0 to 2 inches: moderately decomposed plant material
A - 2 to 10 inches: fine sandy loam
Bw1 - 10 to 17 inches: fine sandy loam
Bw2 - 17 to 28 inches: fine sandy loam
Cd - 28 to 67 inches: gravelly fine sandy loam

Properties and qualities

Slope: 0 to 8 percent
Surface area covered with cobbles, stones or boulders: 9.0 percent
Depth to restrictive feature: 20 to 43 inches to densic material
Drainage class: Well drained
Runoff class: Medium
Capacity of the most limiting layer to transmit water (Ksat): Very low to moderately low (0.00 to 0.14 in/hr)
Depth to water table: About 18 to 37 inches
Frequency of flooding: None
Frequency of ponding: None
Maximum salinity: Nonsaline (0.0 to 1.9 mmhos/cm)
Available water supply, 0 to 60 inches: Low (about 4.7 inches)

Interpretive groups

Land capability classification (irrigated): None specified
Land capability classification (nonirrigated): 7s
Hydrologic Soil Group: C
Ecological site: F144AY007CT - Well Drained Dense Till Uplands
Hydric soil rating: No

Minor Components

Woodbridge, extremely stony

Percent of map unit: 10 percent
Landform: Hills, drumlins, ground moraines
Landform position (two-dimensional): Summit, backslope, footslope
Landform position (three-dimensional): Side slope, crest

Custom Soil Resource Report

Down-slope shape: Concave
Across-slope shape: Linear
Hydric soil rating: No

Charlton, extremely stony

Percent of map unit: 5 percent
Landform: Hills
Landform position (two-dimensional): Summit, shoulder, backslope
Landform position (three-dimensional): Side slope, crest
Down-slope shape: Convex
Across-slope shape: Convex
Hydric soil rating: No

Ridgebury, extremely stony

Percent of map unit: 4 percent
Landform: Drumlins, drainageways, depressions, ground moraines, hills
Landform position (two-dimensional): Footslope, toeslope
Landform position (three-dimensional): Head slope, base slope
Down-slope shape: Concave
Across-slope shape: Concave
Hydric soil rating: Yes

Whitman, extremely stony

Percent of map unit: 1 percent
Landform: Depressions
Down-slope shape: Concave
Across-slope shape: Concave
Hydric soil rating: Yes

602—Urban land, 0 to 15 percent slopes

Map Unit Setting

National map unit symbol: vkyj
Mean annual precipitation: 32 to 50 inches
Mean annual air temperature: 45 to 50 degrees F
Frost-free period: 120 to 200 days
Farmland classification: Not prime farmland

Map Unit Composition

Urban land: 99 percent
Minor components: 1 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Urban Land

Setting

Parent material: Excavated and filled land

Minor Components

Rock outcrops

Percent of map unit: 1 percent

Hydric soil rating: Unranked

References


- American Association of State Highway and Transportation Officials (AASHTO). 2004. Standard specifications for transportation materials and methods of sampling and testing. 24th edition.
- American Society for Testing and Materials (ASTM). 2005. Standard classification of soils for engineering purposes. ASTM Standard D2487-00.
- Cowardin, L.M., V. Carter, F.C. Golet, and E.T. LaRoe. 1979. Classification of wetlands and deep-water habitats of the United States. U.S. Fish and Wildlife Service FWS/OBS-79/31.
- Federal Register. July 13, 1994. Changes in hydric soils of the United States.
- Federal Register. September 18, 2002. Hydric soils of the United States.
- Hurt, G.W., and L.M. Vasilas, editors. Version 6.0, 2006. Field indicators of hydric soils in the United States.
- National Research Council. 1995. Wetlands: Characteristics and boundaries.
- Soil Survey Division Staff. 1993. Soil survey manual. Soil Conservation Service. U.S. Department of Agriculture Handbook 18. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_054262
- Soil Survey Staff. 1999. Soil taxonomy: A basic system of soil classification for making and interpreting soil surveys. 2nd edition. Natural Resources Conservation Service, U.S. Department of Agriculture Handbook 436. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053577
- Soil Survey Staff. 2010. Keys to soil taxonomy. 11th edition. U.S. Department of Agriculture, Natural Resources Conservation Service. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053580
- Tiner, R.W., Jr. 1985. Wetlands of Delaware. U.S. Fish and Wildlife Service and Delaware Department of Natural Resources and Environmental Control, Wetlands Section.
- United States Army Corps of Engineers, Environmental Laboratory. 1987. Corps of Engineers wetlands delineation manual. Waterways Experiment Station Technical Report Y-87-1.
- United States Department of Agriculture, Natural Resources Conservation Service. National forestry manual. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/home/?cid=nrcs142p2_053374
- United States Department of Agriculture, Natural Resources Conservation Service. National range and pasture handbook. <http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/landuse/rangepasture/?cid=stelprdb1043084>

Custom Soil Resource Report

United States Department of Agriculture, Natural Resources Conservation Service. National soil survey handbook, title 430-VI. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/scientists/?cid=nrcs142p2_054242

United States Department of Agriculture, Natural Resources Conservation Service. 2006. Land resource regions and major land resource areas of the United States, the Caribbean, and the Pacific Basin. U.S. Department of Agriculture Handbook 296. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053624

United States Department of Agriculture, Soil Conservation Service. 1961. Land capability classification. U.S. Department of Agriculture Handbook 210. http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_052290.pdf

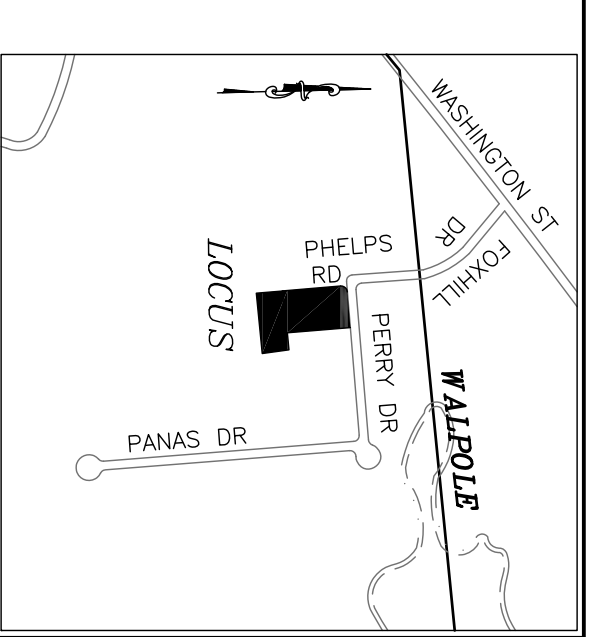


LOCUS 1"=1000'

PROJECT:
7 Perry Drive
Foxborough, MA

OWNER:
1776 Washington
Street Realty TR
Michael R Berube
Jr-Trustee
7 Perry Drive
Foxborough, MA

BPAZ Holdings,
31, LLC
1 Sansome Street
San Francisco, CA

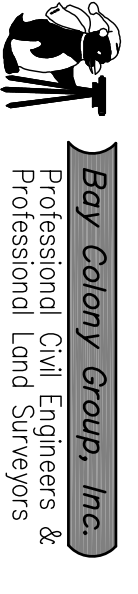

FOUR SCHOOL STREET
P.O. BOX 9136
FOXBOROUGH, MA 02035
508-543-3939

DATE APPROVED: _____
DATE ENDORSED: _____
FOXBOROUGH PLANNING BOARD

STAMP



DRAWING TITLE

Cover Sheet

SCALE: NIS
JUNE 14, 2023
SHEET NUMBER
21-0102D
CV

SITE DEVELOPMENT PLAN OF #7 Perry Drive FOXBOROUGH, MA

JUNE 14, 2023 ——— SCALE: AS NOTED

BAY COLONY GROUP, Inc.
PROFESSIONAL CIVIL ENGINEERS & LAND SURVEYORS
FOUR SCHOOL STREET, P.O. BOX 9136
FOXBOROUGH, MA 02035
(508) 543-3939

ASSESSORS REF: MAP 002, PARCEL 010

ZONING: GENERAL INDUSTRIAL / LIMITED INDUSTRIAL

NOTES TO CONTRACTORS:

- ALL CONTRACTORS MUST CONTACT THE FOXBOROUGH PLANNING BOARD AT 508.543.1250 PRIOR TO THE INITIATION OF ANY CONSTRUCTION.
- A STREET OPENING PERMIT MUST BE OBTAINED FROM THE FOXBOROUGH HIGHWAY DEPARTMENT PRIOR TO ANY WORK OCCURRING IN OR ON ANY STREET (ACCEPTED OR NOT) AFTER THE TOP COURSE OF PAVEMENT IS INSTALLED.
- THIS PLAN IS ACCOMPANIED BY AN APPROVAL LETTER DATED XXXXXX BY THE FOXBOROUGH PLANNING BOARD. SAID LETTER SHALL BE CONSIDERED A PART OF THIS PLAN.

CIVIL DRAWINGS		
SHEET NO.	DESCRIPTION	LAST REVISED
SHEET CV	COVER SHEET	06-14-2023
SHEET 1	LEGEND & GENERAL NOTES	06-14-2023
SHEET 2	EXISTING CONDITIONS PLAN	06-14-2023
SHEET 3	LAYOUT AND GRADING PLAN	06-14-2023
SHEET 4	DRAINAGE AND UTILITIES PLAN	06-14-2023
SHEET 5	DETAILS	06-14-2023
SHEET 6	SWPPP & SNOW STORAGE PLAN	06-14-2023
SHEET 7		

THE LAST REVISED DATE FOR PLANS IN THIS SET IS: 06-14-2023

PROJECT:

7 Perry Drive
Foxborough, MA

GENERAL NOTES

TOPOGRAPHICAL INFORMATION OBTAINED FROM AN ON THE GROUND SURVEY BY THIS OFFICE IN DECEMBER, 2022. OFF-SITE IMPROVEMENTS ARE COMPILED FROM THE TOWN OF FOXBOROUGH GIS. HORIZONTAL DATUM IS NAD 83 AND VERTICAL DATUM IS NAVD 88. WETLAND LINE FLAGGED BY THE PARE CORPORATION IN JUNE 2023. SITE DOES NOT LIE WITHIN A FEMA DESIGNATED FLOOD ZONE (A OR V ZONES).

UNDERGROUND UTILITIES ARE SHOWN HEREON AS COMPILED FROM RECORD PLANS AND VISIBLE UTILITY STRUCTURES. BAY COLONY GROUP DOES NOT WARRANT THE ACTUAL DEPTH AND LOCATIONS OF ANY UTILITIES SHOWN HEREON. CONTACT DIGSAFE AT 1-800-322-4844 AT LEAST 72 HOURS, SATURDAYS, SUNDAYS AND HOLIDAYS EXCLUDED, PRIOR TO EXCAVATING AT ANY LOCATION. A COPY OF THE DIGSAFE PROJECT REFERENCE NUMBER(S) SHALL BE GIVEN TO THE OWNER PRIOR TO EXCAVATION.

WHERE AN EXISTING UNDERGROUND UTILITY IS FOUND TO CONFLICT WITH THE PROPOSED WORK, THE LOCATION, ELEVATION AND SIZE OF THE UTILITY SHALL BE ACCURATELY DETERMINED WITHOUT DELAY BY THE CONTRACTOR, AND THE INFORMATION FURNISHED TO THE ENGINEER IMMEDIATELY.

TEST PITS TO LOCATED EXISTING UTILITIES MAY BE ORDERED BY THE ENGINEER.

THE CONTRACTOR SHALL MAKE ALL ARRANGEMENTS FOR THE ALTERATION AND ADJUSTMENT OF GAS, ELECTRIC, TELEPHONE AND ANY OTHER PRIVATE UTILITIES BY THE RESPECTIVE COMPANIES.

AREAS OUTSIDE THE LIMITS OF THE PROPOSED WORK DISTURBED BY THE CONTRACTOR'S OPERATIONS SHALL BE RESTORED BY THE CONTRACTOR TO THEIR ORIGINAL CONDITIONS AT THE CONTRACTOR'S EXPENSE.

STONE WALLS, FENCES, MAIL BOXES, SIGNS, CURBS, LIGHT POLES ETC.: SHALL BE REMOVED AND REPLACED AS NECESSARY TO PERFORM THE WORK.

ALL PAVEMENT DISTURBED BY THE CONTRACTOR'S OPERATIONS SHALL BE REPLACED IN ACCORDANCE WITH THE SPECIFICATIONS AND AS SHOWN ON THE DRAWINGS.

OPENINGS FOR PIPE IN PRECAST CONCRETE STRUCTURES SHALL BE CAST IN THE REQUIRED LOCATIONS DURING MANHOLE MANUFACTURE. FIELD CUT OPENINGS WILL NOT BE PERMITTED UNLESS APPROVED BY THE ENGINEER.

IN PAVED AND GRAVEL AREAS THE TOP OF THE STRUCTURE COVERS SHALL BE SET FLUSH WITH THE PAVED SURFACE. IN CROSS-COUNTRY AREAS THE TOP OF THE COVER SHALL EXTEND 2 INCHES ABOVE FINISHED GRADE, OR AS SHOWN ON THE DRAWINGS, OR AS DIRECTED BY THE ENGINEER.

ALL CONTRACTORS MUST CONTACT THE FOXBOROUGH PLANNING BOARD AT 508.543.2250 PRIOR TO THE INITIATION OF ANY CONSTRUCTION.

A STREET OPENING PERMIT MUST BE OBTAINED FROM THE FOXBOROUGH HIGHWAY DEPARTMENT PRIOR TO ANY WORK OCCURRING IN OR ON ANY STREET (ACCEPTED OR NOT) AFTER THE TOP COURSE OF PAVEMENT IS INSTALLED.

THIS PLAN IS ACCOMPANIED BY AN APPROVAL LETTER DATED XXXXXXXX BY THE FOXBOROUGH PLANNING BOARD AND AN ORDER OF CONDITIONS ISSUED BY THE FOXBOROUGH CONSERVATION COMMISSION DATED XXXXXXXX (SET-17-XXX). SAID DOCUMENTS SHALL BE CONSIDERED A PART OF THIS PLAN.

SYMBOLS & LEGEND

EXISTING

n.t.s.	- NOT TO SCALE
T.B.M.	- TEMPORARY BENCH MARK
Ⓟ	- BOUND (TYPE NOTED)
Ⓢ	- STAKE & STONE
Ⓛ	- DRILL HOLE
IP	- IRON PIPE/PIN
Ⓜ/H/B	- MASS HIGHWAY BOUND
Δ s/n	- STAKE & NAIL
(fd)	- FOUND
(set)	- SET IN PLACE
Ⓣ	- UTILITY POLE
UP/P	- UTILITY POLE/LIGHT POLE
UP	- UTILITY POLE
Ⓢ	- WELL
n/f	- NOW OR FORMERLY
Ⓣ	- TREE (SIZE NOTED)
(rec)	- RECORD
Ⓛ	- DRAIN MANHOLE
Ⓛ	- TELEPHONE MANHOLE
Ⓛ	- ELECTRIC MANHOLE
Ⓢ	- SEWER MANHOLE
□	- CATCH BASIN
WS M	- WATER GATE
WS M	- WATER SERVICE
GC M	- GAS GATE
Ⓜ	- EXISTING HYDRANT
SGC	- SLOPED GRANITE CURBING
VGC	- VERTICAL GRANITE CURBING
PVC	- POLYVINYL CHLORIDE PIPE
CMP	- CORRUGATED METAL PIPE
VCP	- VITREOUS CLAY PIPE
CLF	- CHAIN LINK FENCE
OHW	- OVERHEAD WIRE
SIGN -	- SIGN (SIZE & TYPE NOTED)
Ⓣ	- TEST PIT
D	- DRAIN PIPE (SIZE & TYPE NOTED)
S	- SEWER PIPE (SIZE & TYPE NOTED)
E	- ELECTRIC DUCT (SIZE & TYPE NOTED)
G	- GAS MAIN (SIZE & TYPE NOTED)
W	- WATER MAIN (SIZE & TYPE NOTED)
T	- TELEPHONE DUCT
Ⓢ	- STONE WALL
Ⓢ	- EDGE OF TREELINE
Ⓢ	- GUARD-RAIL (TYPE NOTED)
Ⓢ	- RAILROAD TRACKS
Ⓢ	- RETAINING WALL (SIZE & TYPE NOTED)
Ⓢ	- BARBED WIRE FENCE
Ⓢ	- STOCKADE FENCE
Ⓢ	- CHAIN-LINK FENCE

PROPOSED

n.t.s.	- NOT TO SCALE
T.B.M.	- TEMPORARY BENCH MARK
Ⓟ	- BOUND (TYPE NOTED)
Ⓢ	- STAKE & STONE
Ⓛ	- DRILL HOLE
IP	- IRON PIPE/PIN
Ⓜ/H/B	- MASS HIGHWAY BOUND
Δ s/n	- STAKE & NAIL
(fd)	- FOUND
(set)	- SET IN PLACE
Ⓣ	- UTILITY POLE
UP/P	- UTILITY POLE/LIGHT POLE
UP	- UTILITY POLE
Ⓢ	- WELL
n/f	- NOW OR FORMERLY
Ⓣ	- TREE (SIZE NOTED)
(rec)	- RECORD
Ⓛ	- DRAIN MANHOLE
Ⓛ	- TELEPHONE MANHOLE
Ⓛ	- ELECTRIC MANHOLE
Ⓢ	- SEWER MANHOLE
□	- CATCH BASIN
WS M	- WATER GATE
WS M	- WATER SERVICE
GC M	- GAS GATE
Ⓜ	- PROPOSED HYDRANT
SGC	- SLOPED GRANITE CURBING
MBC	- MONOLITHIC BITUMINOUS CURBING
VCC	- VERTICAL CONCRETE CURBING
CMP	- CORRUGATED METAL PIPE
VCP	- VITREOUS CLAY PIPE
CLF	- CHAIN LINK FENCE
OHW	- OVERHEAD WIRE
R&R	- REMOVE AND RE-USE
R&S	- REMOVE AND STACK
SIGN -	- SIGN (SIZE & TYPE NOTED)
D	- DRAIN PIPE (SIZE & TYPE NOTED)
S	- SEWER PIPE (SIZE & TYPE NOTED)
E	- ELECTRIC DUCT (SIZE & TYPE NOTED)
G	- GAS MAIN (SIZE & TYPE NOTED)
W	- WATER MAIN (SIZE & TYPE NOTED)
T	- TELEPHONE DUCT
Ⓢ	- STONE WALL
Ⓢ	- EDGE OF TREELINE
Ⓢ	- GUARD-RAIL (TYPE NOTED)
Ⓢ	- RETAINING WALL (SIZE & TYPE NOTED)
Ⓢ	- BARBED WIRE FENCE
Ⓢ	- STOCKADE FENCE
Ⓢ	- CHAIN-LINK FENCE

PAVEMENT MARKINGS


SWL	SWL - SOLID WHITE LINE - 6" STATE HIGHWAY, 4" LOCAL STREETS
SYL	SYL - SOLID YELLOW LINE - 6" STATE HIGHWAY, 4" LOCAL STREETS
DWL	DWL - DOTTED WHITE LINE - 6" (2' STRIPE w/4' GAP) STATE HIGHWAY
WLDL	DOTTED WHITE LINE - 4" (2' STRIPE w/4' GAP) LOCAL STREETS
DDYL	WHITE LANE DELINEATION LINE - 6" (3' STRIPE w/9' GAP) STATE HIGHWAY
DDYL	WHITE LANE DELINEATION LINE - 4" (3' STRIPE w/9' GAP) LOCAL STREETS
DDYL	DOUBLE DOTTED YELLOW LINE - 4" (2' STRIPE w/4' GAP) LOCAL STREETS
BWLL	BROKEN WHITE LANE LINE - 6" (10' STRIPE w/30' GAP) STATE HIGHWAY
BWLL	BROKEN WHITE LANE LINE - 4" (10' STRIPE w/30' GAP) LOCAL STREETS
SWLL	SOLID WHITE LANE LINE - 6" STATE HIGHWAY, 4" LOCAL STREETS
SWEL	SOLID WHITE EDGE LINE - 6" STATE HIGHWAY, 4" LOCAL STREETS
SWGL	SOLID WHITE GORE LINE - 12"
SYGL	SOLID YELLOW EDGE LINE - 6" STATE HIGHWAY, 4" LOCAL STREETS
SYGL	SOLID YELLOW GORE LINE - 12"
DYL	DOUBLE YELLOW LINE - 2--6" LINES STATE HIGHWAY
DYL	DOUBLE YELLOW LINE - 2--4" LINES LOCAL STREETS
PAV	PAVEMENT ARROW AND LEGEND

Legend &
General Notes

DRAWING TITLE

STAMP

DATE APPROVED: _____
DATE ENDORSED: _____
FOXBOROUGH PLANNING BOARD


Bay Colony Group, Inc.
Professional Civil Engineers &
Professional Land Surveyors
FOUR SCHOOL STREET
P.O. BOX 9136
FOXBOROUGH, MA 02035
508-545-9399


OWNER:
1776 Washington
Street Realty TR
Michael R Berube
Jr Trustee
7 Perry Drive
Foxborough, MA
BPAZ Holdings,
31 LLC
1 Sansome Street
San Francisco, CA

PROJECT:

7 Perry Drive
Foxborough, MA

OWNER:


1776 Washington
Street Realty TR
Michael R Berube
Jr Trustee
7 Perry Drive
Foxborough, MA
BPAZ Holdings,
31, LLC
1 Sansome Street
San Francisco, CA

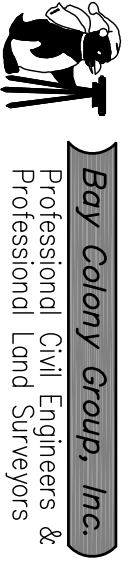

FOUR SCHOOL STREET
P.O. BOX 9136
FOXBOROUGH, MA 02035
508-545-5539

DATE APPROVED: _____
DATE ENDORSED: _____
FOXBOROUGH PLANNING BOARD

STAMP



DRAWING TITLE

Existing Conditions

SCALE: 1" = 30'

JUNE 14, 2023 SHEET NUMBER

21-0102D

2




PROJECT:

7 Perry Drive
Foxborough, MA

OWNER:


1776 Washington
Street Realty TR
Michael R Berube
Jr Trustee
7 Perry Drive
Foxborough, MA
BPAZ Holdings,
31, LLC
1 Sansome Street
San Francisco, CA

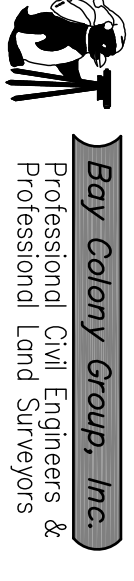

FOUR SCHOOL STREET
P.O. BOX 9136
FOXBOROUGH, MA 02035
508-545-5539

DATE APPROVED: _____
DATE ENDORSED: _____
FOXBOROUGH PLANNING BOARD

STAMP

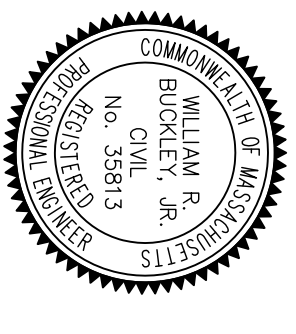

DRAWING TITLE




Layout and Grading

SCALE: 1" = 30'

JUNE 14, 2023 SHEET NUMBER

21-0102D 3

ZONING BY-LAW REQUIREMENTS			
ZONING DISTRICT - GENERAL INDUSTRIAL / LIMITED INDUSTRIAL			
	REQUIRED	EXISTING	PROPOSED
MIN. LOT FRONTAGE	50'	170.0'	170.0'
MIN. FRONT YARD	50'	55.0'	55.0'
MIN. SIDE YARD	25'	25.0'	25.0'
MIN. REAR YARD	50'	189'	92.1'
MAX. BUILDING COVERAGE	25%	25%	25%
PARKING REQUIREMENTS	70%	45%	70%
MANUFACTURING (18,450SF) / 1,700SF	25	9	25
STORAGE (10,250SF) / 1,750SF	7	7	7
TOTAL PARKING SPACES	41	26	41

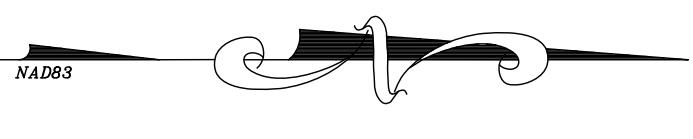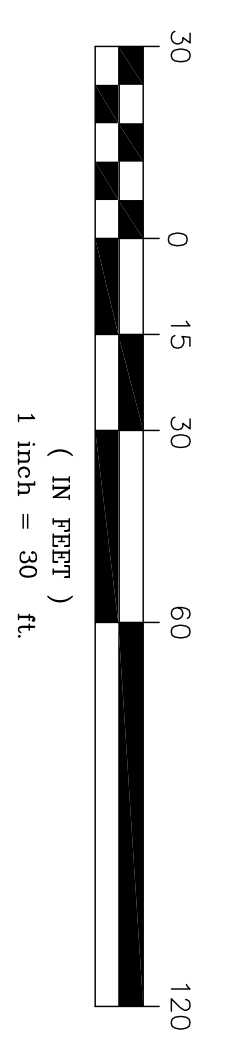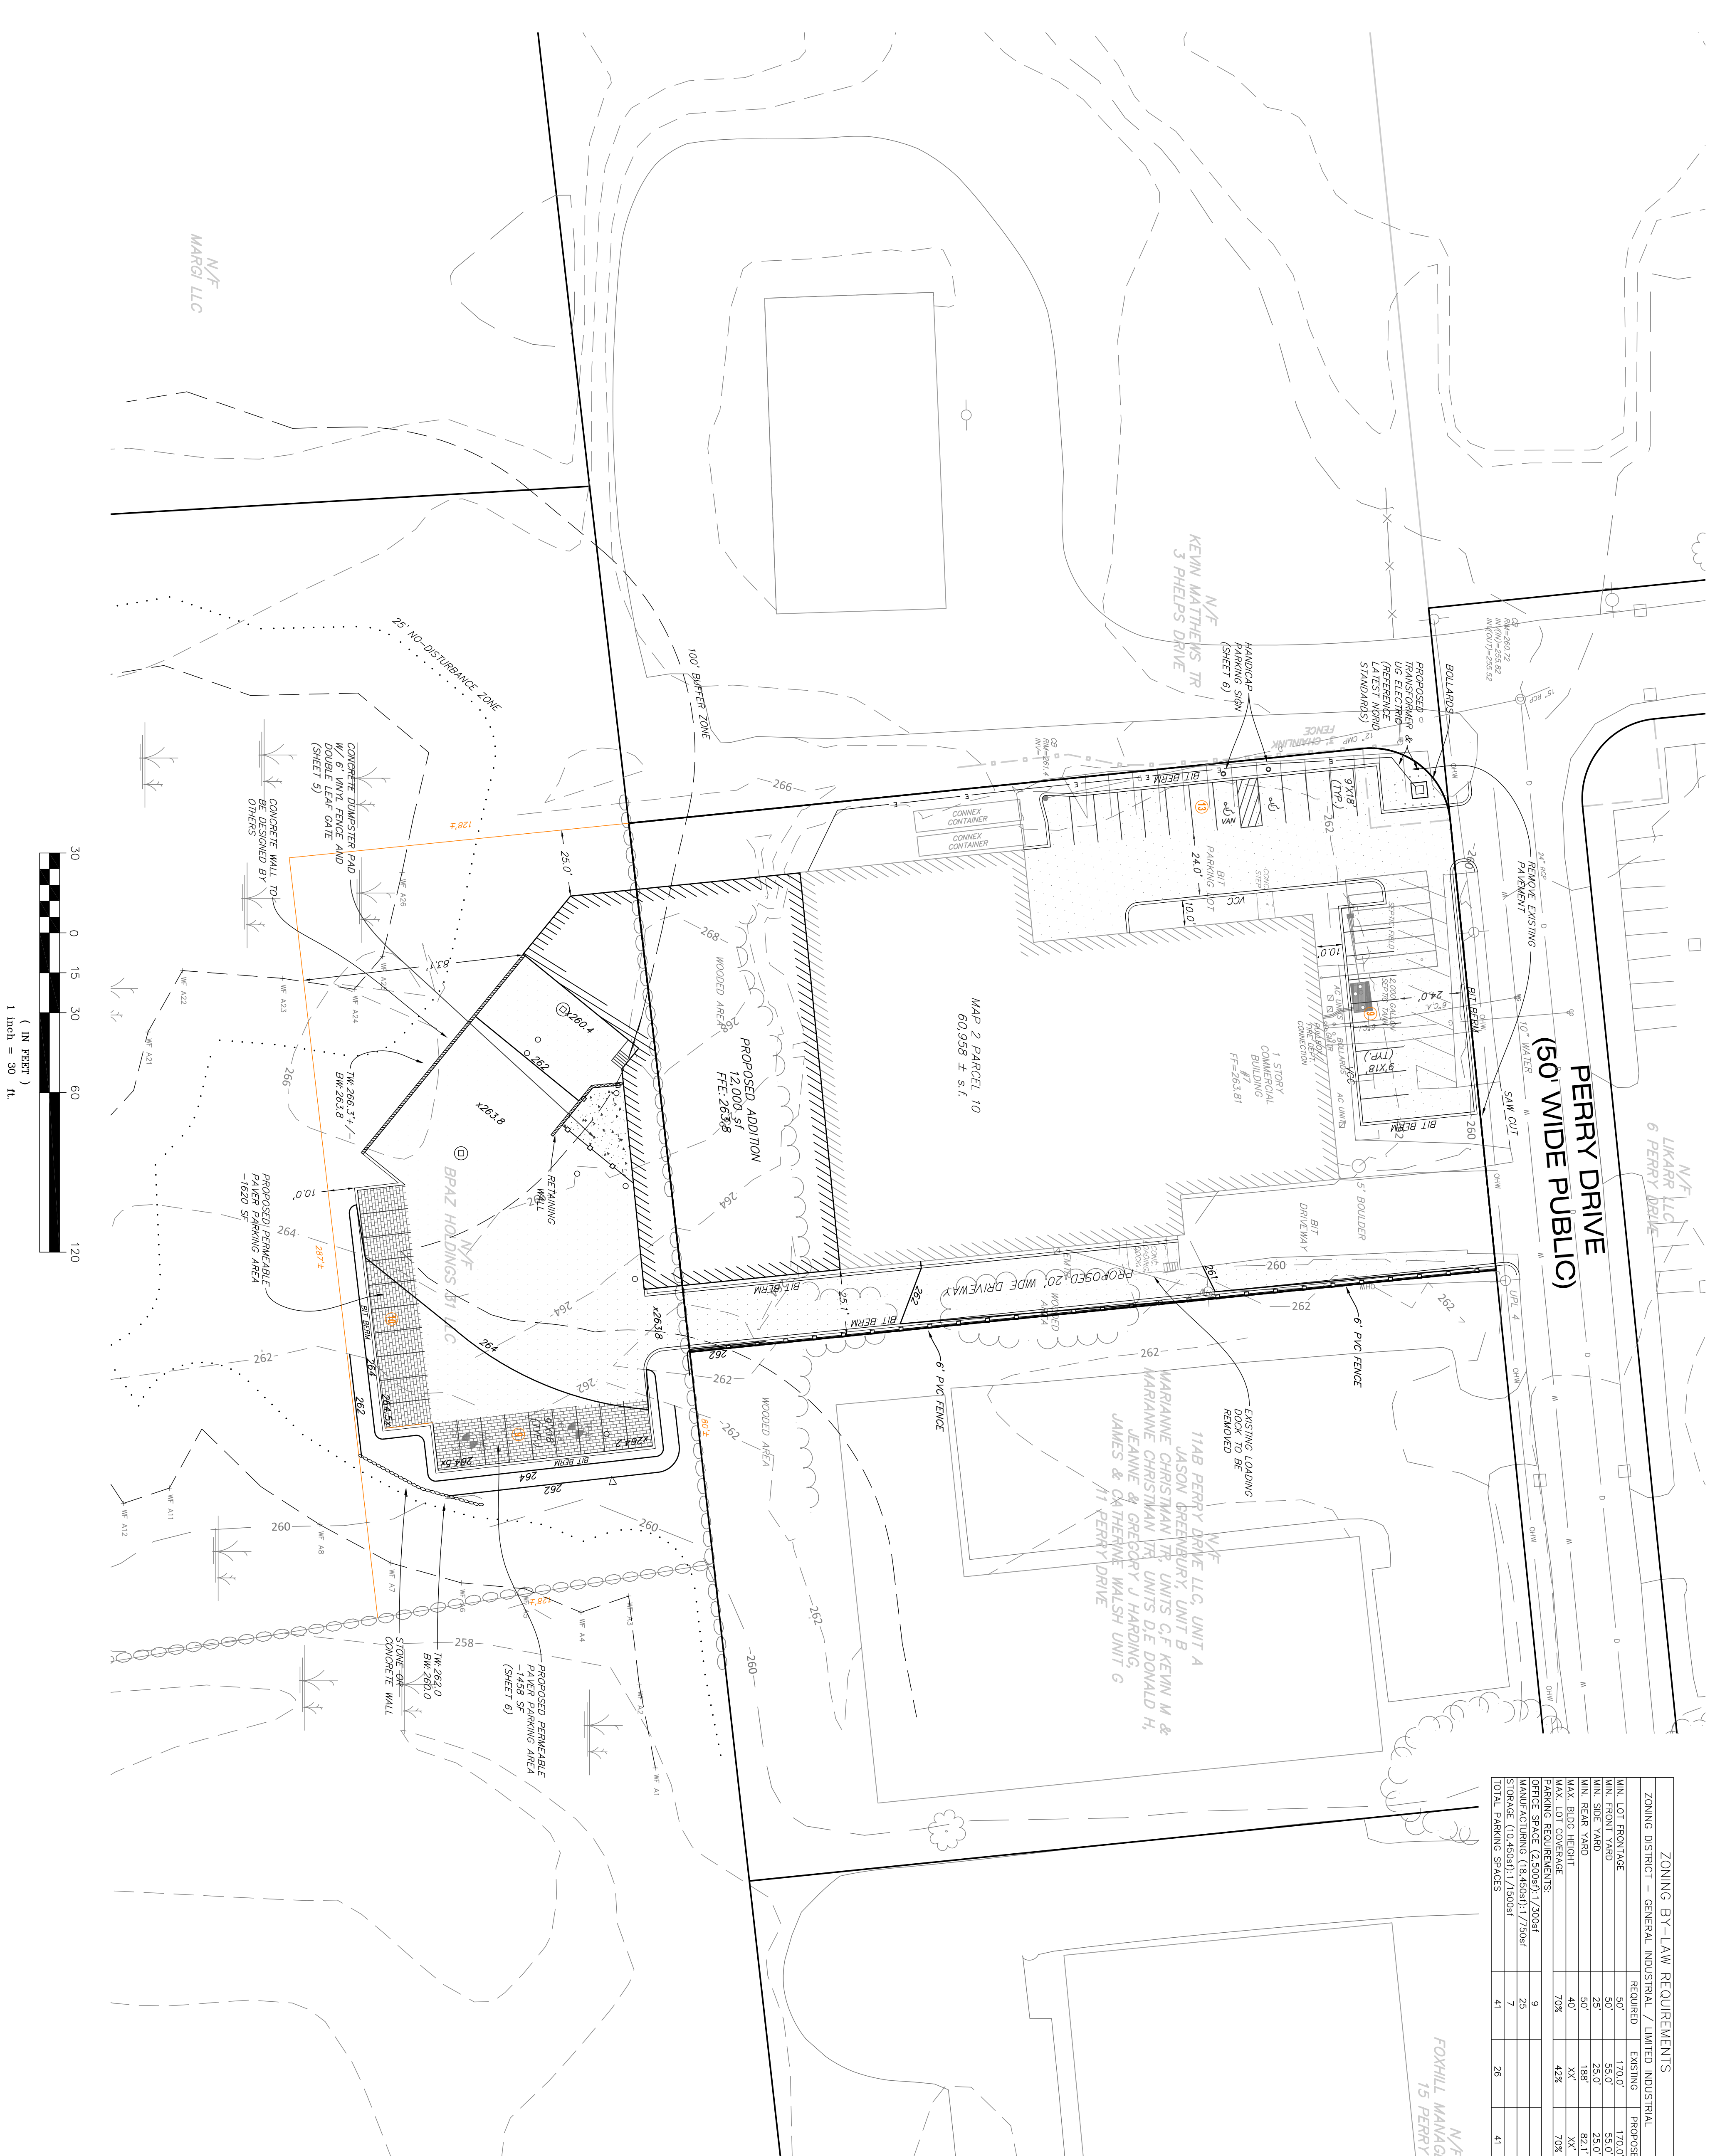


PROJECT:

7 Perry Drive
Foxborough, MA

OWNER:

1776 Washington
Street Realty TR
Michael R Berube
Jr Trustee
7 Perry Drive
Foxborough, MA
BPAZ Holdings,
31, LLC
1 Sansome Street
San Francisco, CA

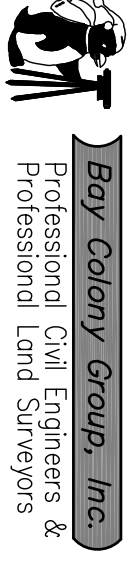

FOUR SCHOOL STREET
P.O. BOX 9136
FOXBOROUGH, MA 02035
508-545-5539

DATE APPROVED: _____
DATE ENDORSED: _____
FOXBOROUGH PLANNING BOARD

STAMP




DRAWING TITLE

Drainage and Utilities

SCALE: 1" = 30'


JUNE 14, 2023 SHEET NUMBER

21-0102D **4**

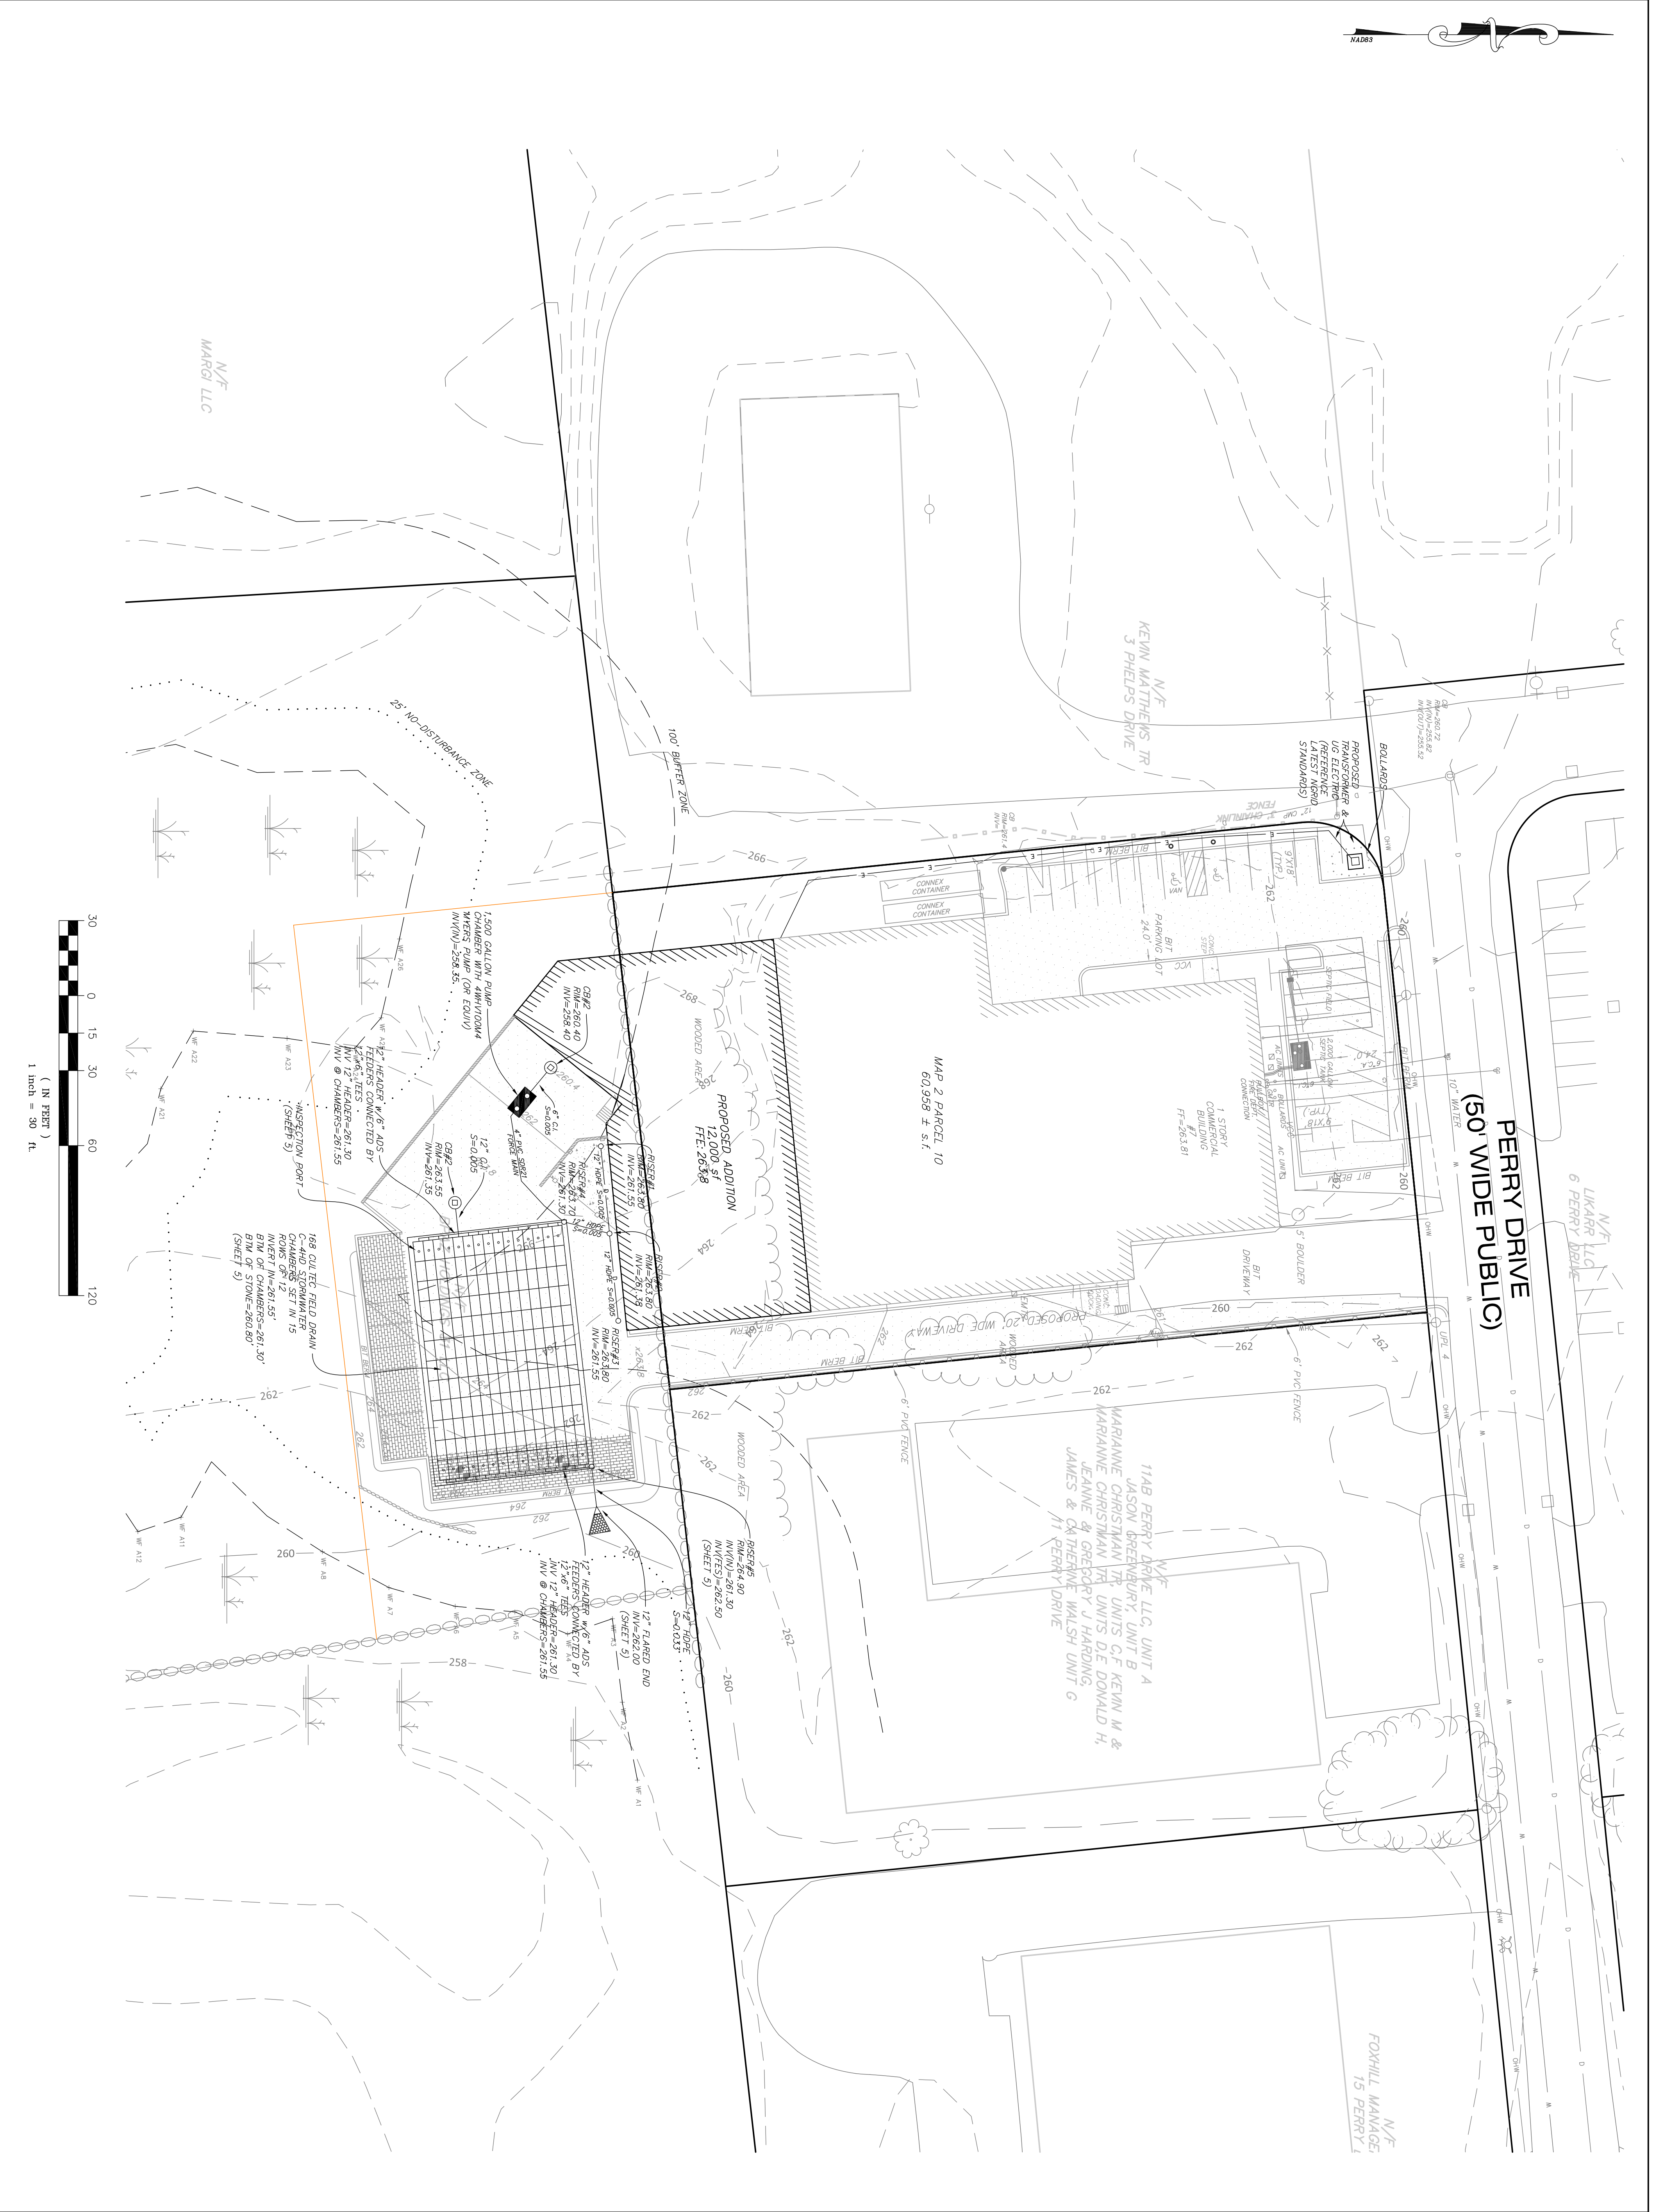


PROJECT:
**7 Perry Drive
 Foxborough, MA**

OWNER:
**1776 Washington
 Street Realty TR
 Michael R Berube
 Jr Trustee
 7 Perry Drive
 Foxborough, MA
 BPAZ Holdings,
 31, LLC
 1 Sansome Street
 San Francisco, CA**

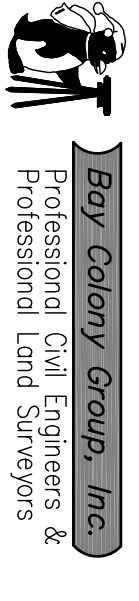


FOUR SCHOOL STREET
 P.O. BOX 9136
 FOXBOROUGH, MA 02035
 508-545-3539

DATE APPROVED: _____
 DATE ENDORSED: _____
 FOXBOROUGH PLANNING BOARD

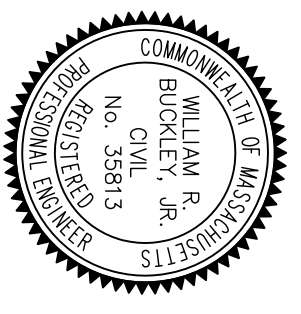


STAMP
 DRAWING TITLE
 Detail



SCALE: N.T.S.
 JUNE 14, 2023
 SHEET NUMBER
5

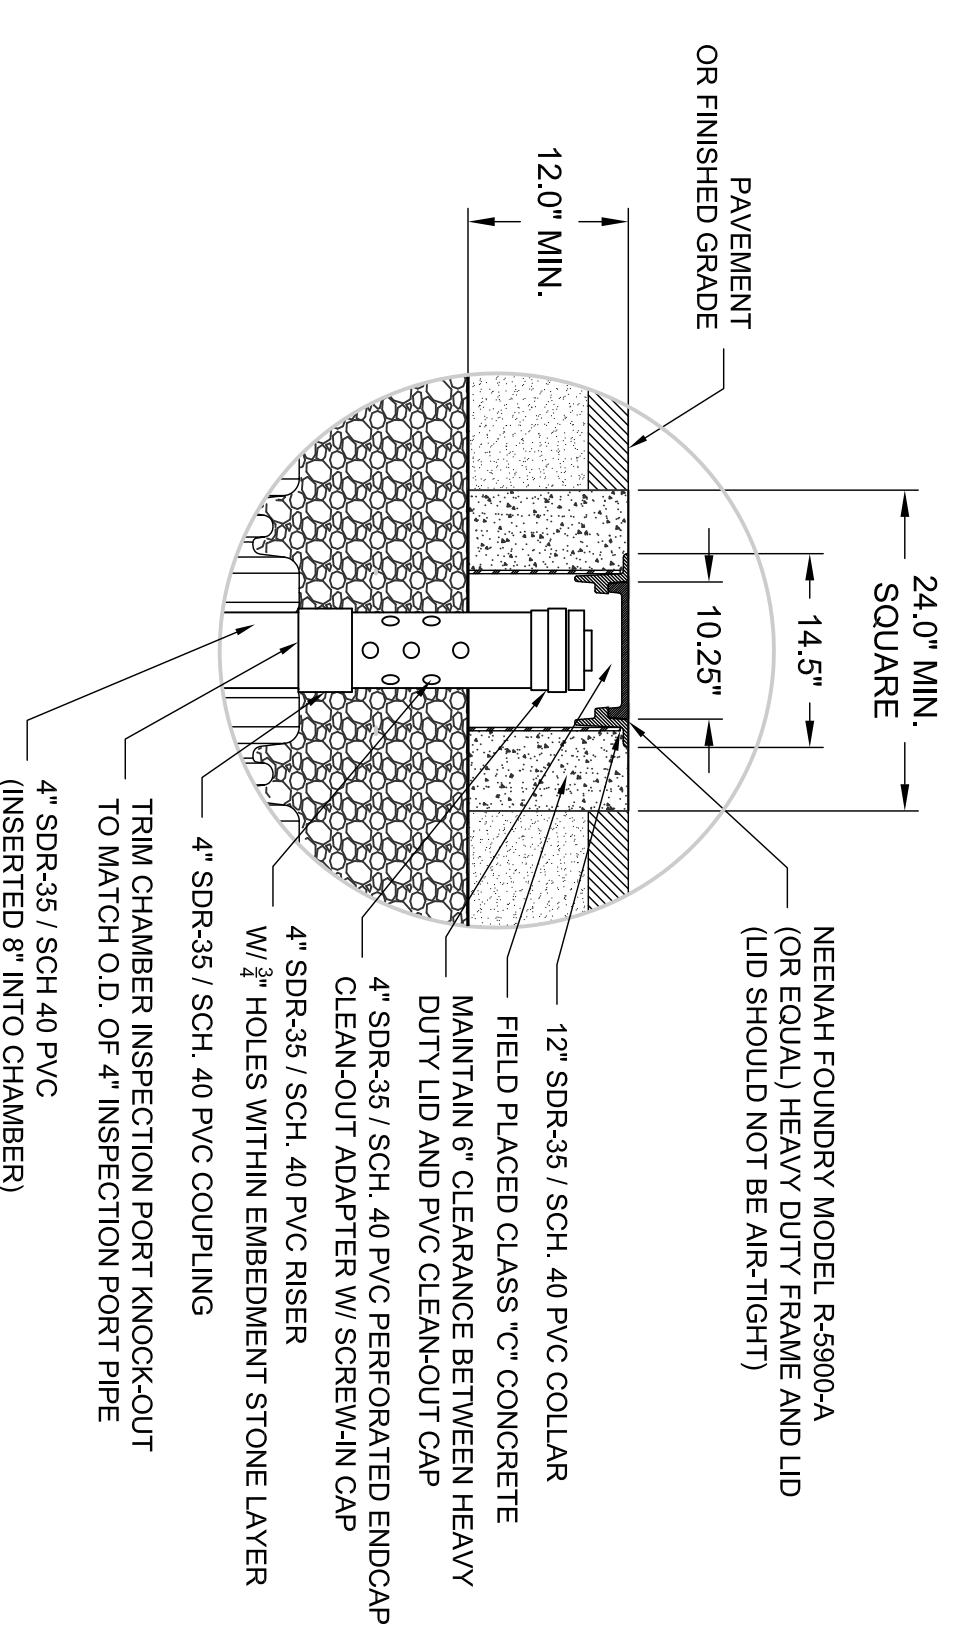


NOTE:
 * INJECTION MOLDED FITTINGS ARE AVAILABLE IN TEES, WYES, REDUCERS, 45° BENDS AND BELL/BELL COUPLERS.
 * WT INJECTION MOLDED FITTINGS AND WT PIPE CAN BE SUBSTITUTED FOR WATER TIGHT APPLICATIONS

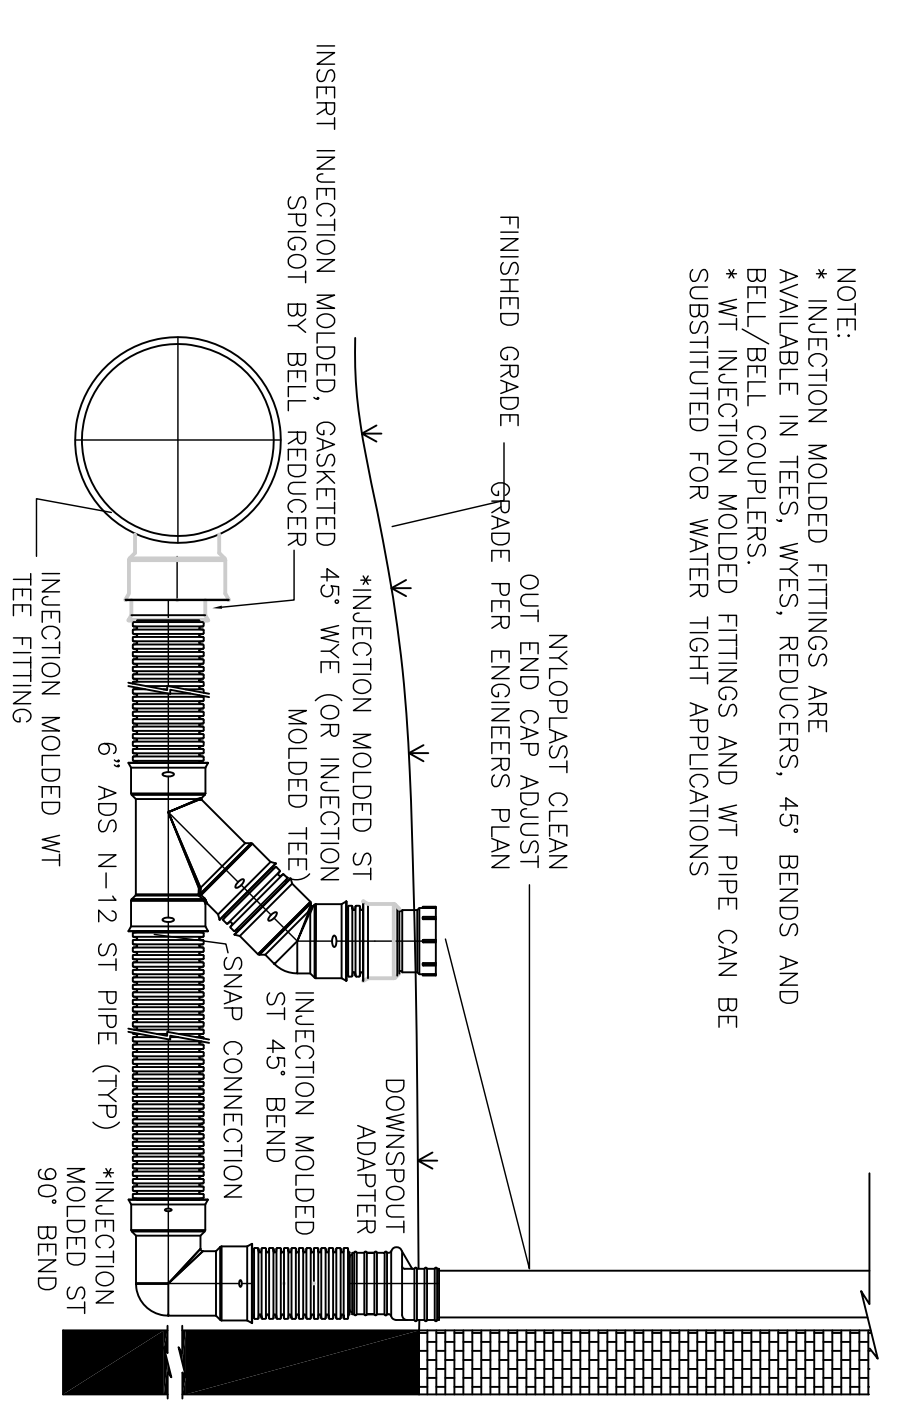


ROOF DRAIN DETAIL WITH CLEANOUT

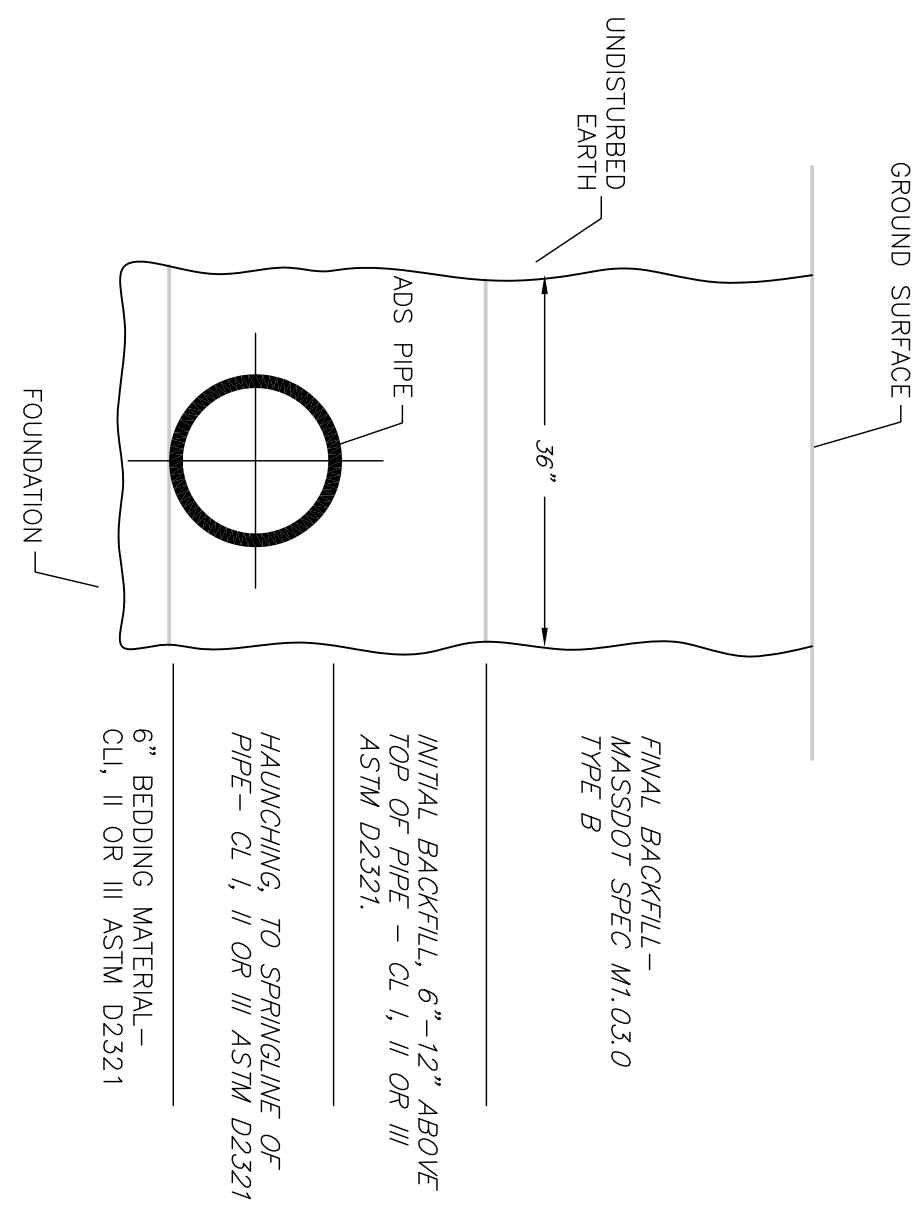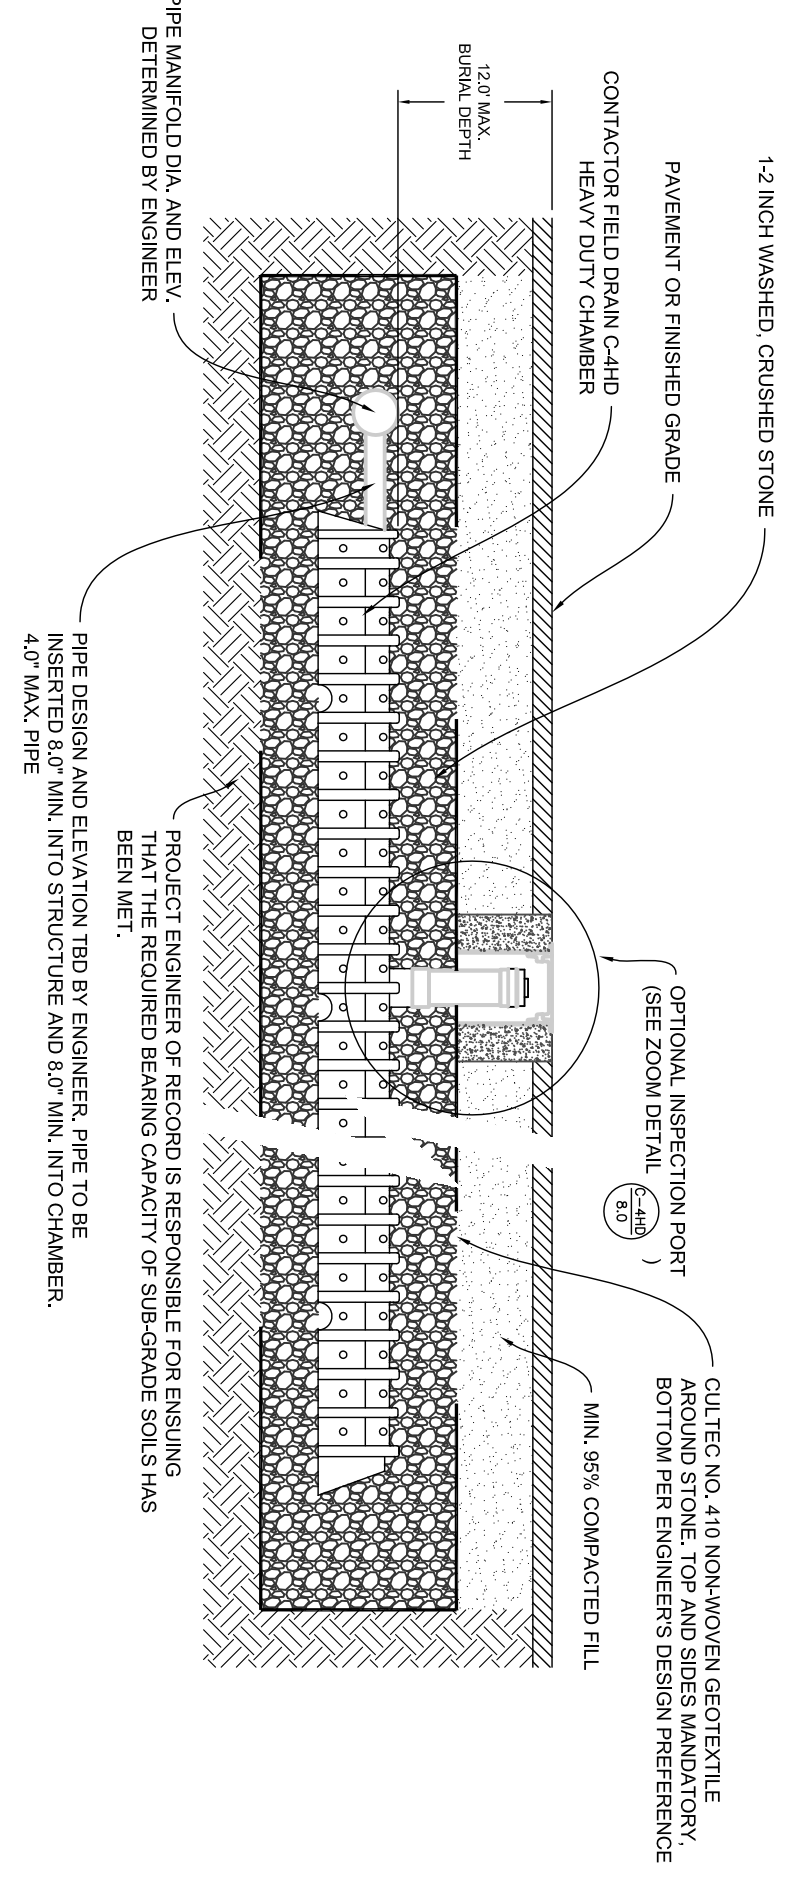

ADS ROOF DRAIN TRENCH DETAIL

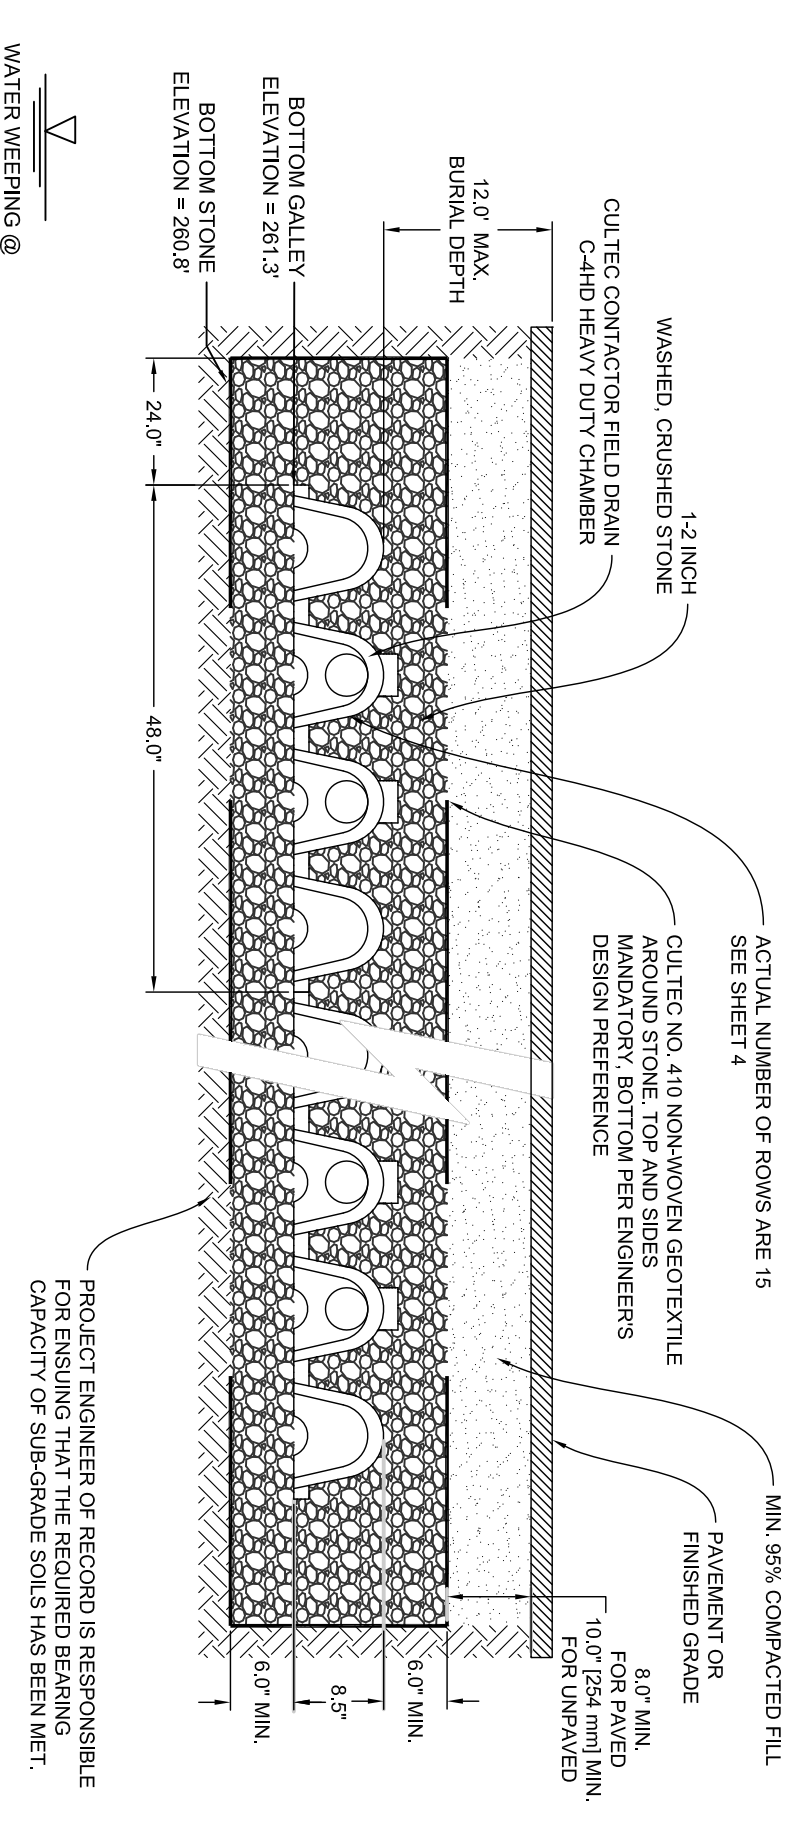


INFILTRATION SYSTEM END VIEW

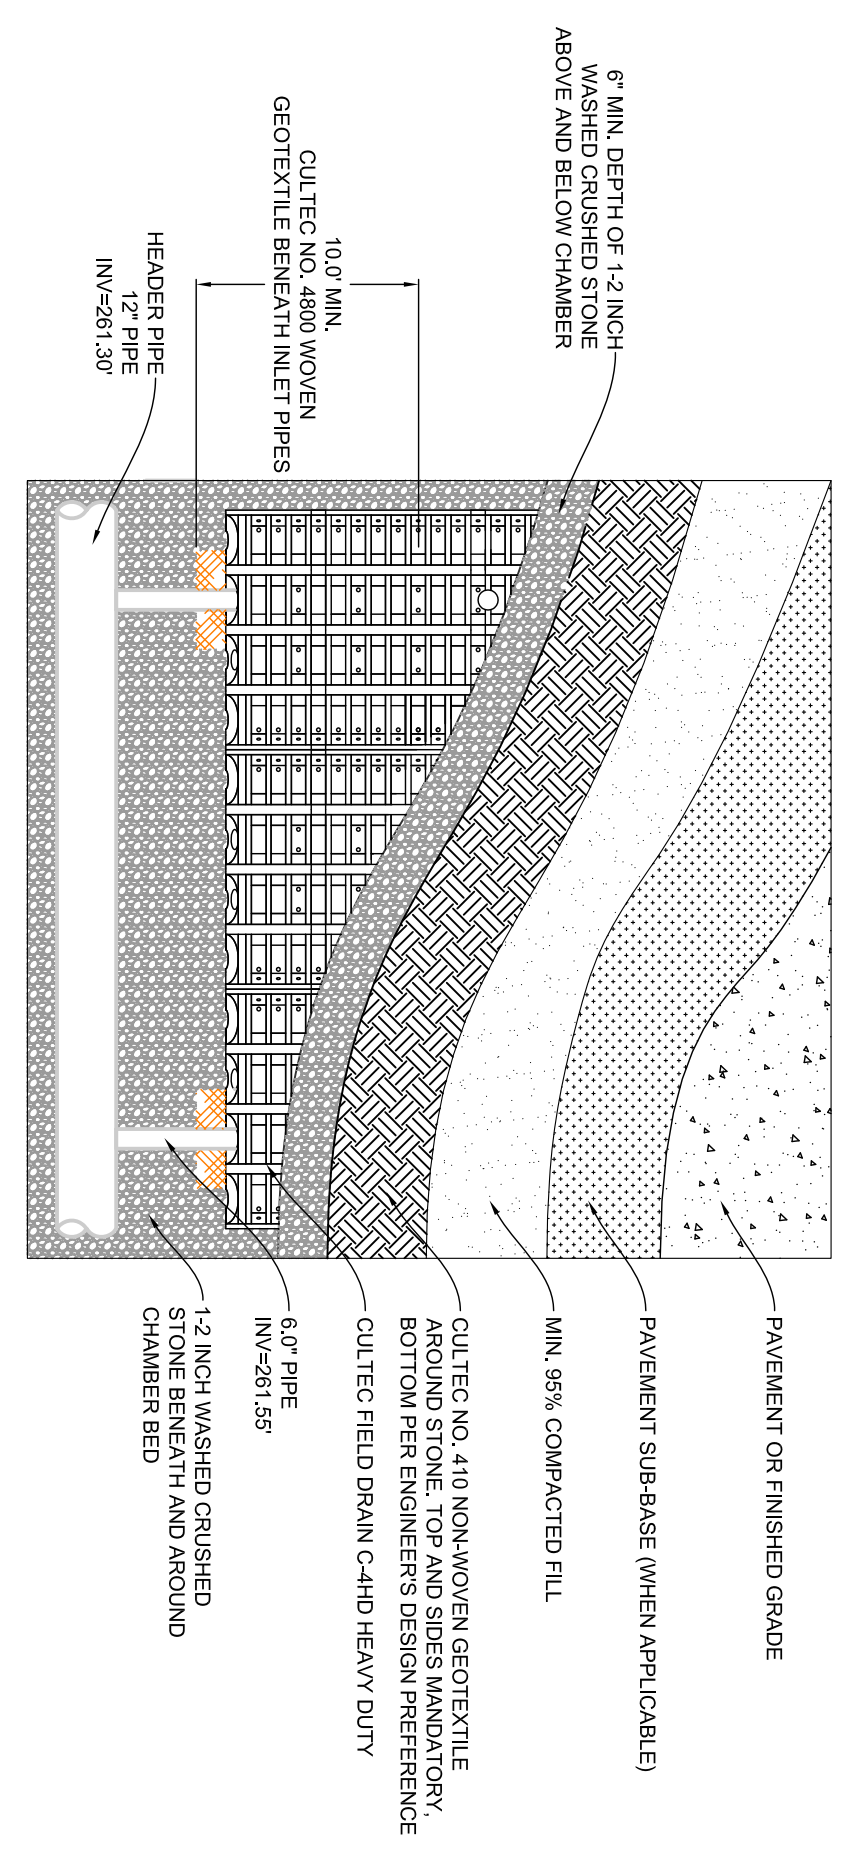

INFILTRATION SYSTEM SECTION VIEW

GRATE OPTIONS		LOAD RATING		PART #		DRAWING #	
PERFORATED	1/2" DIA	1800	1800	1001-1832	1001-1832	1001-1832	1001-1832
PERFORATED	3/4" DIA	1800	1800	1001-1832	1001-1832	1001-1832	1001-1832
PERFORATED	1" DIA	1800	1800	1001-1832	1001-1832	1001-1832	1001-1832
PERFORATED	1 1/2" DIA	1800	1800	1001-1832	1001-1832	1001-1832	1001-1832
PERFORATED	2" DIA	1800	1800	1001-1832	1001-1832	1001-1832	1001-1832
PERFORATED	3" DIA	1800	1800	1001-1832	1001-1832	1001-1832	1001-1832
PERFORATED	4" DIA	1800	1800	1001-1832	1001-1832	1001-1832	1001-1832
PERFORATED	6" DIA	1800	1800	1001-1832	1001-1832	1001-1832	1001-1832
PERFORATED	8" DIA	1800	1800	1001-1832	1001-1832	1001-1832	1001-1832
PERFORATED	12" DIA	1800	1800	1001-1832	1001-1832	1001-1832	1001-1832

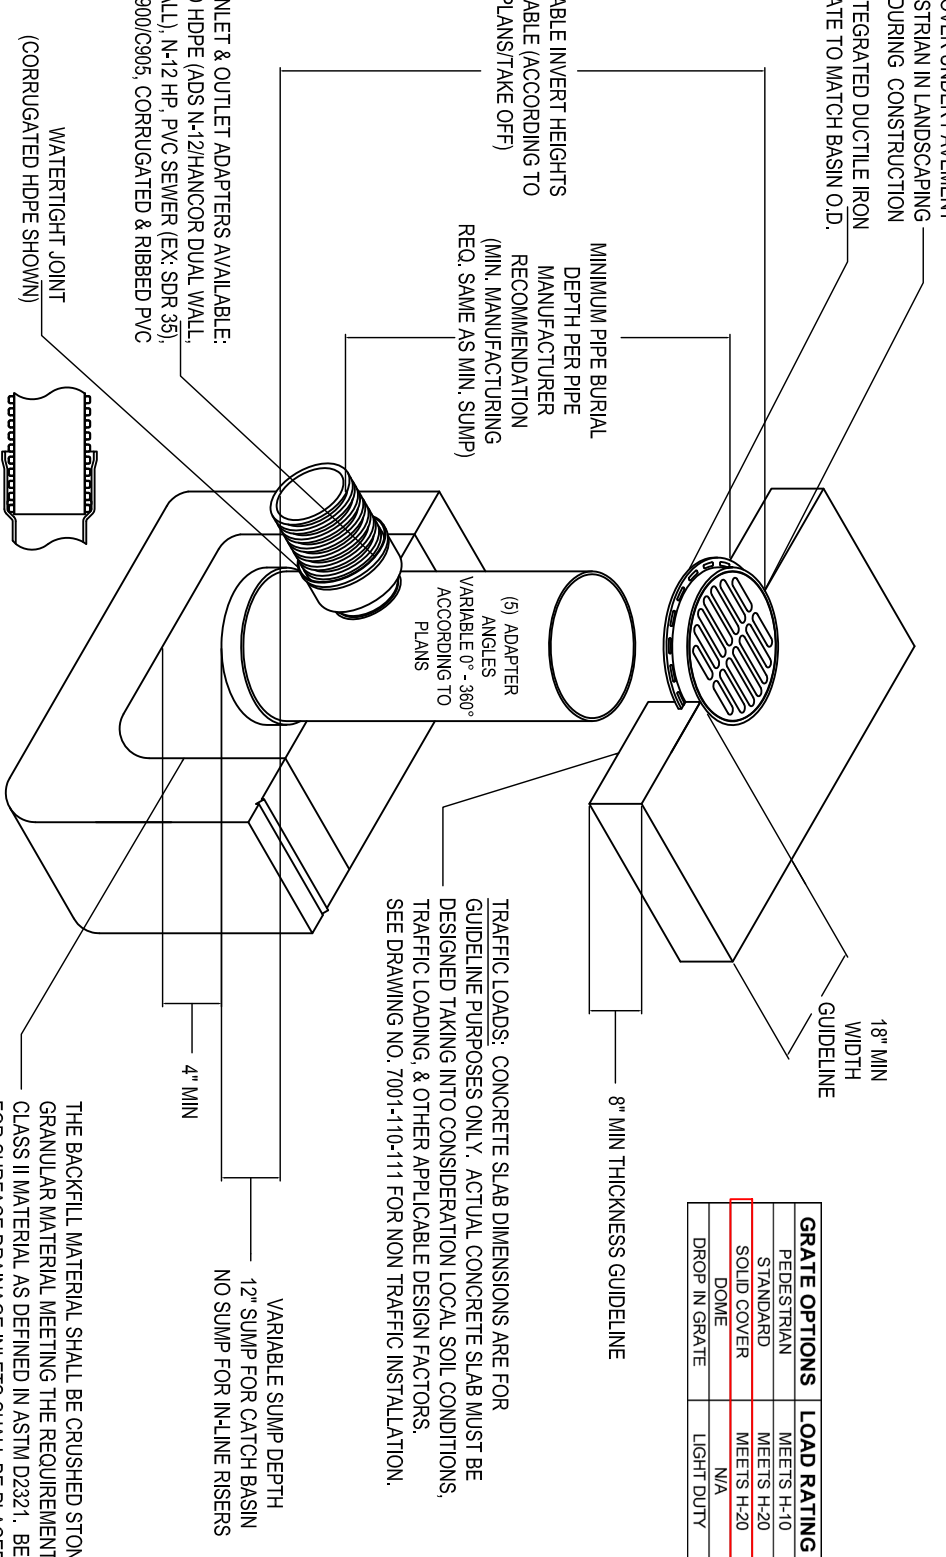

NYLOPLAST 18' DRAIN BASIN: 2818AG __ X (or equivalent)

NYLOPLAST RISER (RDMH) INSTALLATION DETAIL

PROJECT:
**7 Perry Drive
 Foxborough, MA**


OWNER:
**1776 Washington
 Street Realty TR
 Michael R Berube
 Jr Trustee
 7 Perry Drive
 Foxborough, MA**
**BPAZ Holdings,
 31, LLC
 1 Sansome Street
 San Francisco, CA**

Boy Colony Group, Inc.
 Professional Civil Engineers &
 Professional Land Surveyors

FOUR SCHOOL STREET
 P.O. BOX 9136
 FOXBOROUGH, MA 02035
 508-545-3539


DATE APPROVED: _____
 DATE ENDORSED: _____
 FOXBOROUGH PLANNING BOARD

STAMP

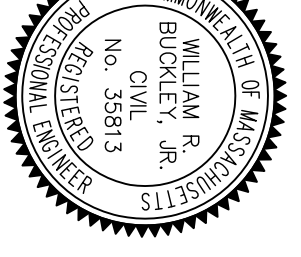


DRAWING TITLE
Detail


SCALE: N.T.S.
 JUNE 14, 2023
 SHEET NUMBER
6

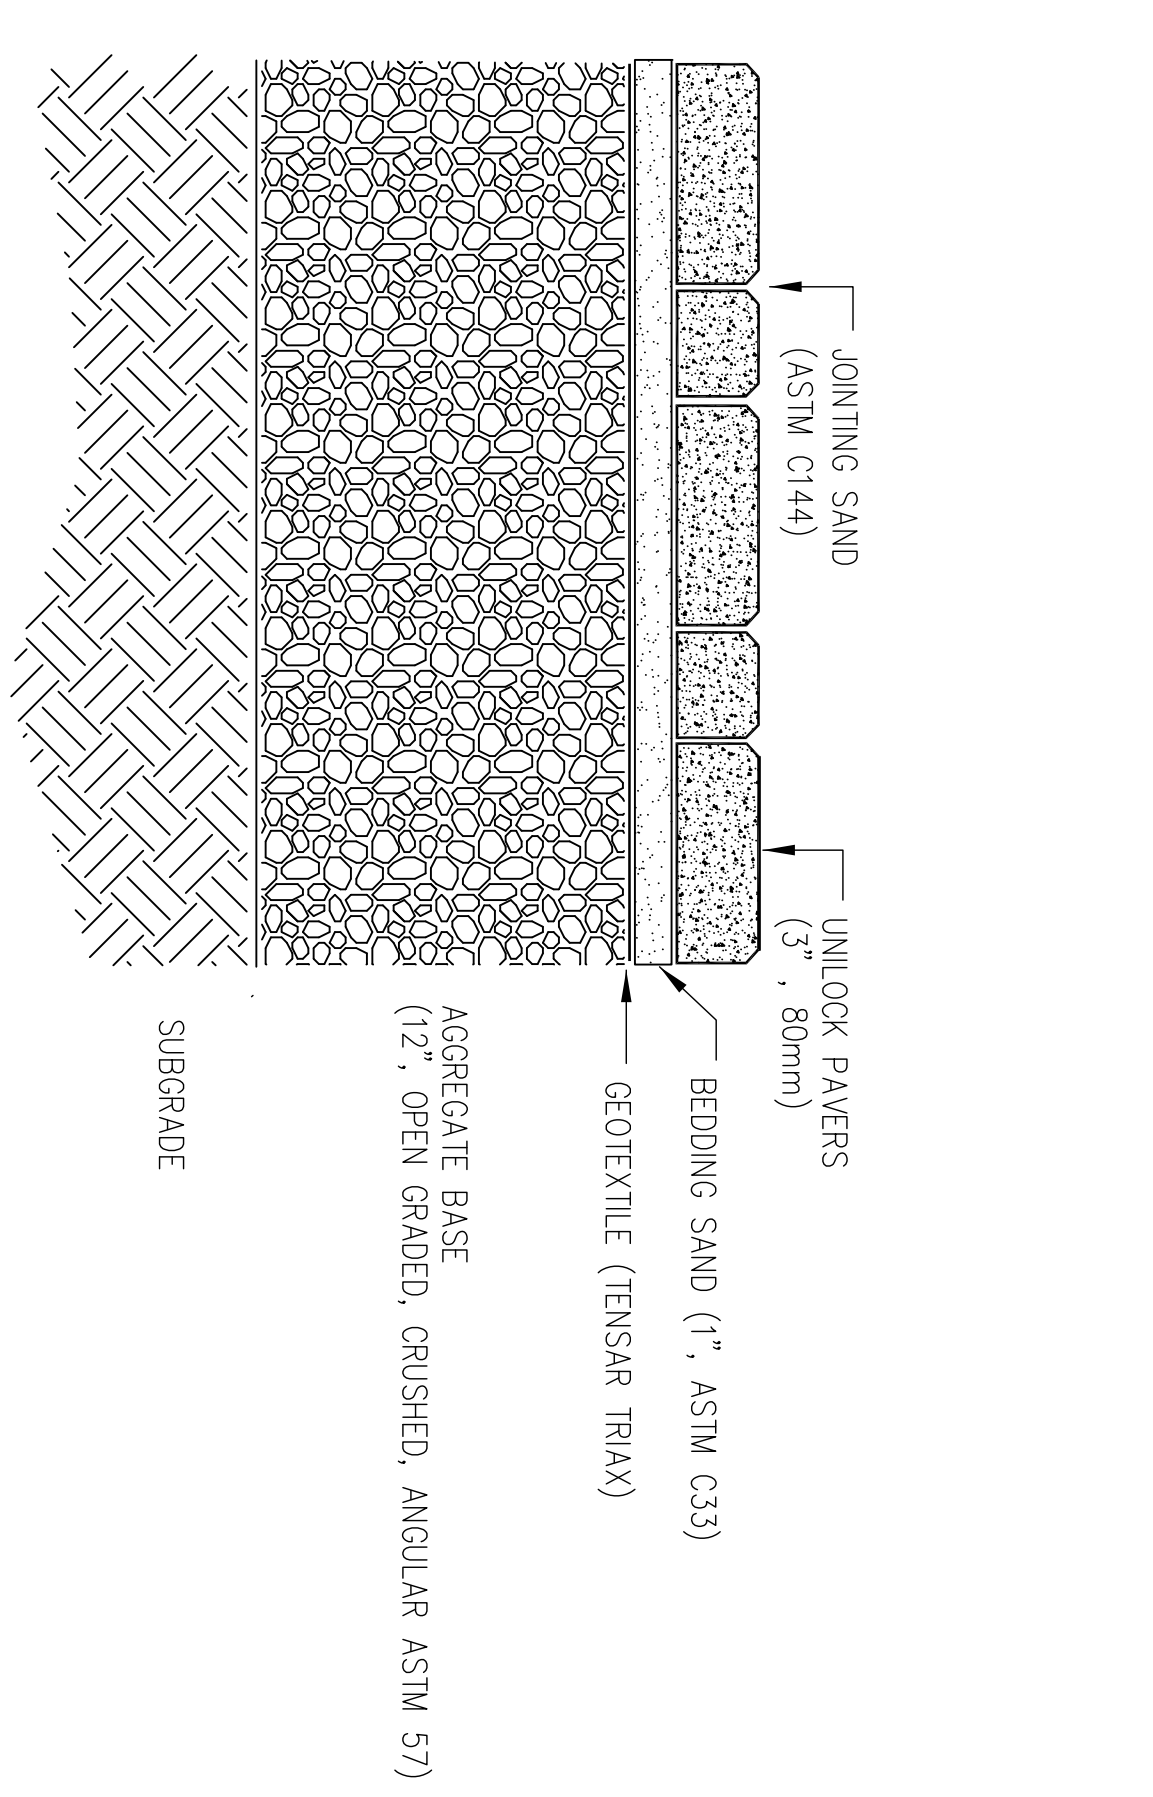


PERMEABLE PAVER DETAIL
 N.T.S.

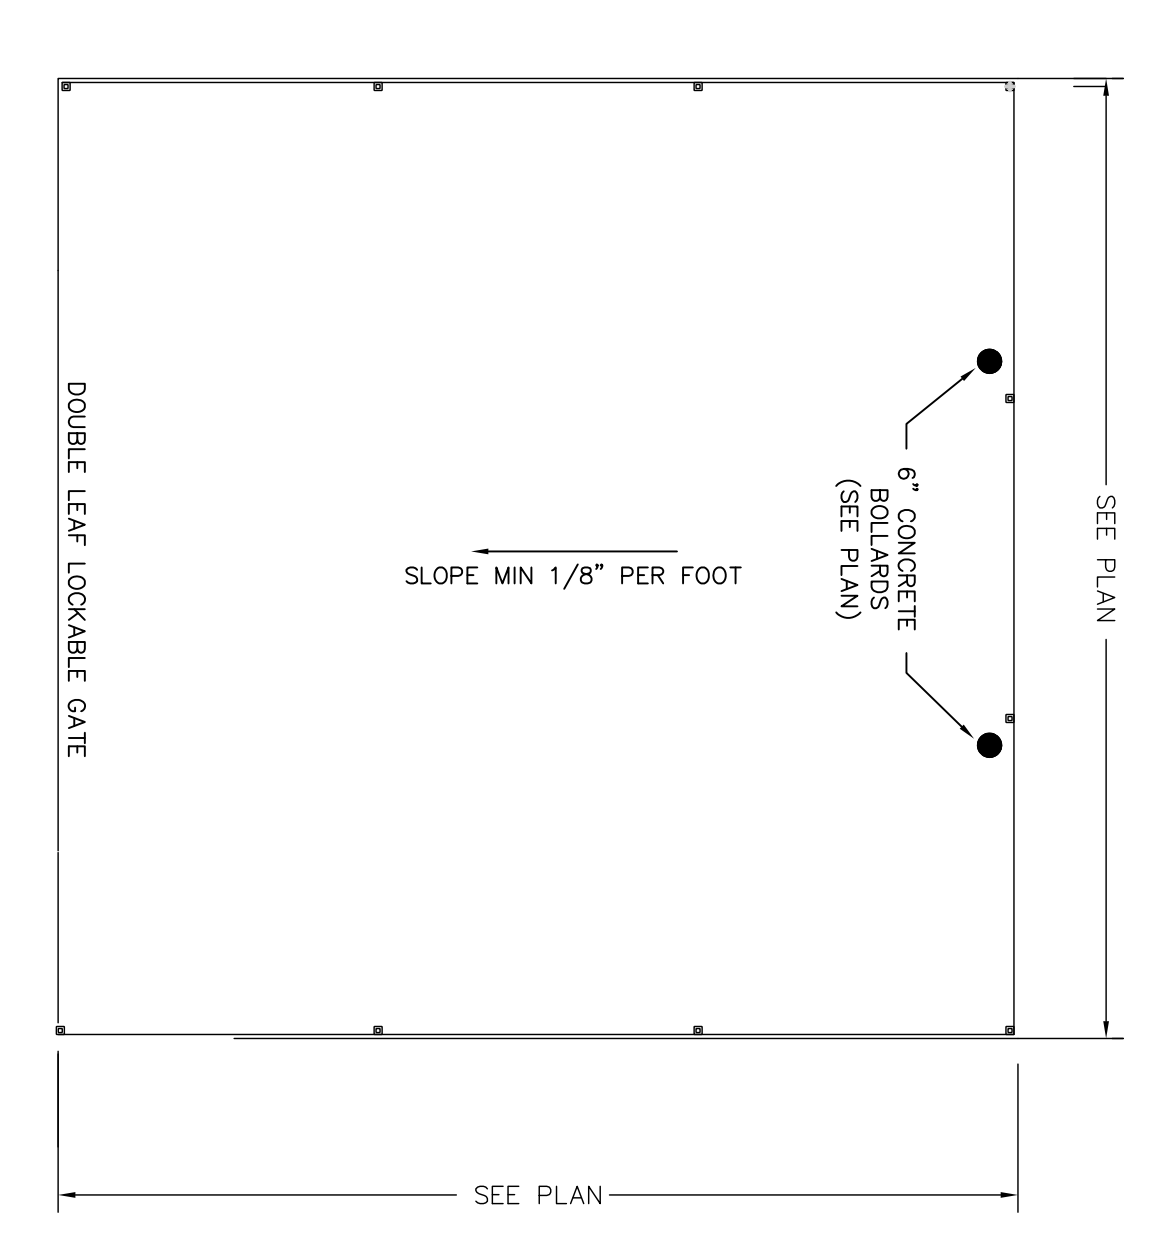


DUMPSTER PAD PLAN
 N.T.S.

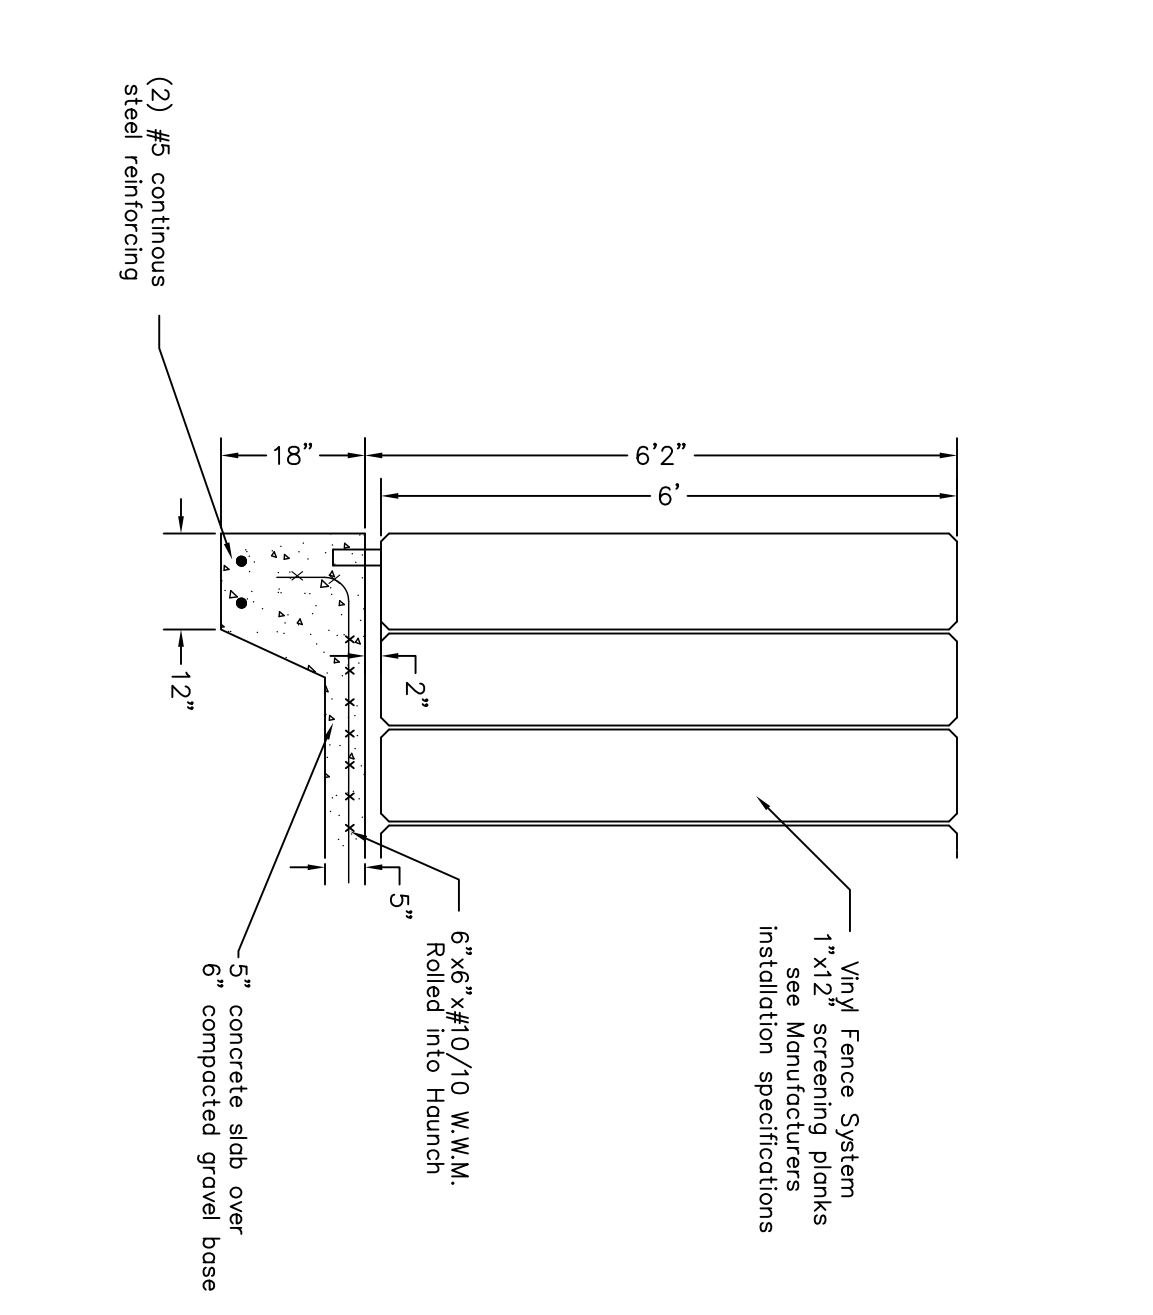


DUMPSTER FENCE SECTION
 N.T.S.

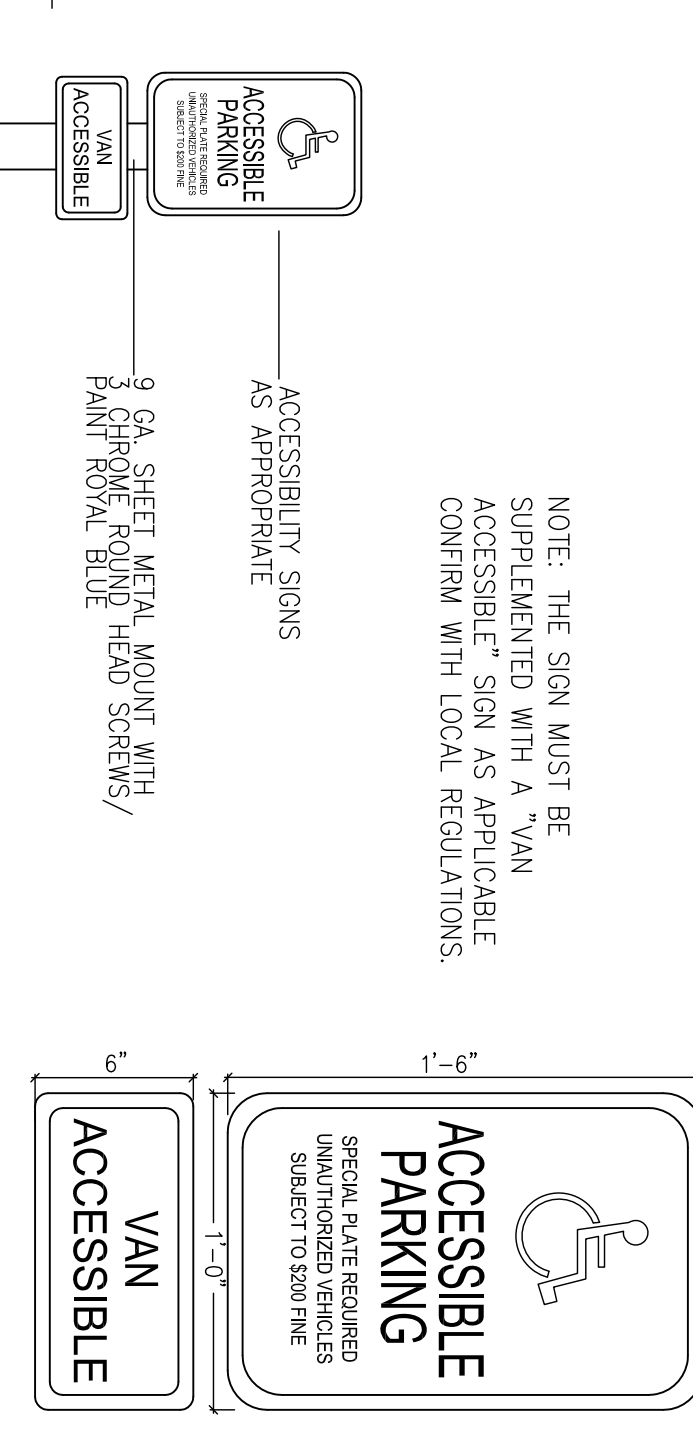


ACCESSIBILITY SIGNS AS APPROPRIATE
 9 GA. SHEET METAL MOUNT WITH 1/4" DIA. SPACERS, ROUND HEAD SCREWS/PAN HEAD NUTS, PAINT ROYAL BLUE
 2" DIA. CONCRETE FILLED STEEL TUBE - CLOSE TOP END AND GRIND SMOOTH/
 PAINT ROYAL BLUE

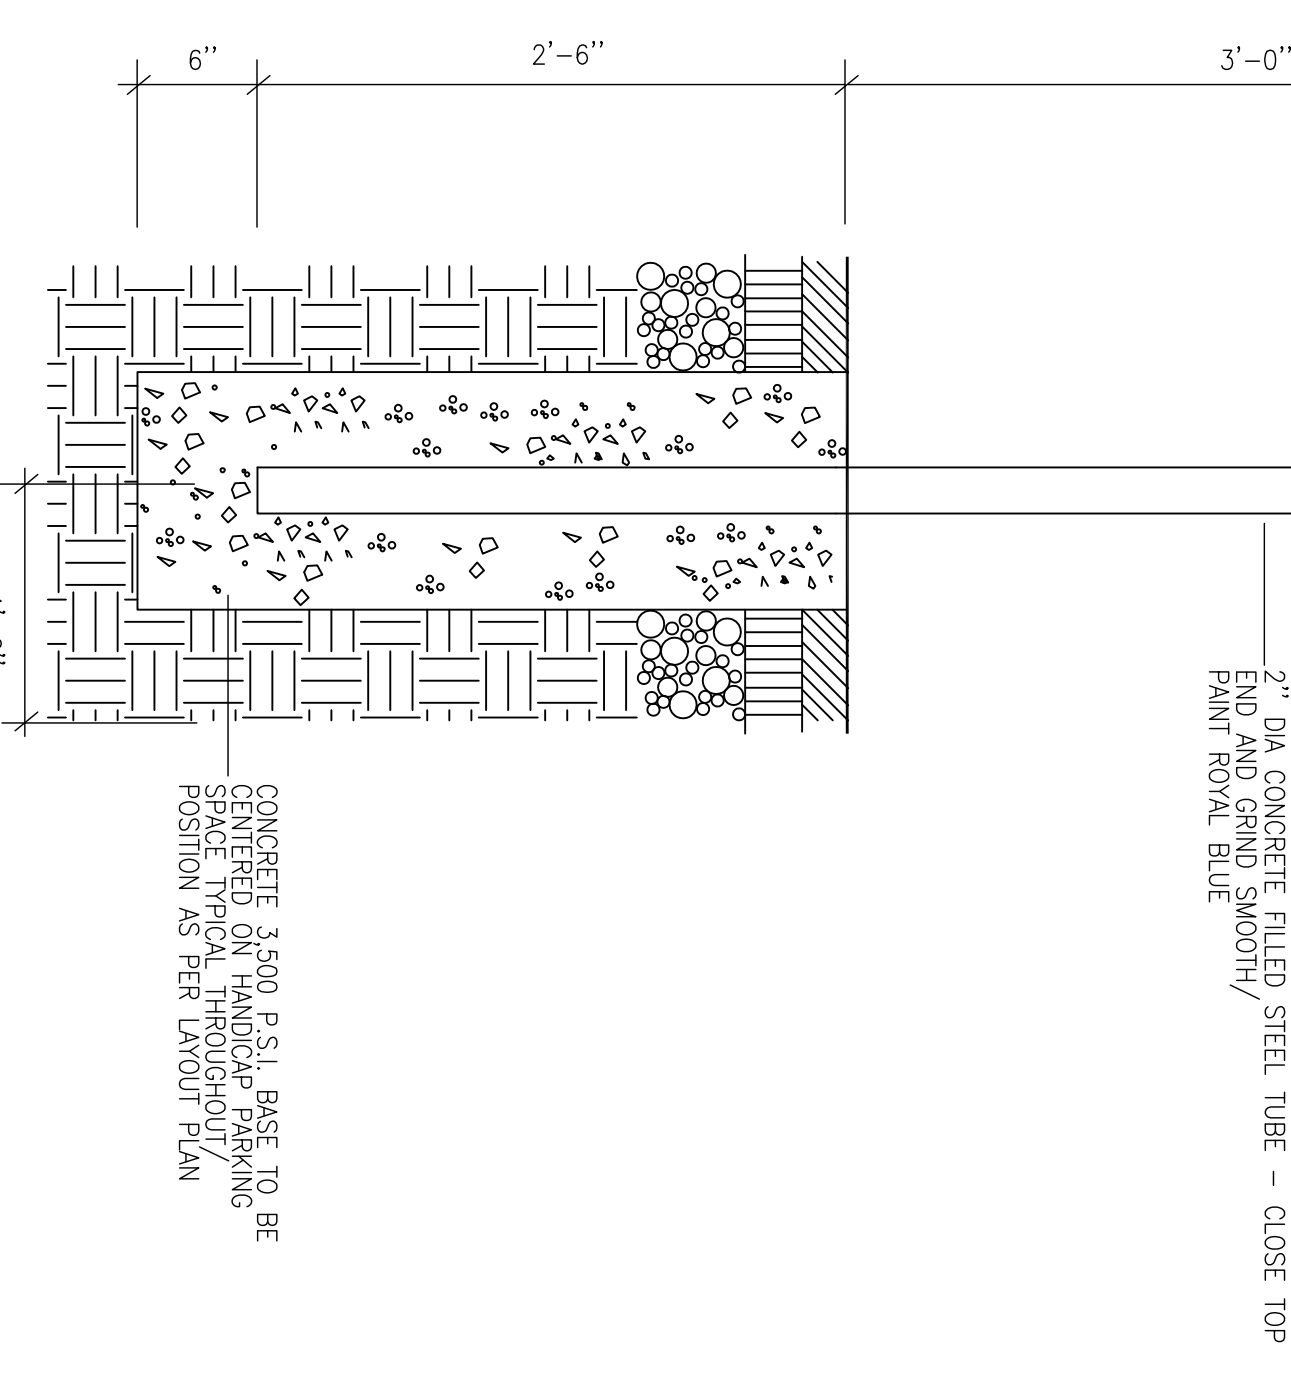


HANDICAP PARKING SIGN
 N.T.S.

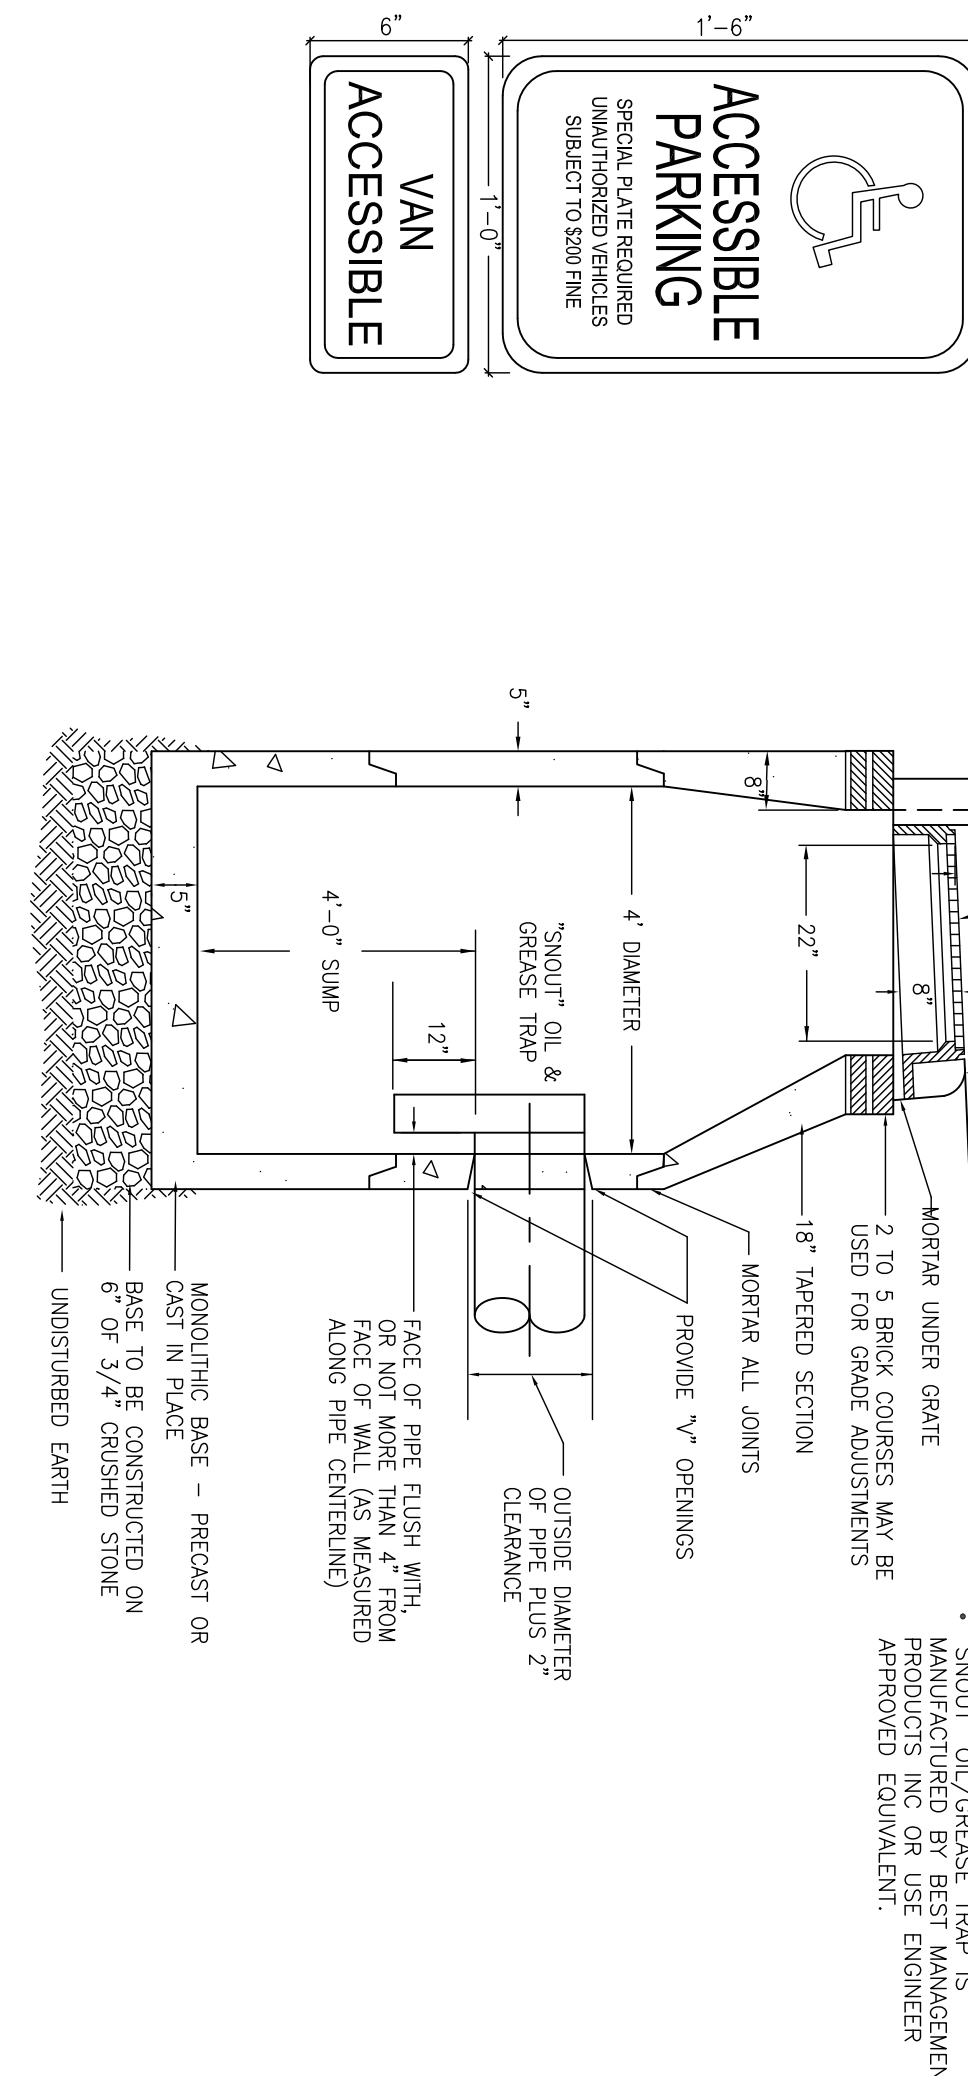


PRECAST CONCRETE CATCH BASIN
 N.T.S.

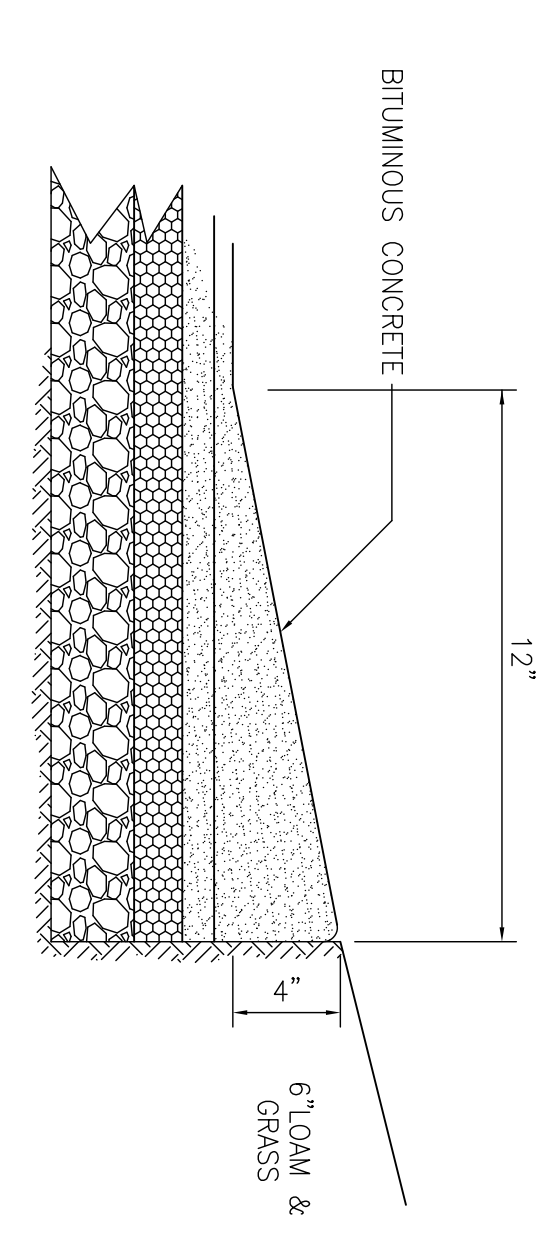

MONOLITHIC BITUMINOUS CURBING
 N.T.S.

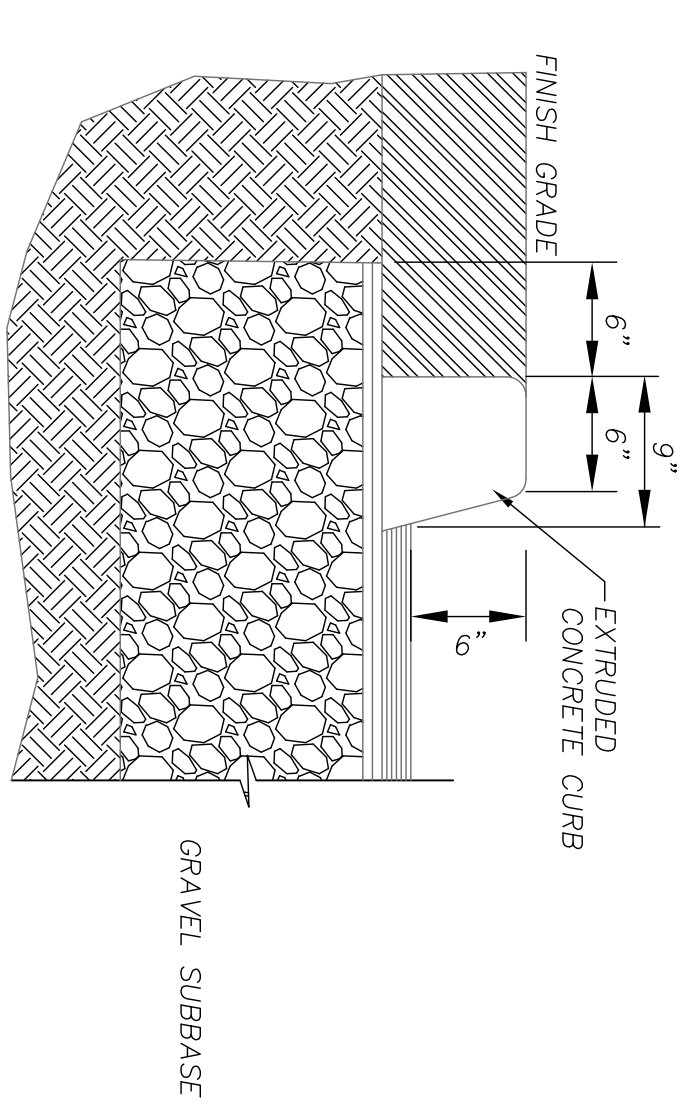

CONCRETE CURBING
 N.T.S.

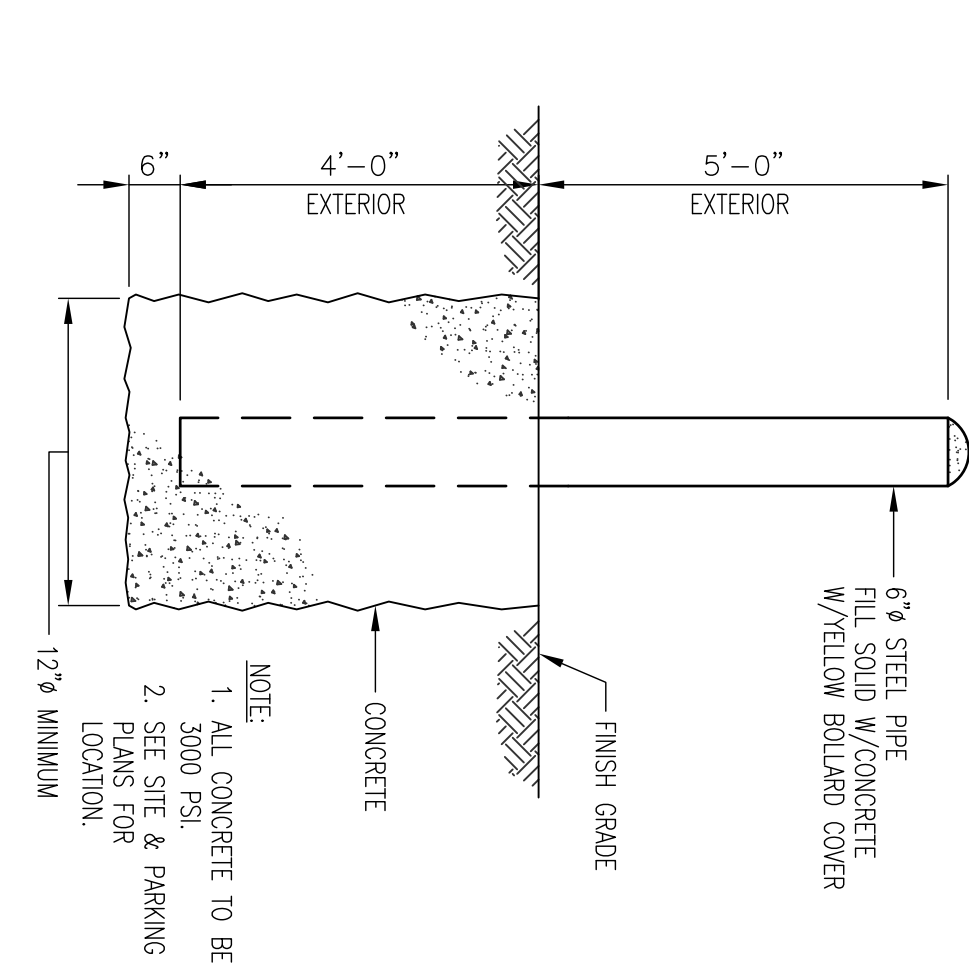

BOLLARD
 N.T.S.

NOTE:
 1. ALL CONCRETE TO BE 3500 PSI.
 2. SEE SITE & PARKING PLANS FOR LOCATION.
 12" MINIMUM

PROJECT:
7 Perry Drive
Foxborough, MA

OWNER:
1776 Washington
Street Realty TR
Michael R Berube
Jr Trustee
7 Perry Drive
Foxborough, MA
BPAZ Holdings,
31, LLC
1 Sansome Street
San Francisco, CA

Boy Colony Group, Inc.
Professional Civil Engineers &
Professional Land Surveyors

FOUR SCHOOL STREET
P.O. BOX 9136
FOXBOROUGH, MA 02035
508-545-5539



DATE APPROVED: _____
DATE ENDORSED: _____
FOXBOROUGH PLANNING BOARD

STAMP







DRAWING TITLE
SWPPP & Snow
Storage Plan

SCALE: 1" = 30'
JUNE 14, 2023 SHEET NUMBER
21-0102D **7**

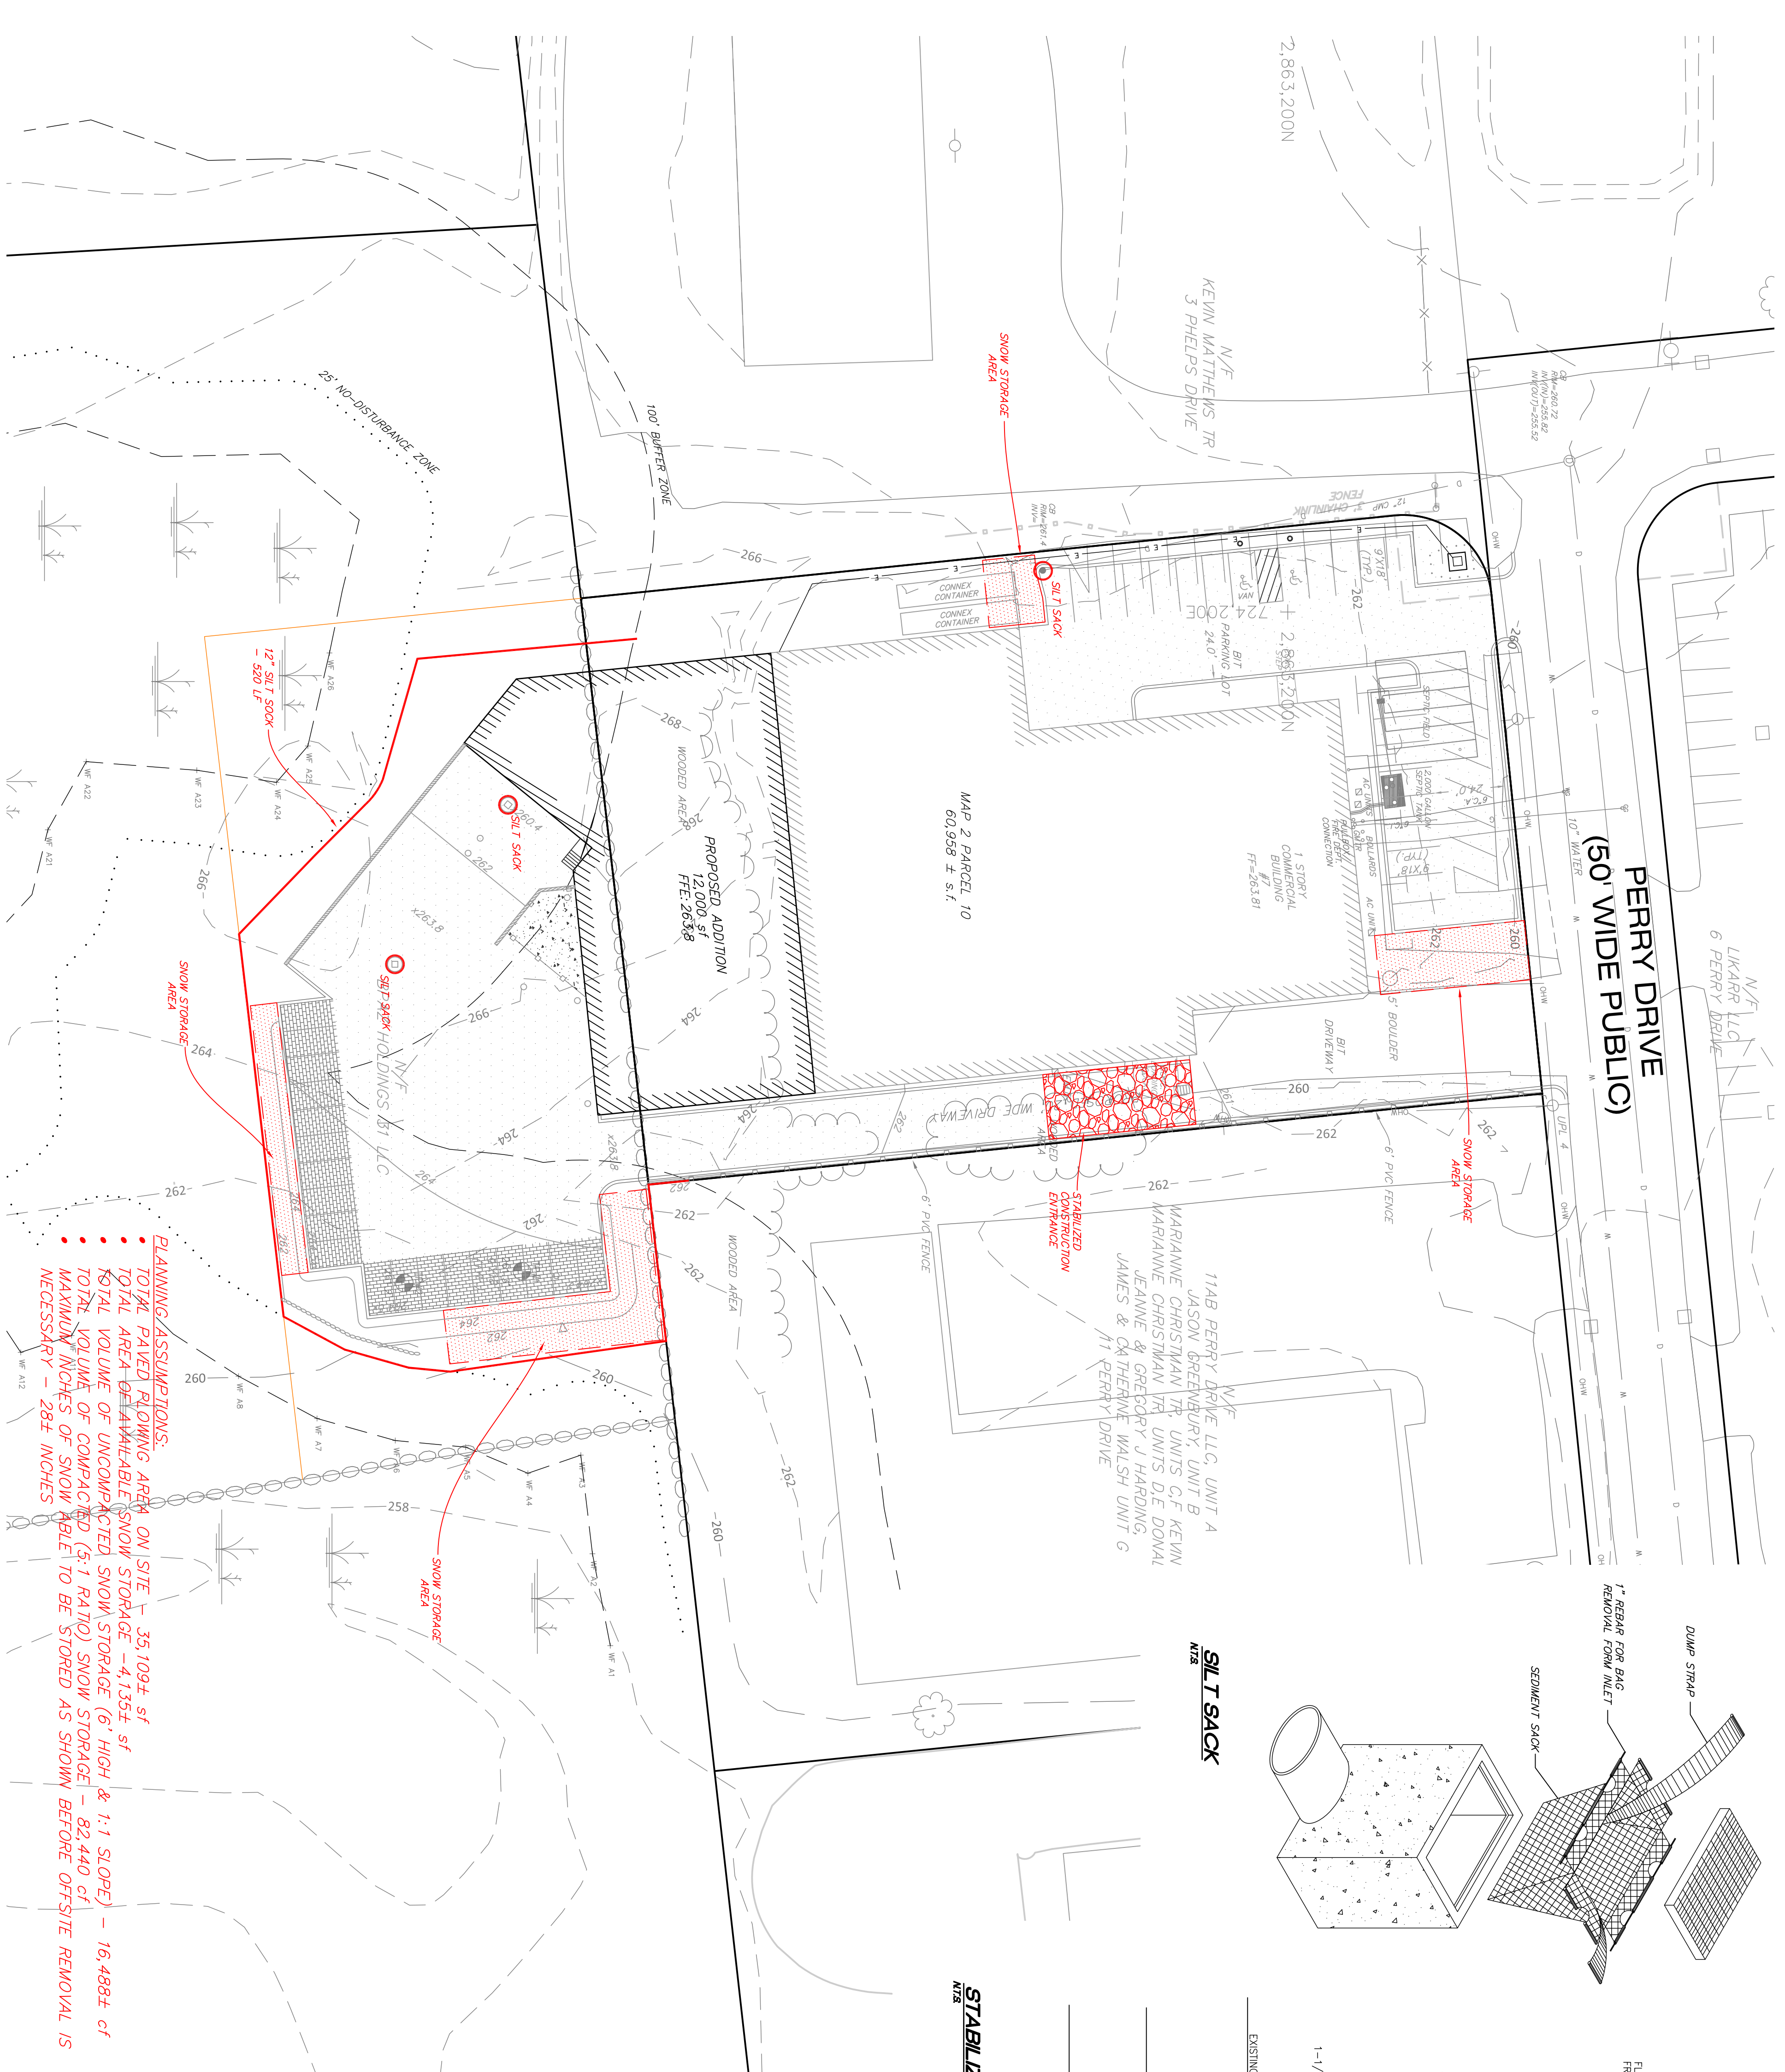

- PLANNING ASSUMPTIONS:**
- TOTAL PAVED PLOWING AREA ON SITE - 35,109± sf
 - TOTAL AREA OF AVAILABLE SNOW STORAGE - 4,135± sf
 - TOTAL VOLUME OF UNCOMPACTED SNOW STORAGE (6" HIGH & 1:1 SLOPE) - 82,440 cf
 - TOTAL VOLUME OF COMPACTED (5:1 RATIO) SNOW STORAGE - 16,488± cf
 - MAXIMUM INCHES OF SNOW ABLE TO BE STORED AS SHOWN BEFORE OFF-SITE REMOVAL IS NECESSARY - 28± INCHES

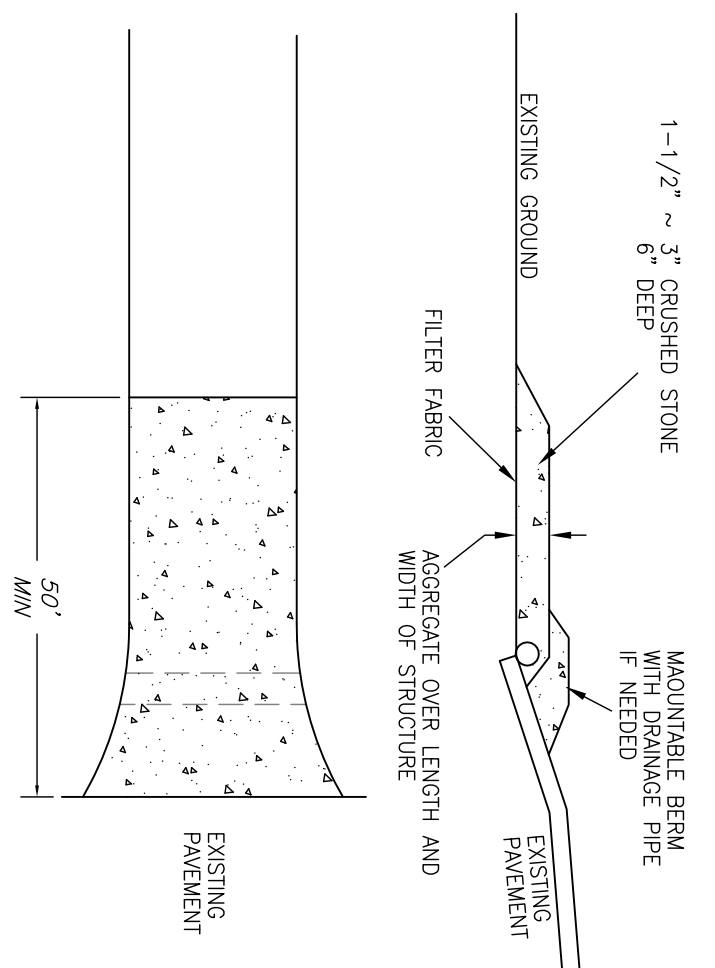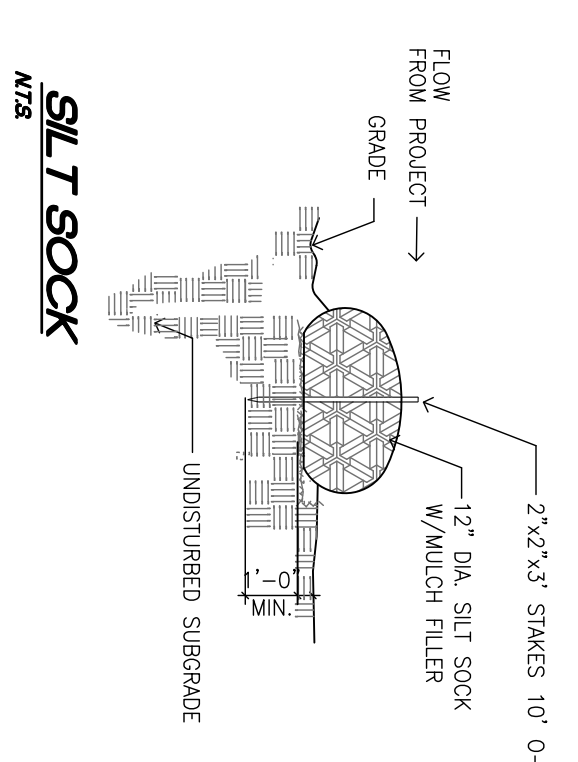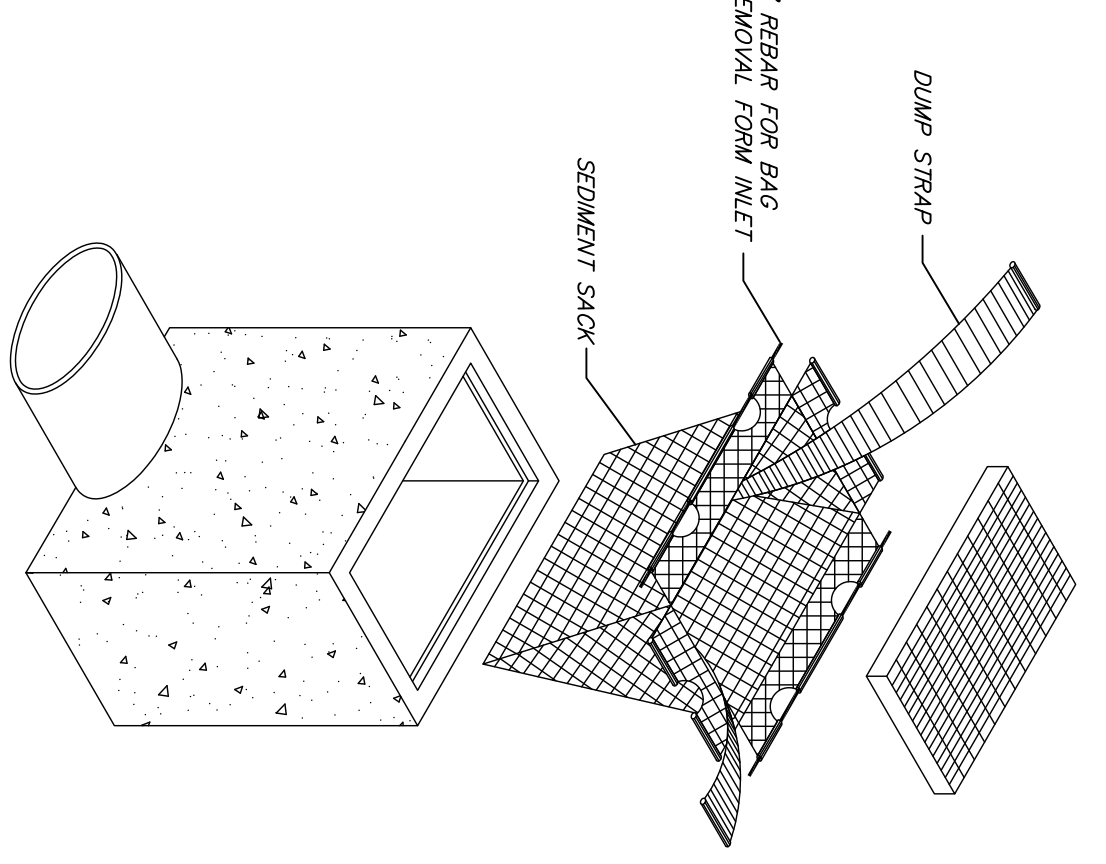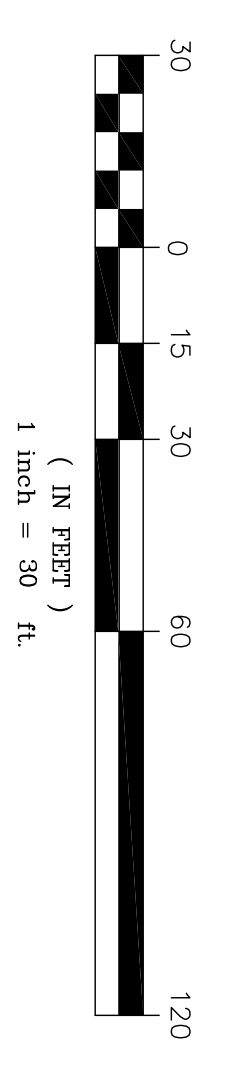

STABILIZED CONSTRUCTION ENTRANCE

PROJECT PHASING

- PHASE 1:
EST. START DATE: _____
EST. FINISH DATE: _____
- INSTALL EROSION CONTROLS AND LIMITS OF WORK, CLEAR TREES TO LIMIT OF WORK, GRUBBING AND REMOVAL OF STUMPS FROM SITE. INSTALLATION OF TEMPORARY SEDIMENT BASINS.
- PHASE 2:
EST. START DATE: _____
EST. FINISH DATE: _____
- IMPORT AND PLACEMENT OF MATERIAL TO BRING PARKING AREAS AND BUILDING TO SUBGRADE. CONSTRUCTION OF BUILDING FOOTINGS AND FOUNDATIONS.
- PHASE 3:
EST. START DATE: _____
EST. FINISH DATE: _____
- INSTALLATION OF DRAINAGE AND UTILITIES. CONSTRUCTION OF STORM WATER BASIN. CONTINUE CONSTRUCTION OF BUILDING. BASE COURSE OF PAVEMENT.
- PHASE 4:
EST. START DATE: _____
EST. FINISH DATE: _____
- COMPLETE CONSTRUCTION OF BUILDING AND FINISHED COURSE OF PAVEMENT. COMPLETE LANDSCAPING OF DISTURBED AREAS. REMOVE EROSION CONTROLS ONCE SITE IS FULLY STABILIZED.